



# Operation Manual

## PRODUCT NAME

Digital Flow Switch  
( IO-Link compatible)

## MODEL/ Series/ Product Number

*PF3A703H-L*  
*PF3A706H-L*  
*PF3A712H-L*

**SMC Corporation**



## Table of Contents

Safety Instructions	4
Model Indication and How to Order	12
Names and Functions of Individual Parts	13
Definition and terminology	15
Mounting and Installation	17
Installation	18
Piping method	19
Wiring	20
Outline of Settings [Measurement mode]	26
Change of Set Value [3 step setting mode]	27
Default setting	27
Change of Set Flow and Hysteresis [Simple setting mode]	30
Change the Function Settings [Function selection mode]	32
Function selection mode	32
Default setting	33
F0 Reference condition/Units selection function/Switch output function	34
F1 Setting of OUT1	36
F3 Select digital filter	45
F5 FUNC setting	46
F10 Sub display setting (Line name setting)	49
F13 Setting for reverse display mode	51
F14 Zero cut-off setting	52
F30 Setting of accumulated value holding time	56
F80 Set display OFF mode	57
F81 Security code	58
F90 Setting of all functions	60
F96 Check of input signal	62
F98 Setting of output check	63
F99 Reset to the default settings	66

Other Settings	67
Maintenance	70
Forgotten the Security Code	70
IO-Link Specifications	71
Outline of IO-Link functions	71
Communication specifications	71
Process data	72
IO-Link parameter setting	75
Troubleshooting	86
Error display	90
Specifications	91
Characteristics data	94
Dimensions	97



# Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of “**Caution**,” “**Warning**” or “**Danger**.” They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC)<sup>\*1</sup>, and other safety regulations.

\*1) ISO 4414: Pneumatic fluid power - General rules and safety requirements for systems and their components  
ISO 4413: Hydraulic fluid power - General rules and safety requirements for systems and their components  
IEC 60204-1: Safety of machinery - Electrical equipment of machines - Part 1: General requirements  
ISO 10218-1: Robots and robotic devices - Safety requirements for industrial robots - Part 1: Robots  
etc.



## Danger

**Danger** indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.



## Warning

**Warning** indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.



## Caution

**Caution** indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.



## Warning

### 1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalog information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

### 2. Only personnel with appropriate training should operate machinery and equipment.

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

### 3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.

1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.

### 4. Our products cannot be used beyond their specifications. Our products are not developed, designed, and manufactured to be used under the following conditions or environments. Use under such conditions or environments is not covered.

1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
2. Use for nuclear power, railways, aviation, space equipment, ships, vehicles, military application, equipment affecting human life, body, and property, fuel equipment, entertainment equipment, emergency shut-off circuits, press clutches, brake circuits, safety equipment, etc., and use for applications that do not conform to standard specifications such as catalogs and operation manuals.
3. Use for interlock circuits, except for use with double interlock such as installing a mechanical protection function in case of failure. Please periodically inspect the product to confirm that the product is operating properly.



# Safety Instructions

## Caution

**We develop, design, and manufacture our products to be used for automatic control equipment, and provide them for peaceful use in manufacturing industries.**

**Use in non-manufacturing industries is not covered.**

Products we manufacture and sell cannot be used for the purpose of transactions or certification specified in the Measurement Act.

The new Measurement Act prohibits use of any unit other than SI units in Japan.

## Limited warranty and Disclaimer/Compliance Requirements

The product used is subject to the following “Limited warranty and Disclaimer” and “Compliance Requirements”. Read and accept them before using the product.

### Limited warranty and Disclaimer

1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered, whichever is first.\*2)  
Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.
2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided.  
This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.
3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalog for the particular products.

**\*2) Vacuum pads are excluded from this 1 year warranty.**

A vacuum pad is a consumable part, so it is warranted for a year after it is delivered.

Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty

### Compliance Requirements

1. The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.
2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.

## ■ Operator

- ◆ This Operation Manual is intended for those who have knowledge of machinery using pneumatic equipment, and have sufficient knowledge of assembly, operation and maintenance of such equipment.  
Only those persons are allowed to perform assembly, operation and maintenance.
- ◆ Read and understand this Operation Manual carefully before assembling, operating or providing maintenance to the product.

## ■ Safety Instructions


### Warning

- Do not disassemble, modify (including the replacement of board) or repair.  
Otherwise, an injury or failure can result.
- Do not operate the product outside of the specifications.  
Do not use the product with flammable or harmful fluids.  
Fire, malfunction, or damage to the product may result.  
Check the specifications before use.
- Do not use in an environment where flammable, explosive or corrosive gases are present.  
Otherwise, fire, explosion or corrosion may occur.  
The product is not designed to be explosion proof.
- Do not use the product with flammable fluid  
Fire or an explosion may result.  
Only air and N<sub>2</sub> are applicable.
- Do not use the product in a place where static electricity is a problem.  
Otherwise failure or malfunction of the system can result.
- If using the product in an interlocking circuit
  - Provide a double interlocking system, for example a mechanical system.
  - Check the product regularly for proper operation.Otherwise malfunction can result, causing an accident.
- The following instructions must be followed during maintenance
  - Turn off the power supply.
  - Stop the air supply, exhaust the residual pressure in piping and verify that the air is released before performing maintenance work.Otherwise an injury can result.

## Caution

- Do not touch the terminals and connectors while the power is on.  
Otherwise electric shock, malfunction and damage to the product can result.
- After maintenance is complete, perform appropriate functional inspections and leak test.  
Stop operation if the equipment does not function properly or there is leakage of fluid.  
When leakage occurs from parts other than the piping, the product itself may be damaged.  
Cut off the power supply and stop the fluid supply.  
Do not apply fluid if the system is leaking.  
Otherwise, an unexpected malfunction may occur and it will become impossible to ensure safety.

### ■ Handling Precautions


- Follow the instructions given below for selecting and handling.
  - The instructions on design and selection (installation, wiring, environment, adjustment, operation, maintenance, etc.) described below must be followed.
    - \*Product specifications
      - The direct current power supply to be used should be UL approved as follows.  
Circuit (of class 2) which is of maximum 30 Vrms (42.4 V peak) or less, with UL 1310 class 2 power supply unit or UL 1585 class 2 transformer.
      - The direct current power supply to be used should be UL approved as follows.
      - The product is a UL approved product only if it has a  mark on the body.
      - Use the specified voltage.  
Otherwise failure or malfunction can result.  
Insufficient supply voltage may not drive a load due to a voltage drop inside the product.  
Check the operating voltage of the load before use.
      - Do not apply a load that exceeds the max. load voltage or current.  
This may cause damage or shorten the lifetime of the product.
      - Data stored by the product is not deleted, even if the power supply is cut off.  
(Limit to rewrite: 1,500,000 times)
      - The applicable fluids for this product are dry air and N<sub>2</sub>.  
The operating fluid temperature range is 0 to 50 °C.
      - Before designing piping confirm the pressure loss (Characteristic data) at the sensor from the pressure loss graph. Confirm pressure loss of the sensor from the characteristics data.
      - For the details of compressed air quality, refer to JIS B 8392: 2012[6: 6: 4].  
Use an air filter with 5 μm or less filtration rating on the inlet side.
      - Use within the specified measurement flow rate and operating pressure.  
Otherwise it will not be able to perform proper measurement due to delivery delay of the fluid.
      - Reserve a space for maintenance.  
Design the system allowing the required space for maintenance.

● **Product handling**

\* **Mounting**

- Tighten to the specified tightening torque.  
If the tightening torque is exceeded, the product can be damaged.  
Insufficient torque can cause displacement of the product from its proper position and the looseness of the mounting screws.
  - If a commercially available switching power supply is used, be sure to ground the frame ground (FG) terminal.
  - Do not drop, hit or apply excessive shock to the product.  
Otherwise damage to the internal components may result, causing malfunction.
  - Do not pull the lead wire forcefully, or lift the product by the lead wire.  
(Tensile strength 49 N or less)  
Hold the product by the body when handling to prevent damage.
  - When connecting the piping, hold the piping and a part of the metal area with a spanner.  
Holding other parts of the product with a spanner may damage the product.
  - Any dust left in the piping should be flushed out by air blow before connecting the piping to the product.  
Otherwise it can cause damage or malfunction.
  - Refer to the flow direction of the fluid indicated on the product label for installation and piping.
  - Do not mount the body with the bottom facing upwards.  
Retention of air can cause inability to measure accurately.
  - Do not insert metal wires or other foreign matter into the flow path.  
This can damage the sensor causing failure or malfunction.
  - Never mount the product in a place that will be used as a scaffold during piping.  
The product may be damaged if excessive force is applied by stepping or climbing onto it.
  - Do not apply excessive rotation force to the monitor.  
The monitor with integrated display can be rotated 90° clockwise.  
Rotating the display with excessive force will damage the end stopper.
  - Visibility decreases if the display is viewed from the opposite side to the buttons.  
Check the settings and display from in front of the display.
  - If there is a risk of foreign matter entering the fluid, install a filter of mist separator at the inlet to avoid failure and malfunction.  
Otherwise it can cause damage or malfunction. Or the flow switch will become unable to measure accurately.  
Air quality specified in the product specifications can be satisfied by using the pneumatic circuit below.
  - Do not connect equipment or piping which may generate a fluctuation in the flow or drift at the IN side of the product.  
When installing the regulator at the IN side of the product, make sure that hunting is not generated.
  - The piping on the IN side must have a straight section of piping whose length is 8 times the piping I.D. or more. If a straight section of piping is not installed, the accuracy will vary by more than ±3%F.S.
- \*: "Straight section" means a section of the piping without any bends or rapid changes in the cross sectional area.

**Recommended pneumatic circuit example (for compressed air)**

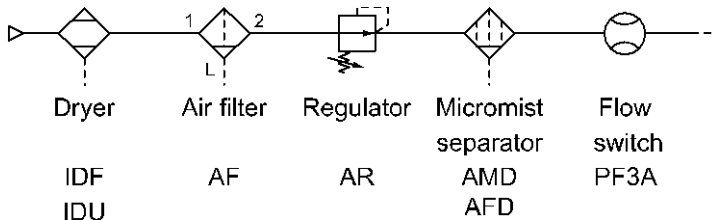



\*Wiring (Including connecting/ disconnecting of the connectors)

- Do not pull hard on the lead wire. Especially never lift the product equipped with fitting and piping by holding the lead wires.

Damage to the connector, circuit board, cover or internal components may result, causing failure or malfunction.

- Avoid repeatedly bending, stretching or applying a heavy object or force to the lead wire.

Repetitive bending stress or tensile stress can cause the sheath of the wire to peel off, or breakage of the wire.

If the lead wire can move, secure it near the body of the product.

The recommended bend radius of the lead wire is 6 times the outside diameter of the sheath, or 33 times the outside diameter of the insulation material, whichever is larger.

Replace the damaged lead wire with a new one.

- Wire correctly.

Incorrect wiring may cause malfunction or damage to the product.

- Do not perform wiring while the power is on.

Otherwise damage to the internal components may result, causing malfunction.

- Do not route wires and cables together with power or high voltage cables.

Route the wires of the product separately from power or high voltage cables to prevent noise and surge from entering the product.

- Confirm correct insulation of wiring.

Poor insulation (interference with other circuits, poor insulation between terminals etc.) can apply excessive voltage or current to the product causing damage.

- Keep wiring as short as possible to prevent interference from electromagnetic noise and surge voltage.

Do not use a cable longer than 20 m.

Wire the DC(-) line (blue) as close as possible to the power supply.

- When analogue output is used, install a noise filter (line noise filter, ferrite element, etc.) between the switch-mode power supply and the product.

#### \*Operating environment

- Do not use the product in an environment where the product is constantly exposed to water splashes. Otherwise failure or malfunction can result. Take measures such as using a cover.
- Do not use the product in an environment where corrosive gases or fluids can be splashed. Otherwise damage to the internal parts can result, causing malfunction.
- Do not use the product in a place where the product could be splashed by oil or chemicals. If the product is to be used in an environment containing oils or chemicals such as coolant or cleaning solvent, even for a short time, it may be adversely affected (damage, malfunction, or hardening of the lead wires).
- Do not use in an area where surges are generated. When there are machines or equipment that generate large surges near the product (magnetic type lifter, high frequency inductive furnace, motor, etc.), this can result in deterioration and damage of the internal components. Take protective measures to isolate the surge sources, and prevent the lines from coming into close contact.
- Do not use a load which generates surge voltage. When a surge-generating load such as a relay or solenoid is driven directly, use a load with a built-in surge suppressor.
- The product is CE/UKCA marked, but not immune to lightning strikes. Take measures against lightning strikes in the system.
- Mount the product in a location that is not affected by vibration or impact. Otherwise it can cause damage or malfunction.
- Do not use the product in the presence of a magnetic field. Malfunction can result.
- Do not let foreign matter, such as wire debris, get inside the product. Otherwise it can cause damage or malfunction.
- Do not use the product in an environment that is exposed to temperature cycle. Heat cycles other than ordinary changes in temperature can adversely affect the internal components of the product.
- Do not expose the product to direct sunlight. If using in a location directly exposed to sunlight, protect the product from the sunlight. Failure or malfunction may occur.
- Keep within the specified ambient temperature range. The ambient temperature range is 0 to 50 °C. Operation under low temperature may lead to damage or operation failure due to frozen moisture in the fluid or air. Protection against freezing is necessary. Mounting of an air dryer is recommended for elimination of drainage and water. Avoid abrupt temperature changes even within the specified temperature range.
- Do not operate close to a heat source, or in a location exposed to radiant heat. Insufficient air quality may cause operation failure.

#### \*Adjustment and Operation

- Connect the load before turning the power supply on.
- Do not short-circuit the load.  
Although error is displayed when the product load has a short circuit, generated over current may lead to the damage of the product.
- Do not press the setting buttons with a sharp pointed object.  
This may damage the setting buttons.
- Supply power under no flow conditions.
- If using the product to detect very small flow differences, warm up the product for 10 to 15 minutes first.  
There will be a drift on the display/ analogue output of approx 2 to 3% for 10 minutes after the power supply is turned on.
- The product doesn't produce and output signal for 3 seconds after the power is supplied.
- Perform settings suitable for the operating conditions.  
Incorrect setting can cause operation failure.
- During the initial setting and flow setting, the product will switch the measurement output with the condition before setting.  
Check the effect to the equipment before setting.  
Stop the control system for setting, if necessary.
- Do not touch the LCD during operation.  
The display can vary due to static electricity.

#### \*Maintenance

- Perform regular maintenance and inspections.  
There is a risk of unexpected failure of components due to the malfunction of equipment and machinery.
- Before performing maintenance, turn off the power supply, stop the air supply, exhaust the residual compressed air in the piping, and verify the release of air.  
Otherwise, unintended malfunction of system components can result.
- Remove the condensate periodically.  
If condensate enters the secondary side, it can cause operating failure of pneumatic equipment.
- Do not use solvents such as benzene, thinner etc. to clean the product.  
This may damage the surface of the body or erase the markings on the body.  
Use a soft cloth to remove stains.  
For heavy stains, use a damp cloth that has been soaked with diluted neutral detergent and fully squeezed, then wipe up the stains again with a dry cloth.

# Model Indication and How to Order

PF3A 7 □ H - □ □ - □ □ - □ □

Type

Symbol	Type
7	Integrated display type

Rated flow range

Symbol	Content
03	30 to 3000 L/min
06	60 to 6000 L/min
12	120 to 12000 L/min

Large flow type

Thread type

Symbol	Content
Nil	Rc
N	NPT
F	G *1

\*1: ISO1179 compliant.

Port size

Symbol	Size	Rated flow range		
		03	06	12
10	1	●	-	-
14	1 1/2	-	●	-
20	2	-	-	●

Output specification

Symbol	OUT	FUNC *2
L	IO-Link/Switch output (N/P)	-
L3	IO-Link/Switch output (N/P)	Analogue voltage output *3 ⇔ External input *4
L4	IO-Link/Switch output (N/P)	Analogue current output ⇔ External input *4

\*2: Analogue output or external input can be selected by pressing the buttons.

Analogue output is set as the default setting.

Output option symbol "L" is not available because the FUNC terminal is not connected.

\*3: 1 to 5 V or 0 to 10 V can be selected by pressing the buttons.

The default setting is 1 to 5 V.

\*4: Accumulated, peak and bottom values can be reset using the external input.

Calibration certificate

Symbol	Content
Nil	Without calibration certificate
A *9	With calibration certificate

\*9: Certificate in both Japanese and English.

\*: Made to Order.

Unit specification


Symbol	Content
Nil	Units selection function *7
M	SI unit only *8

\*7: Since the unit for Japan is fixed to SI due to new measurement law, this option is for overseas.

\*8: Fixed unit instantaneous flow: L/min, Accumulated: L

Options

Nil	With lead wire with M12 connector (3 m) *5
N	No lead wire
Q	With lead wire with M12-M12 connector (3 m) *6



\*5: Each accessory is not assembled with the product, but shipped together.

\*6: One end has an M12 (female) connector and the other end has an M12 (male) connector.


## Accessories/Part numbers

If an accessory is required, order using the following part number.


Product number	Description	Note
ZS-37-A	Lead wire with M12 connector	Length: 3 m
ZS-49-A	Lead wire with M12 connector	Length: 3 m, M12 (female) - M12 (male)

# Names and Functions of Individual Parts

## Body

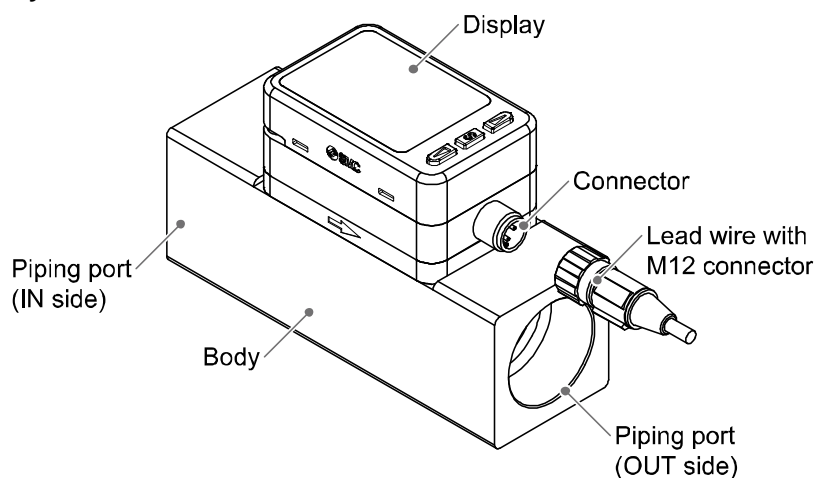


Connector pin numbers  
(on the product)



1	DC(+)
2	FUNC
3	DC(-)
4	OUT (C/Q)



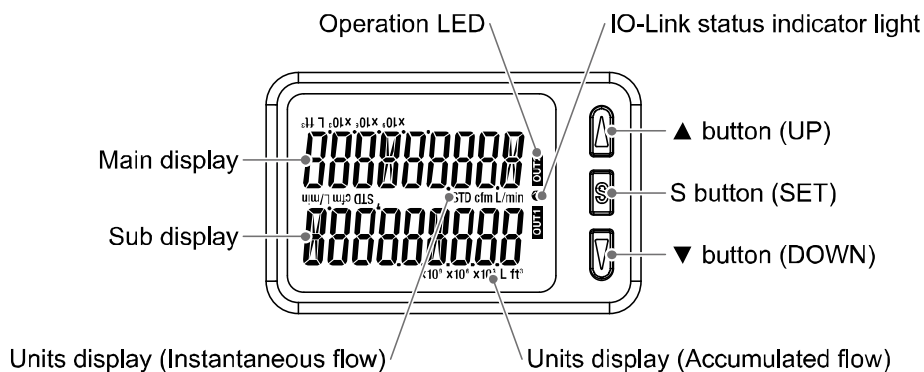


Element	Description
Display	See below
Connector	M12 4-pin connector for electrical connections.
Lead wire with M12 connector	Lead wire for power supply and outputs.
Piping port	For piping connections. Connected to the fluid inlet at IN and to the fluid outlet at OUT.
Body	The body of the product.

## Display



Element	Description
Main display	Displays the instantaneous flow value and error codes. (2 colour display)
Operation LED	Indicates the output status of OUT. When the output is ON: Orange LED is ON. When the accumulated pulse output mode is selected, the output display will turn off.
Sub display	Displays the accumulated flow, set value and peak/bottom value when in measurement mode.
▲ button (UP)	Selects the mode and the display shown on the Sub display or increases the switch point.
S button (SET)	Press this button to change the mode and to set a value.
▼ button (DOWN)	Selects the mode and the display shown on the Sub display or decreases the switch point.
Units display (Instantaneous flow)	Indicates the flow measurement units currently selected.
Units display (Accumulated flow)	Indicates the flow measurement units currently selected.
IO-Link status indicator light	LED is ON when OUT1 is used in IO-Link mode. (LED is OFF in SIO mode)

•IO-Link indicator light operation and display

Communication with master	IO-Link status indicator light	Status			Sub screen display *1	Content
						
Yes		IO-Link mode	Correct	Operate	ModE oPE	Normal communication status (Reading of measurement value)
				Start up	ModE StPt	When communication starts up.
				Preoperate	ModE PrE	
			Abnormal	Version does not match	Er 15 V 10	Version of master and IO-Link does not match *2
No		Abnormal	Communication shut-off	ModE StPt	ModE PrE ModE oPE	Correct communication was not received for <u>1 second or more.</u>
				ModE PrE		
		SIO mode				ModE Sio

LCD display: "O" OFF, "●" Flashing, "●" ON

\*1: "ModE - - -" is displayed when selecting the modes on the sub screen.

\*2: When the product is connected to the IO-Link master with version other than "V1.1", an error is generated.

## ■ Definition and terminology

	Term	Definition
A	Accumulated flow	The total amount of fluid that has passed through the device. If an instantaneous flow of 100 L/min lasts for 5 minutes, the accumulated flow will be $5 \times 100 = 500$ L. If the lower digits exceed the display range, the upper digits and lower digits are displayed alternately. (3-second cycle) When the upper digits are displayed, "10 <sup>3</sup> or 10 <sup>6</sup> or 10 <sup>9</sup> " lights up according to the totalized flowrate.
	Accumulated flow external reset	A function to reset the accumulated value to "0" when an external input signal is applied.
	Accumulated pulse output	A type of output where a pulse is generated every time a predefined accumulated flow passes. It is possible to calculate the total accumulated flow by counting the pulses.
	Accumulated-value hold time	A function to store the cumulative flow value in the product's internal memory at certain time intervals. Reads the memory data when power is supplied. Accumulation of data begins with the value read at the moment power is supplied. The time interval for memorizing can be selected from 2 or 5 minutes.
	Analogue output	Outputs a value proportional to the flow rate. When the analogue output is in the range 1 to 5 V, it will vary between 1 to 5 V according to the rate of flow. The same for analogue output of 0 to 10 V or 4 to 20 mA.
D	Delay time	The setting time from when the flow applied to the flow switch reaches the set value, to when the ON-OFF output actually begins working. Delay time setting can prevent the output from chattering.
	Display range	Displayable range of flow.
	Digital filter	Function to add digital filtering to the fluctuation of flow value. Smooth the fluctuation of displayed value for sharp start up or fall of the flow. When the function is valid, digital filtering is reflected to the ON/OFF of the switch output and analogue output. The response time indicates when the set value is 90% in relation to the step input. Output chattering or flicker in the measurement mode display can be reduced by setting the digital filter. The response time indicates when the set value is 90% in relation to the step input.
F	F.S. (full span/ full scale)	This means "full span" or "full scale", and indicates varied analogue output range at rated value. For example, when analogue output is 1 to 5 V, F.S. = $5 [V] - 1 [V] = 4 [V]$ . (Reference: $1\%F.S. = 4 [V] \times 1\% = 0.04 [V]$ )
H	Hysteresis	The difference between ON and OFF points used to prevent chattering. Hysteresis can be effective in avoiding the effects of pulsation.
	Hysteresis mode	Mode where the switch output will turn ON when the flow is greater than the set value, and will turn OFF when the flow falls below the set value by the amount of hysteresis or more.
I	Instantaneous flow	The flow passing per unit of time. If it is 10 L/min, there is a flow of 10 L passing through the device in 1 minute.
	Internal voltage drop	The voltage drop across the product (and therefore not applied to the load), when the switch output is ON. The voltage drop will vary with load current, and ideally should be 0 V.

	Terminology	Definition
K	Key-lock function	Function that prevents changes to the settings of the flow switch (disables button operation).
N	Normal condition	The flow which is converted into the volume at 0 °C and 101.3 kPa (absolute pressure). <nor> indicates that the product is in normal condition.
O	Operating pressure range	The pressure range in which the product can be used.
	Operating temperature range	Ambient temperature range in which the product can operate.
	Operating humidity range	Humidity range in which the product can operate.
	Operating fluid temperature	Range of fluid temperature that can be measured by the product.
P	Pressure characteristics	Indicates the change in the display value and analogue output when the fluid pressure changes.
	Proof pressure	Pressure limit that if exceeded will result in mechanical and/or electrical damage to the product.
R	Rated flow range	The flow range within which the product will meet all published specifications.
	Repeatability	Reproducibility of the display or analogue output value, when the measured quantity is repeatedly increased and decreased.
S	Set point range	Range in which ON-OFF point (threshold) is adjustable
	Smallest settable increment	The resolution of set and display values. If the minimum setting unit is 2 L/min, the display will change in 2 L/min steps, e.g. 30.....32.....34 L/min.
	Standard condition	The flow which is converted to the volume at 20 °C and 101.3 kPa (absolute pressure). <Std> indicates that the product is standard condition.
	Switch output	Output type that has only 2 conditions, ON or OFF. In the ON condition an indicator LED will show, and any connected load will be powered. In the OFF condition, there will be no indicator LED and no power supplied to the load. An output showing such behavior is called switch output.
T	Temperature characteristics	Indicates the change in the display value and analogue output caused by ambient temperature changes.
U	Units selection function	A function to select display units other than the international unit (SI unit) specified in the new Japanese measurement law. The product is not equipped with this function.
W	Wetted part	A part that comes into physical contact with the fluid.
	Window comparator mode	An operating mode in which the switch output is turned on and off depending on whether the flow is inside or outside the range of two set values




## Mounting and Installation


### Mounting

- Never mount the product in a place that will be used as a mechanical during piping.
  - Attach the piping so that the fluid flows in the direction indicated by the arrow on the body.
  - Never mount the product upside down.
  - The monitor with integrated display can be rotated.
- Rotating the display with excessive force will damage the end stop.

#### ○Flow direction

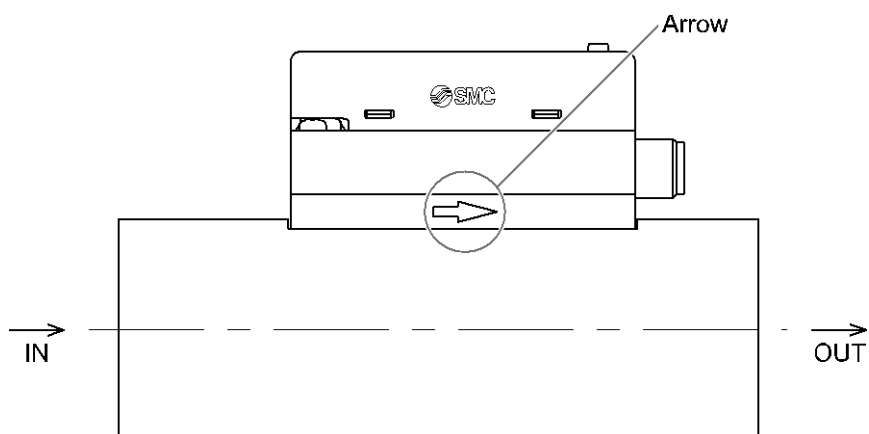

#### ○Rotation of the display

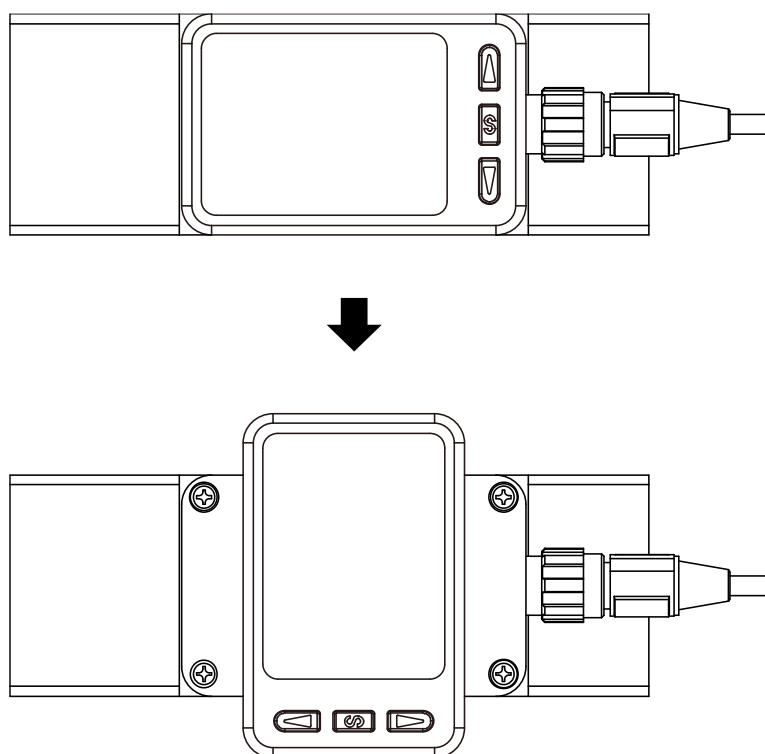


## ■ Installation

### Direct mounting

- Install the product with 4 screws suitable for the product number according to the required tightening torque.


Product number	Suitable screws	Tightening torque	Thread depth
PF3A703H	Equivalent to M4	1.5 N•m $\pm$ 10%	7
PF3A706H	Equivalent to M5	3 N•m $\pm$ 10%	8
PF3A712H	Equivalent to M6	5.2 N•m $\pm$ 10%	9

- Prepared by the user.
- Refer to the dimension drawing (page 97) for the diameter and depth of the mounting screw holes.

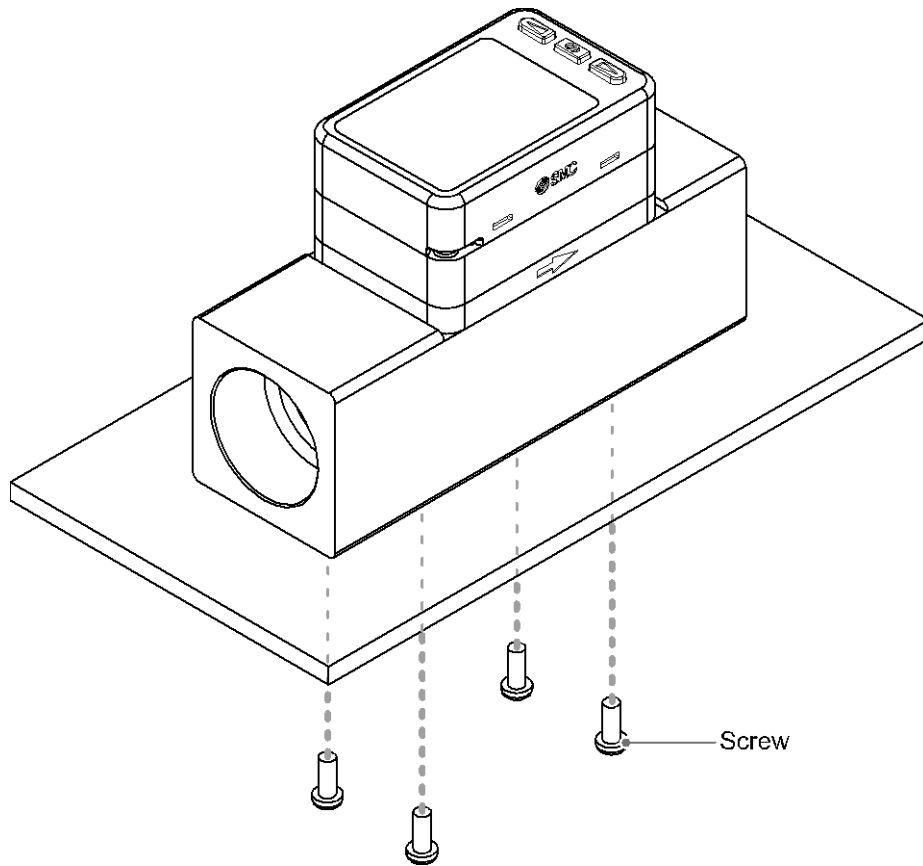


## ■Piping

- Do not connect equipment or piping which may generate a fluctuation in flow or drift at the IN side of the product.  
When installing a regulator at the IN side of the product, make sure that hunting is not generated.
- The piping on the IN side must have a straight section of piping whose length is 8 times the piping diameter or more.  
If a straight section of piping is not installed, the accuracy will vary by approximately 3%F.S.  
Refer to the graph for IN side straight pipe length and accuracy (page 96).
- Avoid sudden changes to the piping size on the IN side of the product.  
The accuracy may vary.
- Do not release the OUT side piping port of the product directly to the atmosphere without connecting piping.  
The accuracy may vary.

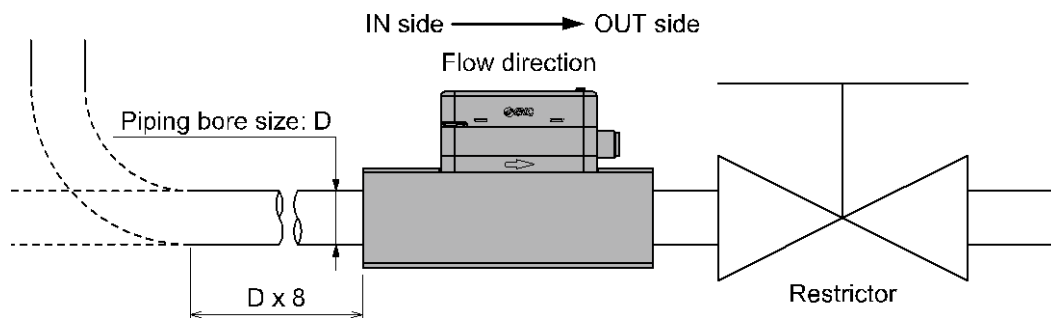

- Use the correct tightening torque for piping. (Refer to the table below for the required torque values.)
- If the tightening torque is exceeded, the product can be damaged.  
If the tightening torque is insufficient, the fittings may become loose.
- Avoid any sealing tape getting inside the fluid passage.
- Ensure there is no leakage after piping.
- When mounting the fitting, a spanner should be used on the body (metal part) of the fitting only.  
Holding other parts of the product with a spanner may damage the product.  
Specifically, make sure that the spanner does not damage the M12 connector.

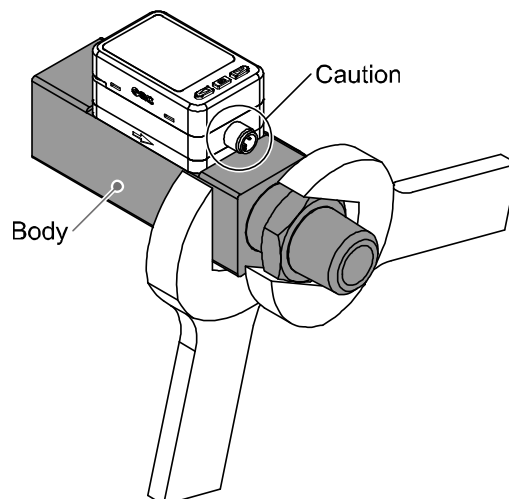

Nominal thread size	Required torque
Rc1, NPT1	36 to 38 N•m
Rc1 1/2, NPT1 1/2, Rc2, NPT2	48 to 50 N•m

Port size	Width across flats of attachment
1	45 mm
1 1/2	60 mm
2	70 mm


## ■Wiring

### Connection


- Connections should only be made with the power supply turned off.
- Use a separate route for the product wiring and any power or high voltage wiring. If wires and cables are routed together with power or high voltage cables, malfunction may result due to noise.
- If a commercially available switching power supply is used, be sure to ground the frame ground (FG) terminal. If the product is connected to the commercially available switching power supply, switching noise will be superimposed and the product specifications will not be satisfied. In that case, insert a noise filter such as a line noise filter/ ferrite between the switching power supplies or change the switching power supply to the series power supply.

### Connecting/Disconnecting

- Align the lead wire connector with the connector key groove, and insert it straight in. Turn the knurled part clockwise. Connection is complete when the knurled part is fully tightened. Check that the connection is not loose.
- To remove the connector, loosen the knurled part and pull the connector straight out.

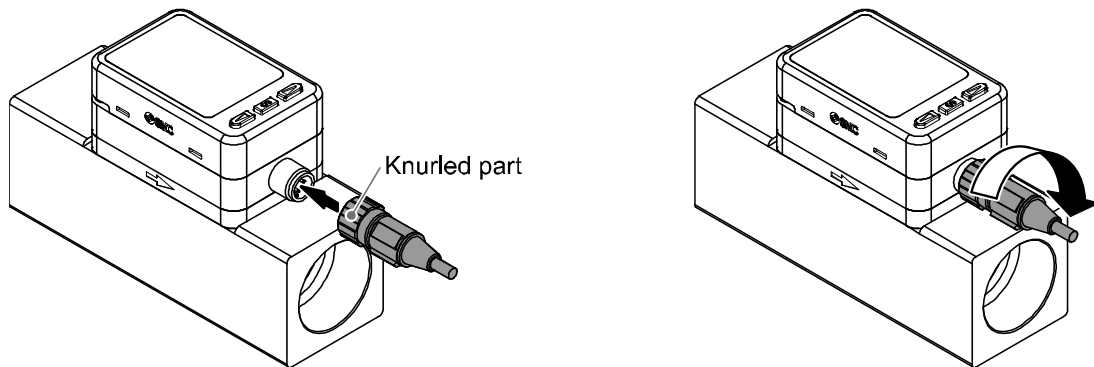

### Connector pin numbers (lead wire)

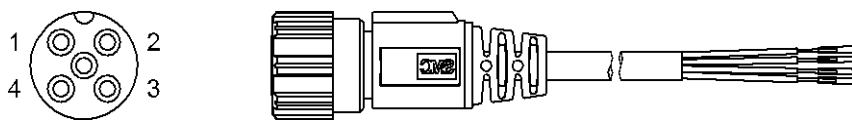

#### •Used as switch output device

Pin number	Wire colour	Description	Function
1	Brown	DC(+)	24 VDC
2	White	FUNC	Analogue output or External input
3	Blue	DC(-)	0 V
4	Black	OUT	Switch output


#### •Used as IO-Link device

Pin number	Wire colour	Description	Function
1	Brown	DC(+)	18 to 30 VDC
2	White	N.C./Other	Not connected/Analogue output or External input
3	Blue	DC(-)	0 V
4	Black	C/Q	Communication data (IO-Link)/Switch output (SIO)

## Internal circuit and wiring examples

NPN output type


PF3A7##H-##-L#-##

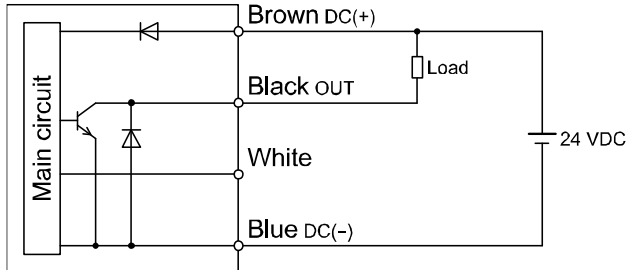

Maximum applied voltage: 28 V  
Maximum load current: 60 mA  
Internal voltage drop 1.5 V max.

PNP output type


PF3A7##H-##-L#-##

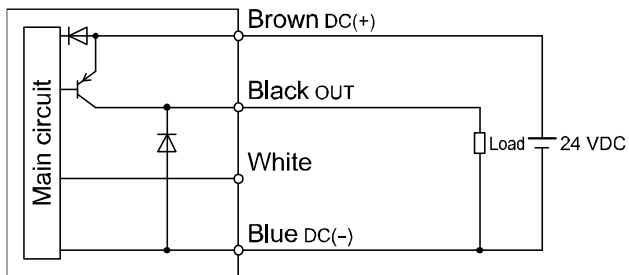

Maximum load current: 60 mA  
Internal voltage drop 1.5 V max.


\*: The output type (NPN or PNP) can be set using [F 0].

**NPN + Analogue output type**  
**PF3A7##H-##-L3/L4#-##**

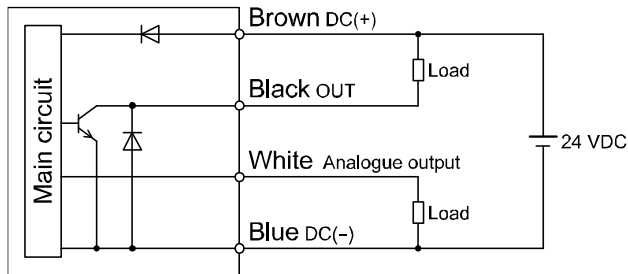


- Maximum applied voltage: 28 V
- Maximum load current: 60 mA
- Internal voltage drop 1.5 V max.
- L3: Analogue output: 1 to 5 V or 0 to 10 V  
 Output impedance: 1 k $\Omega$
- L4: Analogue output: 4 to 20 mA  
 Max. load impedance: 600  $\Omega$   
 Min. load impedance: 50  $\Omega$

**PNP + Analogue output type**  
**PF3A7##H-##-L3/L4#-##**

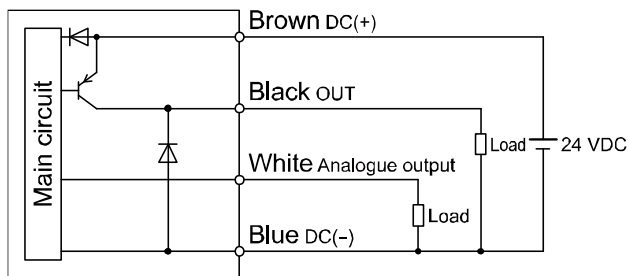


- Maximum load current: 60 mA
- Internal voltage drop 1.5 V max.
- L3: Analogue output: 1 to 5 V or 0 to 10 V  
 Output impedance: 1 k $\Omega$
- L4: Analogue output: 4 to 20 mA  
 Max. load impedance: 600  $\Omega$   
 Min. load impedance: 50  $\Omega$

**NPN + External input type**  
**PF3A7##H-##-L3/L4#-##**

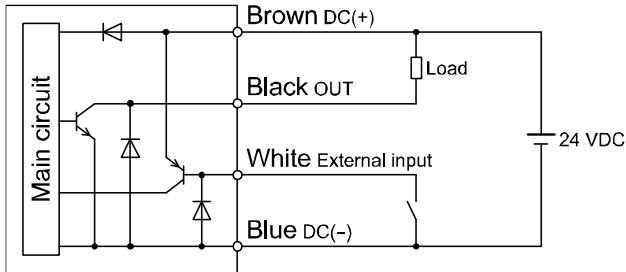

Maximum applied voltage: 28 V  
 Maximum load current: 60 mA  
 Internal voltage drop 1.5 V max.  
 External input: applied voltage of 0.4 V max. (reed or solid state input) for 30 ms or longer


**PNP + External input type**  
**PF3A7##H-##-L3/L4#-##**

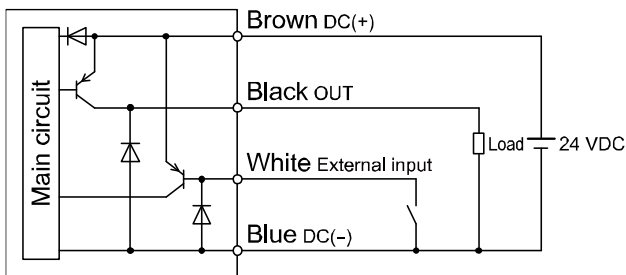


Maximum load current: 60 mA  
 Internal voltage drop 2 V max.  
 External input: Input voltage of 0.4 V max. (reed or solid state input) for 30 ms or longer

### Used as IO-Link device

PF3A7##H-##-L#-##

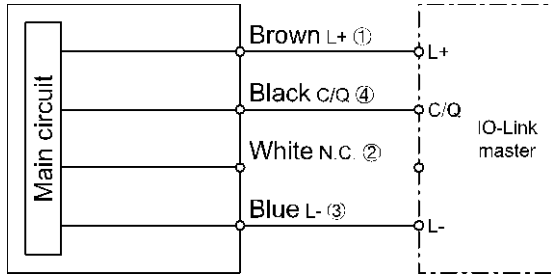

PF3A7##H-##-L3/L4#-##

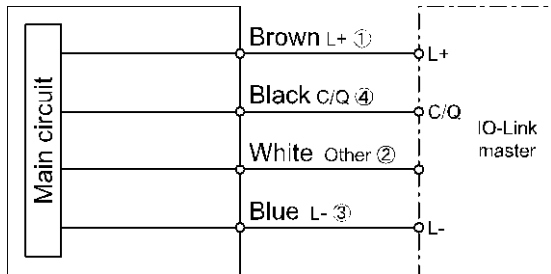



\*: Numbers in the figures show the connector pin layout.



### Example of wiring for accumulated pulse output



NPN output type

PF3A7##H-##-L/L3/L4#-##

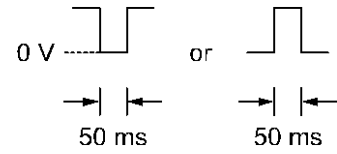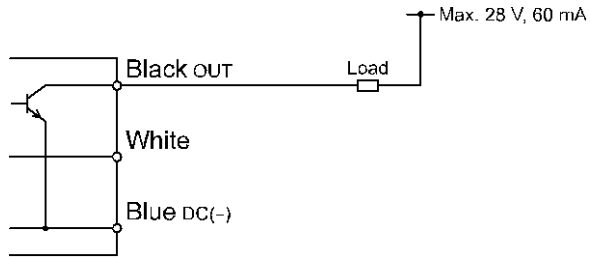

PNP output type

PF3A7##H-##-L/L3/L4#-##

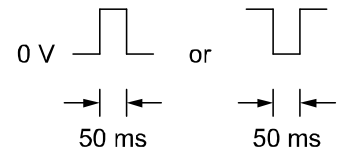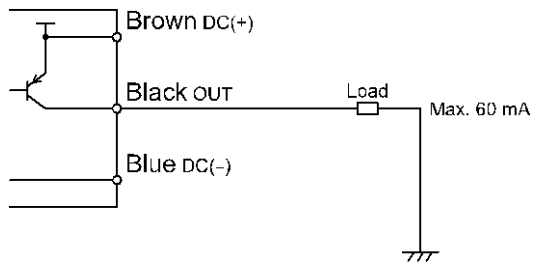

# Outline of Settings [Measurement mode]

Power is supplied.



The output will not operate for 3 seconds after supplying power.  
The identification code of the product is displayed.




### [Measurement mode]

Measurement mode is the condition where the flow is detected and displayed, and the switch function is operating. This is the basic mode; other modes should be selected for set-point changes and other function settings.


**Measurement mode screen**

Current flow rate  
(Main display)

Set value or peak/bottom value  
(Sub display)

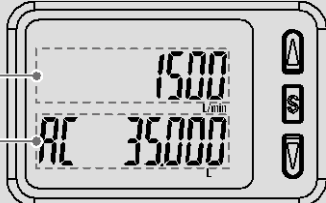

**Sub display**  
In measurement mode, the display of the sub display can be temporarily changed by pressing the ▲ or ▼ buttons.

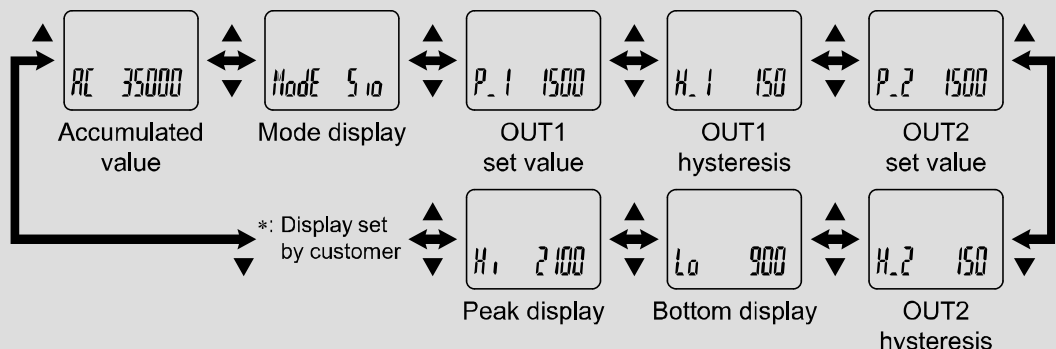

\*: Display set by customer

\*: Arbitrary display mode can be added to the sub display by setting the [F10] sub display. (The default setting does not include arbitrary display.)  
 \*: The example shown is for the 3000 L/min type.  
 \*: OUT2 set value/hysteresis settings are not available. (OUT2 switch output does not exist in the output specification of this model)

Press S button once.

Press the S button for 1 to 3 seconds.

Press the S button for 3 to 5 seconds.



**Change of Set Value**  
(3 step setting mode)  
(Refer to page 27)

**Change of Set Flow and Hysteresis**  
(Simple setting mode)  
(Refer to page 30)

**Change the Function Settings**  
(Function selection mode)  
(Refer to page 32)

**Other Settings**  
(Refer to page 67)

- \*: The outputs will continue to operate during setting.
- \*: If a button operation is not performed for 3 seconds during the setting, the display will flash. (This is to prevent the setting from remaining incomplete if, for instance, an operator were to leave during setting.)
- \*: 3 step setting mode, simple setting mode and function selection mode settings will reflect on each other.

## Change of Set Value [3 step setting mode]

### 3 step setting mode

In the 3 step setting mode, the set value selected in the sub display and the hysteresis can be changed in just 3 steps.

Use this mode if the product is to be used straight away, after changing only the set values.


The current flow value is displayed on the main display

### ■ Default setting

When the flow exceeds the set value [P\_1], the switch will be turned ON.

When the flow falls below the set value by the amount of hysteresis [H\_1] or more, the switch will turn OFF.

If the operation shown below is acceptable, then keep these settings.

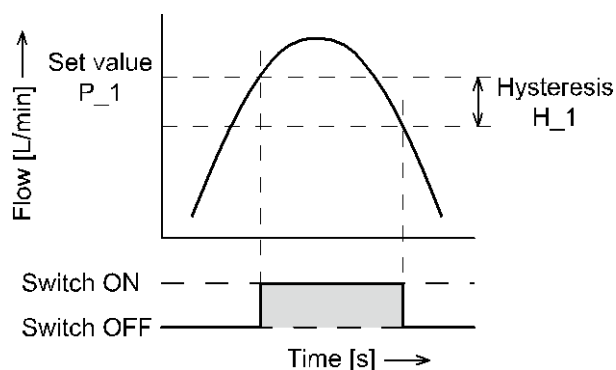

#### ● PF3A703H

Item	Default Settings
[P_1] Set value of OUT	1500 L/min
[H_1] Hysteresis of OUT	150 L/min

#### ● PF3A706H

Item	Default Settings
[P_1] Set value of OUT	3000 L/min
[H_1] Hysteresis of OUT	300 L/min

#### ● PF3A712H

Item	Default Settings
[P_1] Set value of OUT	6000 L/min
[H_1] Hysteresis of OUT	600 L/min

\*: For hysteresis, please refer to [F 1] Setting of OUT1 (page 36).

<Operation>


[Hysteresis mode]

In the 3 step setting mode, the set value (P\_1 or n\_1) and hysteresis (H\_1) can be changed.

Set the items on the sub display (set value and hysteresis) using the ▲ or ▼ buttons.


When changing the set value, follow the operation below. The hysteresis setting can be changed in the same way.

- (1) Press the S button once when the item to be changed is displayed on the sub display.  
The set value on the sub display (right) will start flashing.

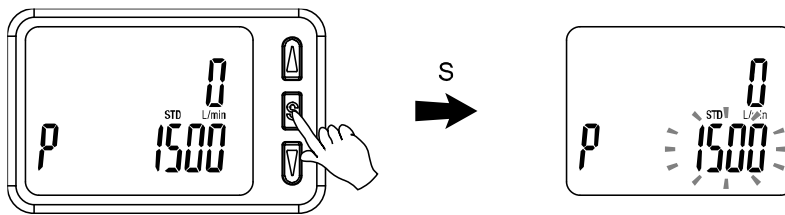


- (2) Press the ▲ or ▼ button to change the set value.  
The ▲ button is to increase and the ▼ button is to decrease the set value.

- Press the ▲ button once to increase the value by one digit, press and hold to continuously increase.

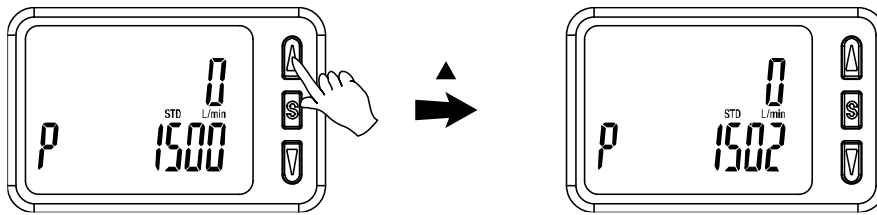

- Press the ▼ button once to reduce the value by one digit, press and hold to continuously reduce.

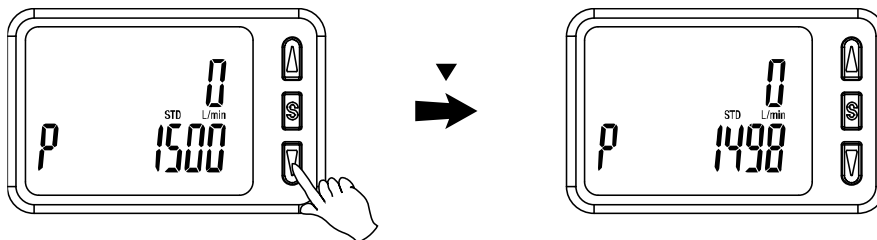

- When ▲ and ▼ buttons are pressed simultaneously for 1 second or more, the set value is displayed as [ - - - ], and the set value will be set to the same as the displayed value automatically (snap shot function) (Refer to page 67). Afterwards, it is possible to adjust the value by pressing ▲ or ▼ button.

- (3) Press the S button to complete the setting.

[Window comparator mode]

The Flow switch turns on within a set flow range (from P1L to P1H). Set P1L, the lower limit of the switch operation, and P1H, the upper limit of the switch operation and WH1 (hysteresis) following the instructions given above.

When reversed output is selected, the main screen displays [n1L] and [n1H].

[Accumulated output mode]

Set each P1 (set value), referring to setting method of page 28.

(When reversed output is selected, the main screen displays [n1]).

Refer to the switch output modes list for the relationship between the set values and operation (page 36).

\*: Setting of the normal/ reverse output switching and hysteresis/window comparator mode switching are performed using the function selection mode [F 1] OUT1 setting.

## Change of Set Flow and Hysteresis [Simple setting mode]

### ■ Simple setting mode



In the simple setting mode, the set value, hysteresis and delay time can be changed while checking the current flow value (main display).

<Operation>

[Hysteresis mode]

- (1) Press the S button for 1 second or longer (but less than 3 seconds) in measurement mode. [SEt] is displayed on the main display.


When the button is released while in the [SEt] display, the current flow value is displayed on the main display, [P\_1] or [n\_1] is displayed on the sub display (left) and the set value is displayed on the sub display (right).

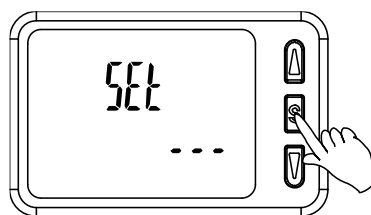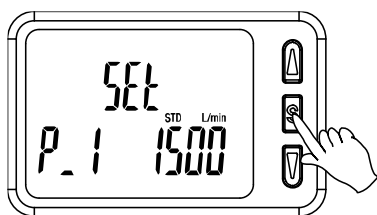

\*: When [F 1] and [F 2] are set to accumulated pulse output, error output or output OFF [---] will be displayed in the sub screen when [SEt] is displayed. It is not possible to move to the Simple setting mode.


- (2) Change the set value using the ▲ or ▼ button, and press the SET button to set the value. Then, the setting moves to hysteresis setting.

(The snap shot function can be used. (Refer to page 67))

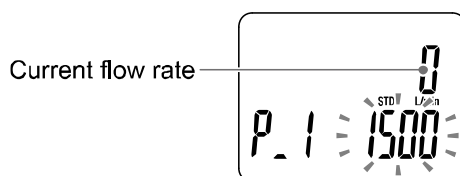

- (3) Change the set value with the ▲ or ▼ button, and press the S button to set the value. Then, the setting moves to the setting of OUT2.

(The snap shot function can be used. (Refer to page 67))



- (4) Like the setting of OUT1, the setting returns to the setting of OUT2 by pressing the S button after setting the set value and hysteresis.

- (5) Press and hold the S button for 2 seconds or longer to complete the simple setting. (If the button is pressed for less than 2 seconds, the setting will be returned to P\_1.)

\*1: Selected items of (1) to (4) become valid after pressing the S button.

\*2: After enabling the setting by pressing the S button, it is possible to return to measurement mode by pressing the S button for 2 seconds or longer.

\*3: When the output mode is set to accumulated pulse, error output or output OFF (refer to page 38), the simple setting mode cannot be used.

(the setting returns to measurement mode by releasing the button when [SEt] is displayed.)

[Window comparator mode]

Set P1L, the lower limit of the switch operation, and P1H, the upper limit of the switch operation, and WH1 (hysteresis) following the instructions given above. (refer to setting method on page 30)  
(When reversed output is selected, the main screen displays n1L and n1H.)

[Accumulated output mode]

Set each P1 (set value), referring to the Setting method on page 30.  
(When reversed output is selected, the main screen displays n1.)

Refer to the switch output modes list for the relationship between the set values and operation (page 36).


## Change the Function Settings [Function selection mode]

### ■ Function selection mode

In this mode, each function setting can be changed separately.

**In measurement mode, press the S button for 3 seconds or longer to display [F 0].**

Press the ▲ or ▼ button to select the function to be changed.

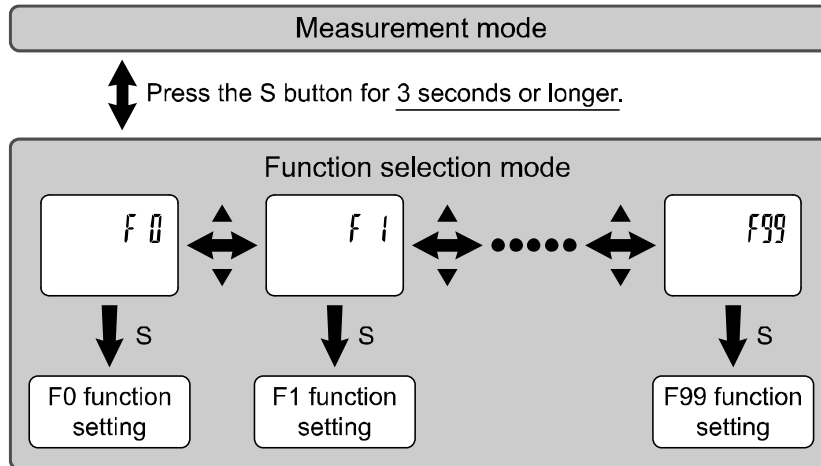

Press the S button for 2 seconds or longer to return to measurement mode.



## ■ Default setting

Function (Main display)		Default Settings (Right sub display)	Applicable Page	
(Main display)	(Left sub display)			
[F 0]	[rEF ] Select display units	[ Std] Standard condition	Page 34	
	[Unit] Units selection function *1	[ L ] L/min		
	[NorP] Select NPN/PNP	[ PnP] PNP output		
[F 1]	[oUt1] Select output mode	[ HYS] Hysteresis mode	Page 36	
	[1ot ] Select switch mode	[ 1_P] Normal output		
	[P_1 ] Select input switch operation	[1500] 1500 L/min (PF3A703H)		Page 36
		[3000] 3000 L/min (PF3A706H)		
		[6000] 6000 L/min (PF3A712H)		
	[H_1 ] Setting of Hysteresis	[ 150] 150 L/min (PF3A703H)		Page 36
		[ 300] 300 L/min (PF3A706H)		
[ 600] 600 L/min (PF3A712H)				
[dt1 ] Delay time setting	[0.00] 0.00 s			
[CoL ] Select display colour	[1SoG] Green when ON Red when OFF (OUT1)			
[F 2]	[oUt2] Select output mode	[ HYS] Hysteresis mode	*2	
	[2ot ] Select switch mode	[ 2_P] Normal output		
	[P_2 ] Select input switch operation	[1500] 1500 L/min (PF3A703H)		*2
		[3000] 3000 L/min (PF3A706H)		
		[6000] 6000 L/min (PF3A712H)		
	[H_2 ] Setting of Hysteresis	[ 150] 150 L/min (PF3A703H)		*2
		[ 300] 300 L/min (PF3A706H)		
[ 600] 600 L/min (PF3A712H)				
[dt2 ] Delay time setting	[0.00] 0.00 s			
[CoL ] Select display colour	[1SoG] Green when ON Red when OFF (OUT1)			
[F 3]	[FiL ] Select digital filter	[ 1.0] 1 second	Page 45	
[F 5]	[FUnc] Select FUNC (switching analogue output/external input) *3	[AoUt] Analogue output	Page 46	
[F10]	[SUB ] Select sub display (Line name setting *4)	[ dEF] Default setting	Page 49	
[F13]	[rEv ] Select Reverse display	[ oFF] Reverse display OFF	Page 51	
[F14]	[CUt ] Select Zero cut-off setting	[ 1.0] 1%F.S. cut	Page 52	
[F30]	[SAvE] Accumulated value hold	[ oFF] Not stored	Page 56	
[F80]	[diSP] Display OFF mode	[ on] Display ON	Page 57	
[F81]	[Pin ] Security code	[ oFF] Not used	Page 58	
[F90]	[ALL ] Setting of all functions	[ oFF] Not used	Page 60	
[F96]	[S_in] Check of input signal	[ - - - ] No input signal	Page 62	
[F98]	[tESt] Setting of output check	[ n] Normal output	Page 63	
[F99]	[ini ] Reset to the default settings	[ oFF] Not used	Page 66	

\*1: Setting is only possible for models with the units selection function.

\*2: [F 2] The OUT2 setting can be set on the product screen, but since there is no OUT2 switch output function as an output specification, it is not possible to output the ON/OFF signal to an external device.

\*3: When the 1 switch output type (output specification symbol is L) is used, [F5] is displayed as [---] and cannot be set. 1 to 5 V or 0 to 10 V can be selected when the analogue voltage output type is used. Analogue output free range function can be selected.

\*4: When Line name is selected, a suitable line name can be input.

## ■ [F 0] Reference condition/Units selection function/Switch output function

### Reference condition

Standard condition or normal condition can be selected.

Standard condition and normal condition are defined as follows:

- Standard condition: Displayed flow rate which is converted to volume at 20 °C, 101.3 kPa (absolute pressure).
- Normal condition: Displayed flow rate which is converted to volume at 0 °C, 101.3 kPa (absolute pressure).

### Units selection function

With the units selection function, the selectable display units are L/min or cfm (ft<sup>3</sup>/min).

This setting is only available for models with the units selection function.

\*: This function is not displayed for models without unit selection function.

\*: For the product without the unit selection function, [L] is shown in the sub display on the left.

### Switch output type

The switch output function can be selected (NPN or PNP output).



<Operation>

Display [F\_0] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to the reference condition.

#### Reference condition



Press the ▲ or ▼ button to select the reference condition.

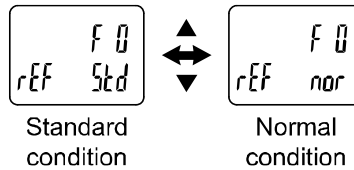

Press the S button to set. ↓ Move on to the units selection function.

#### Units selection function



Press the ▲ or ▼ button to select the display unit.

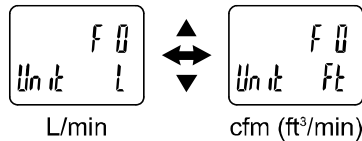

Press the S button to set. ↓ Move on to the switch output function.

#### Switch output function

Press the ▲ or ▼ button to select the switch output function.

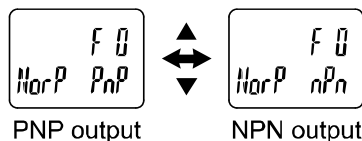

Press the S button to set. ↓ Return to function selection mode.

[F 0] Reference condition/Units selection function/Switch output function completed

Flow specification when [Ft] is selected by the units selection function

Models		PF3A703H	PF3A706H	PF3A712H	
Flow rate	Rated flow range	1.1 to 105.9 cfm	2.2 to 211.8 cfm	4.5 to 424 cfm	
	Setting flow range	Instantaneous flow	1.1 to 111.2 cfm	2.2 to 222.4 cfm	4.5 to 445.0 cfm
		Accumulated flow	0 to 999,999,999,999 ft <sup>3</sup>	0 to 999,999,999,990 ft <sup>3</sup>	
	Setting min. unit	Instantaneous flow	0.1 cfm	0.2 cfm	0.5 cfm
		Accumulated flow	1 ft <sup>3</sup>	10 ft <sup>3</sup>	
Accumulated pulse conversion	1, 10 ft <sup>3</sup>		10, 100 ft <sup>3</sup>		
Display	Display controllable range	Instantaneous flow	0 to 111.2 cfm	0 to 222.4 cfm	0 to 445.0 cfm
		Accumulated flow	0 to 999,999,999,999 ft <sup>3</sup>	0 to 999,999,999,990 ft <sup>3</sup>	
	Display min. unit	Instantaneous flow	0.1 cfm	0.2 cfm	0.5 cfm
		Accumulated flow	1 ft <sup>3</sup>	10 ft <sup>3</sup>	

\*: Flow rate in the specification is the value at standard condition.

## ■ [F 1] Setting of OUT1

Set the output mode of OUT1.

### ● Switch output modes

Select the output mode required from the table below.


	Normal output	Reversed output
Hysteresis mode		
Window comparator mode		
Accumulated output mode (Increment)	<ul style="list-style-type: none"> <li>Count up from "0".</li> <li>Turn ON when the set value is reached.</li> <li>Return to "0" by reset.</li> </ul>	<ul style="list-style-type: none"> <li>Count up from "0".</li> <li>Turn OFF when the set value is reached.</li> <li>Return to "0" by reset.</li> </ul>
Accumulated output mode (Decrement)	<ul style="list-style-type: none"> <li>Count down from set value.</li> <li>Turn ON when the "0" is reached.</li> <li>Return to set value by reset.</li> </ul>	<ul style="list-style-type: none"> <li>Count down from set value.</li> <li>Turn OFF when the "0" is reached.</li> <li>Return to set value by reset.</li> </ul>
Accumulated pulse output mode		
Output off mode		

\*: The operation may become unstable if hysteresis mode or window comparator mode are used during fluctuating flow conditions. In this case, maintain an interval between the set values and start using after confirming stable operation.

● Flow setting chart

Refer to the list of switch output modes for the setting procedure.

Mark the procedure path with a pen or a marker.

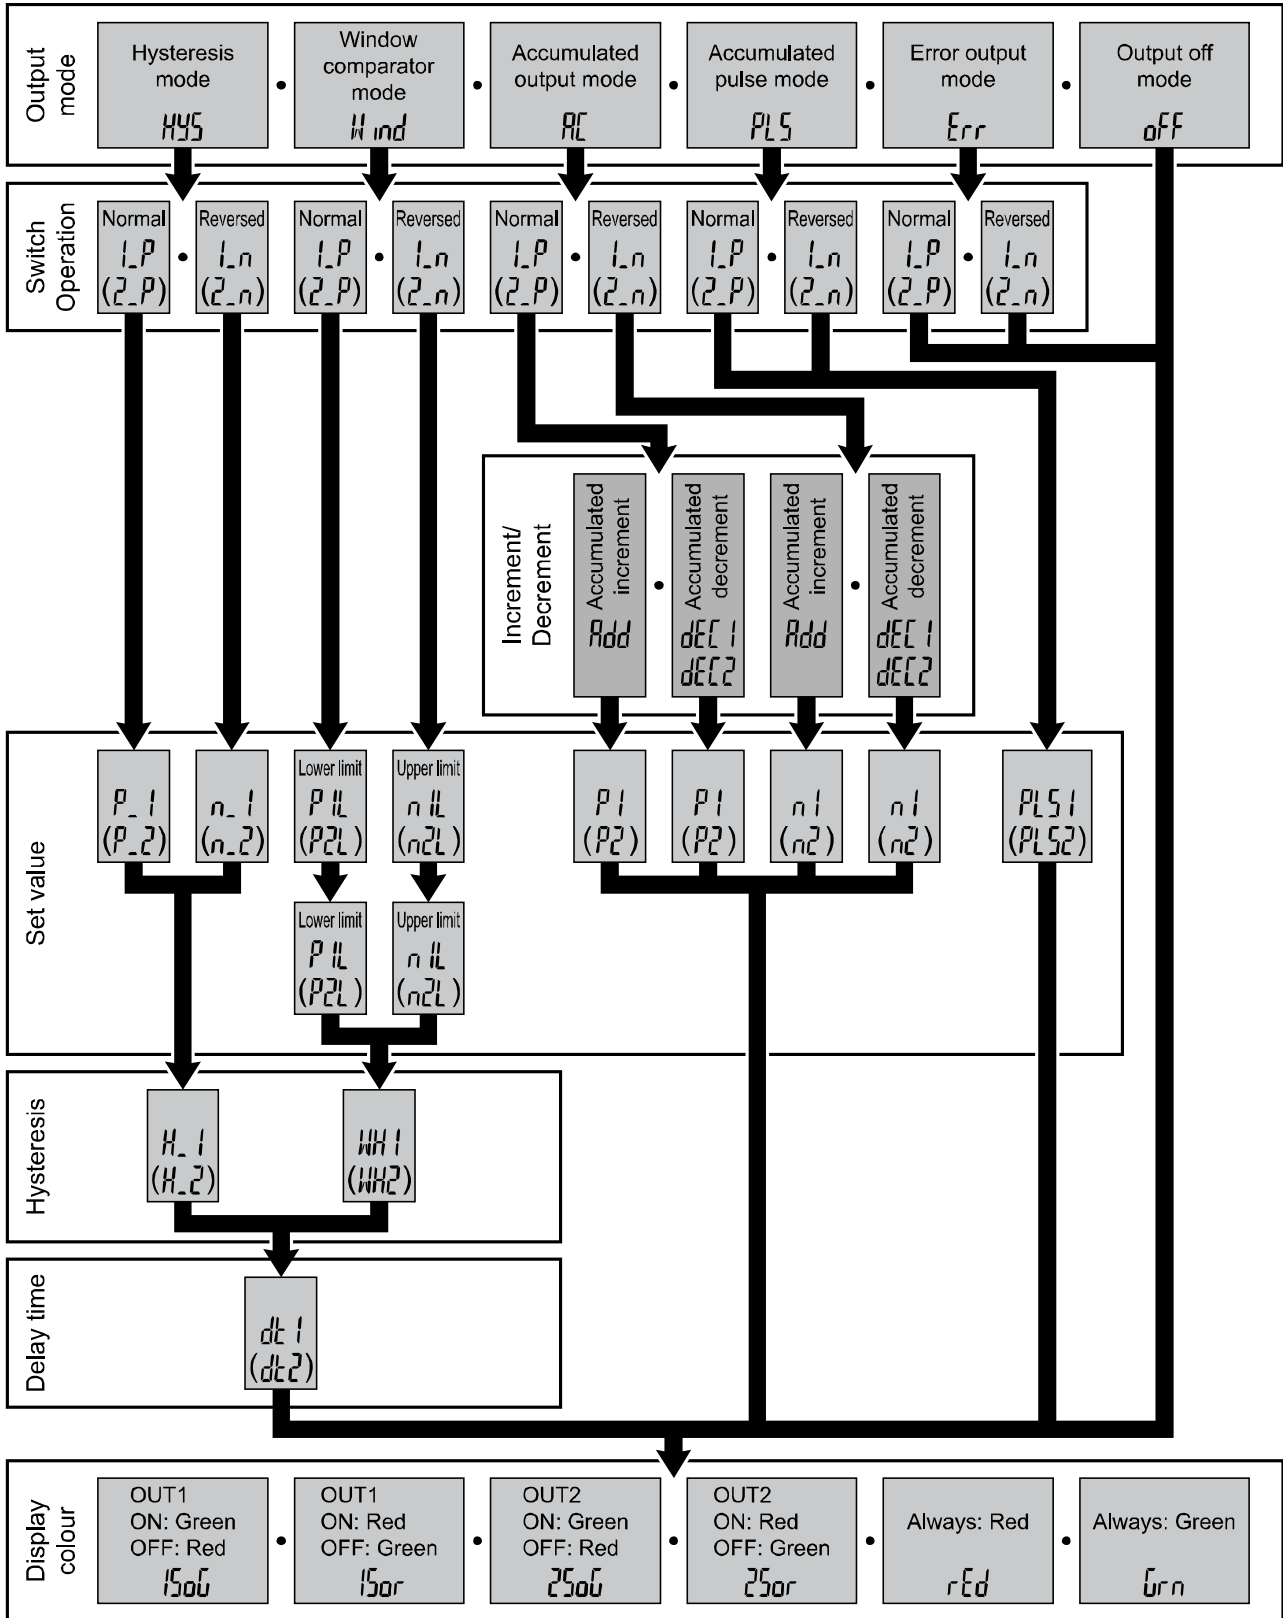

Enter the items you selected, following the procedure below.

Follow the setting flow chart.


<Operation>

Display [F\_1] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to select output mode.

### Select output mode



Press the ▲ or ▼ button to select the output mode.

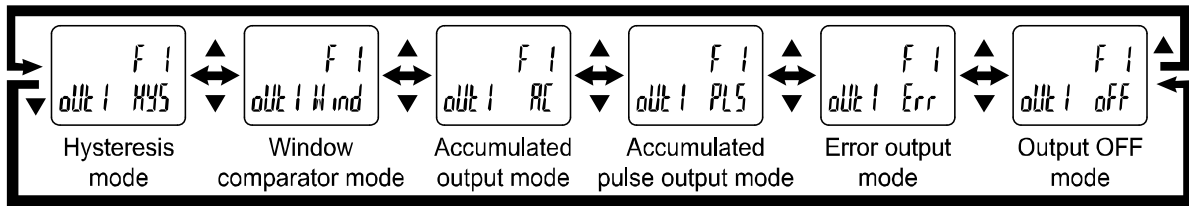

Press the S button to set. ↓ Move on to select normal output/reversed output.

### Select Normal output/ Reversed output

Press the ▲ or ▼ button to select Normal output/ Reversed output.



Normal output      Reversed output

\*: By switching to reversed output, the display colour will change in relation to the setting.

Press the S button to set. ↓ Move on to settings.

Hysteresis mode is selected: Refer to page [40](#)  
Window comparator mode is selected: Refer to page [41](#)  
Accumulated output mode is selected: Refer to page [42](#)  
Accumulated pulse output mode is selected: Refer to page [44](#)

↓ Move on to select display colour.



[oFF] Output off is selected  
Press the S button to move on to select display colour.

- \*: When the output off mode is selected, the output operation indicator LED will turn off.
- \*: oFF is displayed as the set value in the sub display of the measurement mode.



### Select display colour

Press the ▲ or ▼ button to select the display colour.

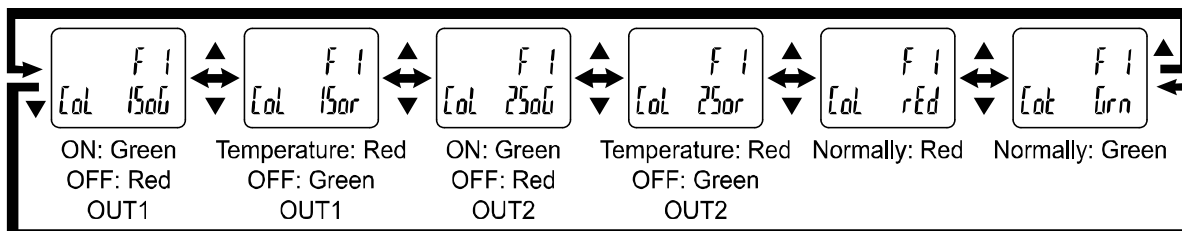

Press the S button to set. ↓ Return to function selection mode.

[F 1] Setting of OUT1 completed

\*: Selected item becomes valid after pressing S button.

\*: After enabling the setting by pressing S button, it is possible to return to the measurement mode by keeping pressing S button.

a. When hysteresis mode is selected

**Input of set value**

Set the flow based on the setting method on page 36.  
The snap shot function can be used. (Refer to page 67)



Press the S button to set. ↓ Move on to setting of hysteresis.

**Setting of Hysteresis**

Set the flow based on the setting method on page 36.  
The snap shot function can be used. (Refer to page 67)



Press the S button to set. ↓ Move on to setting of delay time.

**Setting of delay time**

Set delay time.



Press the S button to set. ↓ Move on to select display colour.

Select display colour  
(Refer to select display colour of page 39.)

\*: Example for 3000 L/min type the above

\*: The set value and hysteresis settings limit each other.



b. When window comparator output mode is selected

**Input of set value (Lower limit value)**

Set the flow based on the setting method on page 36.  
The snap shot function can be used. (Refer to page 67)



Press the S button to set. ↓ Move on to input of set value (upper limit value).

**Input of set value (Upper limit value)**

Set the flow based on the setting method on page 36.  
The snap shot function can be used. (Refer to page 67)



Press the S button to set. ↓ Move on to setting of hysteresis.

**Setting of Hysteresis**

Set the flow based on the setting method on page 36.



Press the S button to set. ↓ Move on to setting of delay time.

**Setting of delay time**

Set delay time.



Press the S button to set. ↓ Move on to select display colour.

Select display colour  
(Refer to select display colour of page 39.)


\*: Example for 3000 L/min type the above

\*: The set value and hysteresis settings limit each other.

c. When Accumulated output mode is selected

**Select accumulated output increment (addition)/  
decrement (subtraction)**

Press the ▲ or ▼ button to select the accumulated  
increment/decrement.

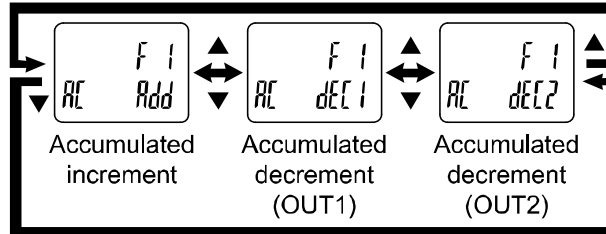

Press the S button to set. ↓ Move on to input the set value.

**Input of set value**

Set the flow based on the setting method on page 36.



Press the S button to set. ↓ Move on to select display colour.

Select display colour  
(Refer to select display colour of page 39.)

●Setting range of the accumulated flow output

The accumulated output setting range is displayed by the set value of the 4 digits and the units.

Set the value by key operation in the sub display. The upper 4 digits of the value is displayed by shifting of the digit. Refer to the table below for details of the set value and display.

Accumulated minimum unit: 10 L

Key operation	Set accumulated value	Sub screen display	
		Value	Units indication
△ ↓	0	0	L
	to	to	
	1,000	1.000	x10 <sup>3</sup> L
	to	to	
	9,990	9.990	x10 <sup>3</sup> L
	to	to	
	99,990	99.99	x10 <sup>3</sup> L
	to	to	
	1,000,000	1.000	x10 <sup>6</sup> L
	to	to	
• • •	10,000,000	10.00	x10 <sup>6</sup> L
	to	to	
	99,990,000	99.99	x10 <sup>6</sup> L
	to	to	
	999,900,000	999.9	x10 <sup>6</sup> L
	to	to	
	1,000,000,000	1.000	x10 <sup>9</sup> L
	to	to	
	10,000,000,000	10.00	x10 <sup>9</sup> L
	to	to	
↑ ▽	99,990,000,000	99.99	x10 <sup>9</sup> L
	to	to	
	999,900,000,000	999.9	x10 <sup>9</sup> L

Accumulated minimum unit: 100 L

Key operation	Set accumulated value	Sub screen display	
		Value	Units indication
△ ↓	0	0	L
	to	to	
	1,000	1.000	x10 <sup>3</sup> L
	to	to	
	9,900	9.900	x10 <sup>3</sup> L
	to	to	
	99,900	99.90	x10 <sup>3</sup> L
	to	to	
	1,000,000	1.000	x10 <sup>6</sup> L
	to	to	
• • •	10,000,000	10.00	x10 <sup>6</sup> L
	to	to	
	99,990,000	99.99	x10 <sup>6</sup> L
	to	to	
	999,900.000	999.9	x10 <sup>6</sup> L
	to	to	
	1,000,000,000	1.000	x10 <sup>9</sup> L
	to	to	
	10,000,000,000	10.00	x10 <sup>9</sup> L
	to	to	
↑ ▽	99,990,000,000	99.99	x10 <sup>9</sup> L
	to	to	
	999,900,000,000	999.9	x10 <sup>9</sup> L


\*: The units on the right side of the sub screen will flash.

\*: When the units are set to [ Ft ] with [ F 0 ], the units display "L" will be turned ON.

d. When accumulated pulse output mode is selected

**Select accumulated pulse output**

Press the ▲ or ▼ button to select accumulated pulse output.

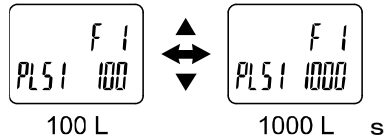

Press the S button to set. ↓ Move on to select display colour.

Select display colour  
(Refer to select display colour of page 39.)

- \*: When the accumulated pulse output mode is selected, the output operation indicator LED will turn off.
- \*: When flow rate is less than the rated flow range, the accumulated pulse output will not operate.
- \*: When the flow exceeds the maximum display range, the accumulated pulse output will be equivalent to the maximum display value.

## ■[F 3] Select digital filter

The digital filter of the switch output and analogue output can be selected.  
Output chattering can be prevented by setting the digital filter.



<Operation>

Display [F\_3] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to select digital filter.

### Select digital filter

Press the ▲ or ▼ button to select the digital filter.

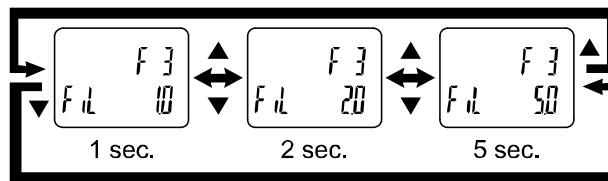

Press the S button to set. ↓ Return to function selection mode.

[F3] Digital filter setting completed

\*: Each set value is a guideline for 90% response time.

\*: Both the switch output and flow display are affected.

## ■[F 5] FUNC setting

Analogue output or external input can be selected.

- When analogue output is selected

1 to 5 V or 0 to 10 V can be selected when the analogue voltage output type is used.

The flow value corresponding to 5 V (10 V) or 20 mA can be selected with the analogue output free range function.

- When external input is selected

The Accumulated Flow, Peak Value and Bottom Value can be reset remotely.

- Accumulated Flow External Reset: A function to reset the Accumulated Flow value when an external input signal is applied.

In accumulated increment mode, the accumulated flow value will reset to zero, and then increase from zero.

In accumulated decrement mode, the accumulated flow value will reset to a set value, and then decrease from the set value.

\*: When the Accumulated Value is memorized, every time the Accumulated Value External Reset is activated, the memory will be accessed. Take into consideration the maximum number of times the memory can be accessed is 1.5 million times. The total of External Input times and Accumulated Value Memorizing time interval should not exceed 1.5 million times.

- Peak/ Bottom value reset: A function to clear the peak value or bottom value when an external input signal is applied.


<Operation>

Display [F\_5] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to select FUNC.

**Select FUNC**

Press the ▲ or ▼ button to select the FUNC setting.

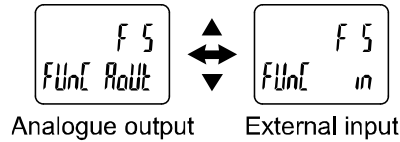

[AoUt] Analogue output is selected

When the model includes the analogue voltage output type is used.

Press the S button to select analogue voltage output.

When the model includes the analogue current output type is used.

Press the S button, the analogue current output range will be displayed.

\*: Cannot be changed.

[in] External input is selected


Press the S button to select the external input.

**Analogue output setting**


Press the ▲ or ▼ button to select analogue output setting.



Voltage output type

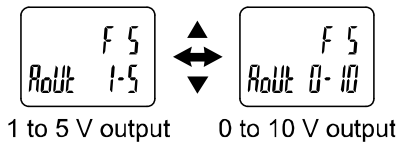

Current output type





Press the S button to set.

Move on to the analogue output free range function mode.

**Select external input**



Press the ▲ or ▼ button to select external input setting.

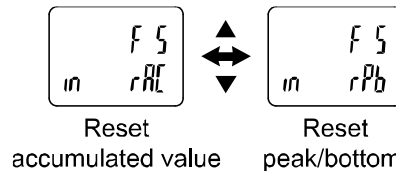


Press S button to return to function selection mode.

**Select analogue output free range function**

Press the ▲ or ▼ button to select analogue output free setting function.



Free range function OFF



Free range function ON

[on] Free range function ON is selected  
Press the S button to set value input.


[oFF] Free range function OFF is selected.  
Press the S button to return to function selection mode.

**Input of set value**

Use the ▲ or ▼ buttons to set the flow value that will output 5 V (10 V) or 20 mA.



The entered flow value can be in the range: 10% of the max. rated flow, to the upper display limit.

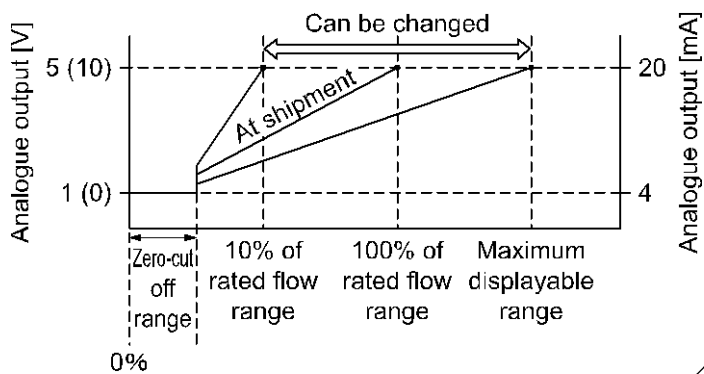

Press the S button to set. Return to function selection mode.

[F 5] FUNC setting completed



## ■[F10] Sub display setting (Line name setting)

Add the displayed item to the sub display.

- Default setting: Accumulated value, OUT setting, peak value, and bottom value are displayed.
  - Addition of line name: Line name can be added to the default display.  
A line name can be input. (up to 9 characters and/or numbers).
  - Addition of display OFF: Display off can be added to the default display.
- \*: Addition of line name and display off cannot be set at the same time.



<Operation>

Display [F10] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ▼ Move on to sub display setting.

### Sub display setting

Press the ▲ or ▼ button to select the display style for the sub-display.

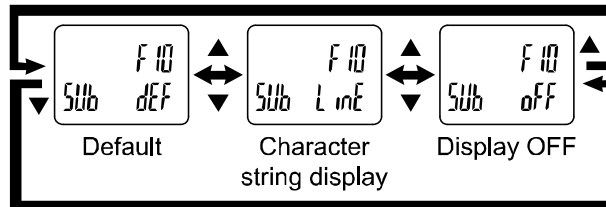

▼ [LinE] Addition of line name is added  
Press the S button to move on to input of line name.

▼ [dEF] Default setting is selected  
[oFF] Display off is selected  
Press S button to return to function selection mode.


### Input of line name

All the values flash.  
Press S button to return to function selection mode.  
Press the ▲ or ▼ button to change the characters.



The order of displayed characters is A → b → ... → Y → Z → 0 → ... → 9 → symbol → Space. (The allowable characters is dependent on the display digit.)

Press the S button to move to the digit on the right.

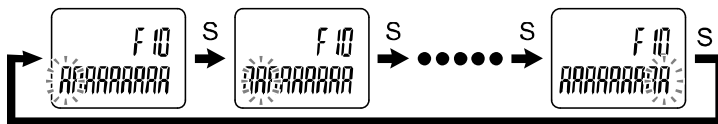

Press the S button for 1 second or longer to flash characters.

Press the S button to set. ▼ Return to function selection mode.

[F10] Sub display setting completed

●Characters for entering the line name

Maximum number of digits for entering the line name is 9 digits. However, the number of allowable characters is dependent on the number of the digit.

Characters									
Number of digits	1	2	3	4	5	6	7	8	9
seg	11 seg	7 seg	7 seg	7 seg	7 seg	11 seg	7 seg	7 seg	7 seg

\*: 1st. and 6th. digits are displayed in 11 seg. Others are displayed in 7 seg.

Character for 7 segment display

Character changes as below by pressing the ▲ or ▼ button.

→ ▲ →

A - b - c - d - E - F - G - H - I - J - K

- L - ñ - n - o - P - r - S - t - U - u - v

- y - 0 - 1 - 2 - 3 - 4 - 5 - 6 - 7 - 8 - 9

- . - - - - ' - SPACE - Return to A

← ▼ ←

Character for 11 segment display

Character changes as below by pressing the ▲ or ▼ button.

→ ▲ →

A - b - c - d - E - F - G - H - I - J - K - L - M

- N - o - P - Q - r - S - t - U - u - V - W - X - Y - Z

- 0 - 1 - 2 - 3 - 4 - 5 - 6 - 7 - 8 - 9 - . - - - - '

- / - # - \$ - % - & - ' - n - H - P - Y - u - SPACE - Return to A

← ▼ ←

## ■[F13] Setting for reverse display mode

This function is used to rotate display upside down.

It is used to correct the display when it is upside down due to installation of the product.

When the reverse display function is ON, the function of the ▲ and ▼ buttons are reversed.



<Operation>

Display [F13] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to select reverse display.

### Select reverse display

Press the ▲ or ▼ button to select reverse display.

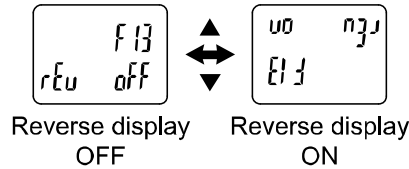

Press the S button to set. ↓ Return to function selection mode.

[F13] Setting for reverse display mode completed

\*: When reverse display function is ON, the characters of the sub display appear upside down.

## ■[F14] Zero cut-off setting

When the flow is close to 0 L/min., the product rounds the value and zero will be displayed.

Flow value will be displayed even when the flow rate is 0 L/min. when the pressure is high or depending on the installation orientation.

Zero cut-off function makes the display zero.

The range to display zero can be changed.


< Operation >

Display [F14] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Select Zero cut-off setting.

### Select zero cut-off setting


Press the ▲ or ▼ button to select the value of Zero cut-off.

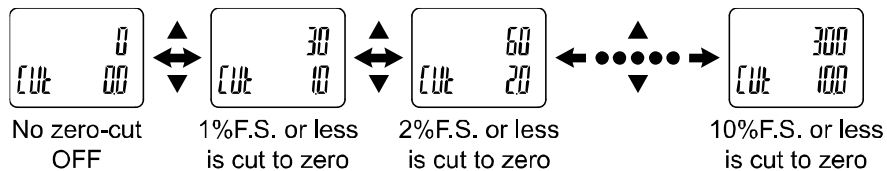

\*: The display above is an example of when [L] is selected for the PF3A703H (3000 L/min type) with the unit switching function.

\*: If the flow rate does not reach the above value, the display will be zero.

Example: PF3A703H (3000 L/min type)

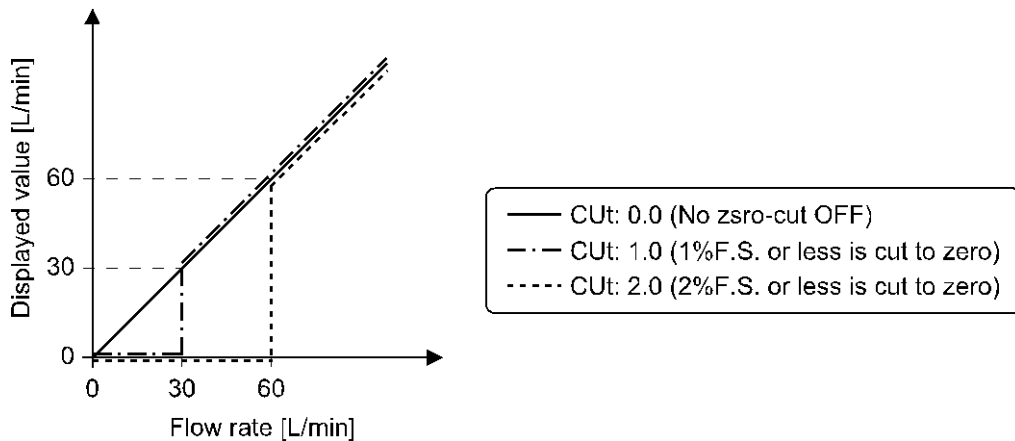

Press the S button to set. ↓ Return to function selection mode.

[F14] Zero cut-off setting completed

●Settable flow range when [L] is selected by the units selection function

Zero cut-off set value	Zero cut-off range	Displayable flow range		
		PF3A703H	PF3A706H	PF3A712H
0.0 *	0%F.S.	0 to 3150 L/min	0 to 6300 L/min	0 to 12600 L/min
1.0	0 to 1%F.S.	30 to 3150 L/min (Displays 0 when the value is below 30 L/min)	60 to 6300 L/min (Displays 0 when the value is below 60 L/min)	120 to 12600 L/min (Displays 0 when the value is below 120 L/min)
2.0	0 to 2%F.S.	60 to 3150 L/min (Displays 0 when the value is below 60 L/min)	120 to 6300 L/min (Displays 0 when the value is below 120 L/min)	240 to 12600 L/min (Displays 0 when the value is below 240 L/min)
3.0	0 to 3%F.S.	90 to 3150 L/min (Displays 0 when the value is below 90 L/min)	180 to 6300 L/min (Displays 0 when the value is below 180 L/min)	360 to 12600 L/min (Displays 0 when the value is below 360 L/min)
4.0	0 to 4%F.S.	120 to 3150 L/min (Displays 0 when the value is below 120 L/min)	240 to 6300 L/min (Displays 0 when the value is below 240 L/min)	480 to 12600 L/min (Displays 0 when the value is below 480 L/min)
5.0	0 to 5%F.S.	150 to 3150 L/min (Displays 0 when the value is below 150 L/min)	300 to 6300 L/min (Displays 0 when the value is below 300 L/min)	600 to 12600 L/min (Displays 0 when the value is below 600 L/min)
6.0	0 to 6%F.S.	180 to 3150 L/min (Displays 0 when the value is below 180 L/min)	360 to 6300 L/min (Displays 0 when the value is below 360 L/min)	720 to 12600 L/min (Displays 0 when the value is below 720 L/min)
7.0	0 to 7%F.S.	210 to 3150 L/min (Displays 0 when the value is below 210 L/min)	420 to 6300 L/min (Displays 0 when the value is below 420 L/min)	840 to 12600 L/min (Displays 0 when the value is below 840 L/min)
8.0	0 to 8%F.S.	240 to 3150 L/min (Displays 0 when the value is below 240 L/min)	480 to 6300 L/min (Displays 0 when the value is below 480 L/min)	960 to 12600 L/min (Displays 0 when the value is below 960 L/min)
9.0	0 to 9%F.S.	270 to 3150 L/min (Displays 0 when the value is below 270 L/min)	540 to 6300 L/min (Displays 0 when the value is below 540 L/min)	1080 to 12600 L/min (Displays 0 when the value is below 1080 L/min)
10.0	0 to 10%F.S.	300 to 3150 L/min (Displays 0 when the value is below 300 L/min)	600 to 6300 L/min (Displays 0 when the value is below 600 L/min)	1200 to 12600 L/min (Displays 0 when the value is below 1200 L/min)

\*: The zero-cut range of the accumulated value and accumulated pulse value should be 1% F.S. or more. However, please note that if the zero-cut set value is 0.0, any value below 1% F.S. will be cut.

\*: When setting the flow value and hysteresis within zero cut-off settable range, the on-off point varies depending on the settable range. For details, please refer to switch output (OUT) value and hysteresis are set within Zero cut-off range (page 55).

●Flow specification when [Ft] is selected by the units selection function.

Zero cut-off set value	Zero cut-off range	Set point range		
		PF3A703H	PF3A706H	PF3A712H
0.0 *	0%F.S.	0 to 111.2 cfm	0 to 222.4 cfm	0 to 445.0 cfm
1.0	0 to 1%F.S.	1.1 to 111.2 cfm (Displays 0 when the value is below 1.1 cfm)	2.2 to 222.4 cfm (Displays 0 when the value is below 2.2 cfm)	4.5 to 445.0 cfm (Displays 0 when the value is below 4.5 cfm)
2.0	0 to 2%F.S.	2.2 to 111.2 cfm (Displays 0 when the value is below 2.2 cfm)	4.4 to 222.4 cfm (Displays 0 when the value is below 4.4 cfm)	8.5 to 445.0 cfm (Displays 0 when the value is below 8.5 cfm)
3.0	0 to 3%F.S.	3.2 to 111.2 cfm (Displays 0 when the value is below 3.2 cfm)	6.4 to 222.4 cfm (Displays 0 when the value is below 6.4 cfm)	13.0 to 445.0 cfm (Displays 0 when the value is below 13.0 cfm)
4.0	0 to 4%F.S.	4.3 to 111.2 cfm (Displays 0 when the value is below 4.3 cfm)	8.6 to 222.4 cfm (Displays 0 when the value is below 8.6 cfm)	17.0 to 445.0 cfm (Displays 0 when the value is below 17.0 cfm)
5.0	0 to 5%F.S.	5.3 to 111.2 cfm (Displays 0 when the value is below 5.3 cfm)	10.6 to 222.4 cfm (Displays 0 when the value is below 10.6 cfm)	21.5 to 445.0 cfm (Displays 0 when the value is below 21.5 cfm)
6.0	0 to 6%F.S.	6.4 to 111.2 cfm (Displays 0 when the value is below 6.4 cfm)	12.8 to 222.4 cfm (Displays 0 when the value is below 12.8 cfm)	25.5 to 445.0 cfm (Displays 0 when the value is below 25.5 cfm)
7.0	0 to 7%F.S.	7.5 to 111.2 cfm (Displays 0 when the value is below 7.5 cfm)	15.0 to 222.4 cfm (Displays 0 when the value is below 15.0 cfm)	30.0 to 445.0 cfm (Displays 0 when the value is below 30.0 cfm)
8.0	0 to 8%F.S.	8.5 to 111.2 cfm (Displays 0 when the value is below 8.5 cfm)	17.0 to 222.4 cfm (Displays 0 when the value is below 17.0 cfm)	34.0 to 445.0 cfm (Displays 0 when the value is below 34.0 cfm)
9.0	0 to 9%F.S.	9.6 to 111.2 cfm (Displays 0 when the value is below 9.6 cfm)	19.2 to 222.4 cfm (Displays 0 when the value is below 19.2 cfm)	38.5 to 445.0 cfm (Displays 0 when the value is below 38.5 cfm)
10.0	0 to 10%F.S.	10.6 to 111.2 cfm (Displays 0 when the value is below 10.6 cfm)	21.2 to 222.4 cfm (Displays 0 when the value is below 21.2 cfm)	42.5 to 445.0 cfm (Displays 0 when the value is below 42.5 cfm)

\*: The zero-cut range of the accumulated value and accumulated pulse value should be 1% F.S. or more. However, please note that if the zero-cut set value is 0.0, any value below 1% F.S. will be cut.

\*: When setting the flow value and hysteresis within zero cut-off settable range, the on-off point varies depending on the settable range. For details, please refer to switch output (OUT) value and hysteresis are set within Zero cut-off range (page 55).

- When the set value and hysteresis of the switch output (OUT1/2) is set within the zero-cut range. The operating point of the switch output will be changed, depending on the zero-cut setting value. However, please note that the set value and hysteresis of the switch output will not be changed. To maintain the on-off point, set the value and hysteresis without the zero cut-off range.

<Example: PF3A703H (3000 L/min type)>


Common setting

Output mode	Hysteresis mode
Switch operation	Normal output
Set value (P_1)	80
Hysteresis (H_1)	30

### Initial setting

Zero cut-off setting CUt: 1.0 (displays 0 for a value below 30 L/min)

Switch ON point	80 L/min or more
Switch OFF point	Below 50 L/min

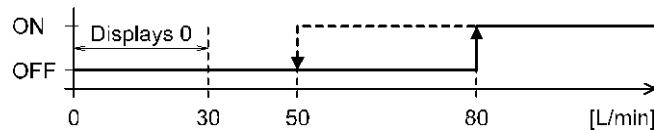


Change the zero cut-off setting  
The set value (P\_1) and hysteresis (H\_1)  
cannot be changed.

### ~Condition when the operating point of hysteresis (H\_1) is changed~

- The zero-cut setting CUt: 1.0 will be changed to CUt: 2.0. (0 will be displayed for a value below 60 L/min)


Switch ON point	80 L/min or more
Switch OFF point	Below 60 L/min (0 is displayed)

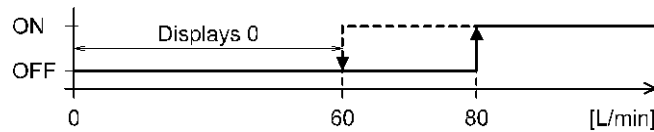

### ~Condition when the operating point of the set point (P\_1) and hysteresis (H\_1) is changed~

- The zero-cut setting CUt: 1.0 will be changed to CUt: 3.0. (0 will be displayed for a value below 90 L/min)

Switch ON point	90 L/min or more
Switch OFF point	Below 90 L/min (0 is displayed)

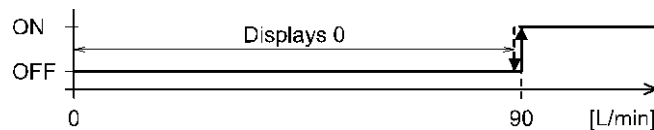

## ■[F30] Setting of accumulated value hold

In the default setting, the accumulated flow value is not held when the power supply is turned off. This function enables the accumulated flow value to be stored in permanent memory every 2 or 5 minutes.

\*: When using the accumulated value hold function, calculate the product life from the operating conditions, and use the product within its life. Maximum updating time of the accumulated value is 1.5 million times.

If the product is operated 24 hours per day, the product life will be as follows.

- Data memorized every 5 minutes: 5 minutes x 1.5 million times = 7.5 million minutes = 14.3 years
- Data memorized every 2 minutes: 2 minutes x 1.5 million times = 3 million minutes = 5.7 years

If the Accumulated Flow External Reset is repeatedly used, the product life will be shorter than calculated life.


<Operation>

Display [F30] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to select accumulated value hold.

### Select accumulated value hold

Press the ▲ or ▼ button to select the accumulate value hold.

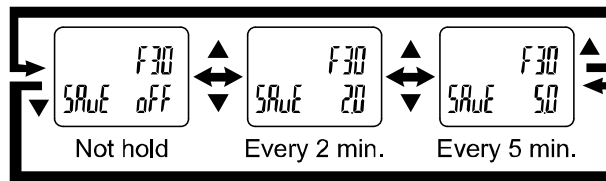


Press the S button to set. ↓ Return to function selection mode.

[F 30] Setting of accumulated value hold completed

\*: The value is stored in memory every 2 or 5 minutes. If the power supply is turned off, the accumulated flow since the last time it was stored will be lost.

\*: When the power supply is turned on again, the accumulated flow count will start from the last value recorded at B.

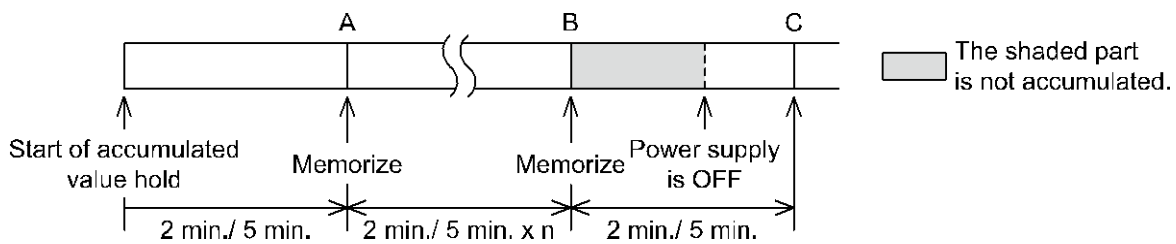



## ■[F80] Set display OFF mode

This function will turn the display OFF if no buttons are pressed for 30 seconds.

However when a flow monitor (PFG3 series) is connected, the displayed value might be different, due to an error. When the flow monitor display is used, it is recommended to set this product to the display OFF mode.


<Operation>

Display [F80] by pressing ▲ or ▼ button in function selection mode.


Press the S button. ↓ Move on to select display OFF mode.

### Select display OFF mode

Press the ▲ or ▼ button to select display OFF function.



Display ON




Display OFF

Press the S button to set. ↓ Return to function selection mode.

[F80] Set display OFF mode completed

\*: In display OFF mode, the under bar of sub display flashes.

\*: When any button is activated, the display will turn on. If no button operation is performed within 30 seconds, the display will turn off again.



## ■[F81] Security code

The security code can be turned on and off and the security code can be changed when unlocked.


< Operation >

Display [F81] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to Setting of security code

### Setting of Security code

Press the▲ or ▼ button to select the setting of security code.

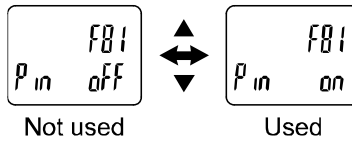

[oFF] is selected.  
Press the S button to  
return to function  
selection mode.

[on] is selected.  
Press the S button to set.


↓ Move on to check of the  
setting of security code.

### Check of the setting of security code

Press the ▲ or ▼ button to change the  
value.

Press the S button to move to the digit to  
the right.

(The default setting is [000])

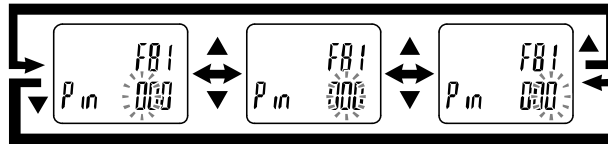

Press the S button for 1 second or longer.

- When the security code is correct, move on to the security code setting.
- If the security code entered is incorrect, [FAL] will be displayed, and the security code must be entered again.


If the wrong security code is entered 3 times, [nG] is displayed on the main display and the device returns to function selection mode.

↓ Move on to the setting of security code.



### Changing of security code.

New security code is displayed on the main display.  
 Press the ▲ or ▼ button to change the value.  
 Press the S button to move on to input the next digit.

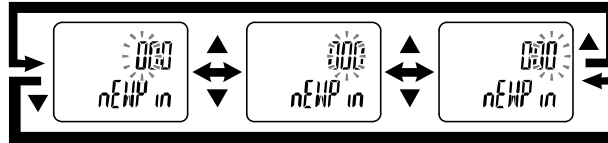

After entry, the changed security code will flash by pressing the S button for 1 second or longer.  
 (At this point, the changing of the security code is not completed)  
 Press the ▲ or ▼ button to return to setting step.



Press the S button to set. ↓ Return to function selection mode.

[F81] Security code completed

If the security code function is enabled, it is necessary to input a security code to release the key lock.

\*: If a key is not pressed for 30 seconds while entering the security code, function selection mode will return.


## ■[F90] Setting of all functions

Each time the S button is pressed, the function steps in the order shown in the following table.

<Operation>

Display [F90] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to the suction signal input check.

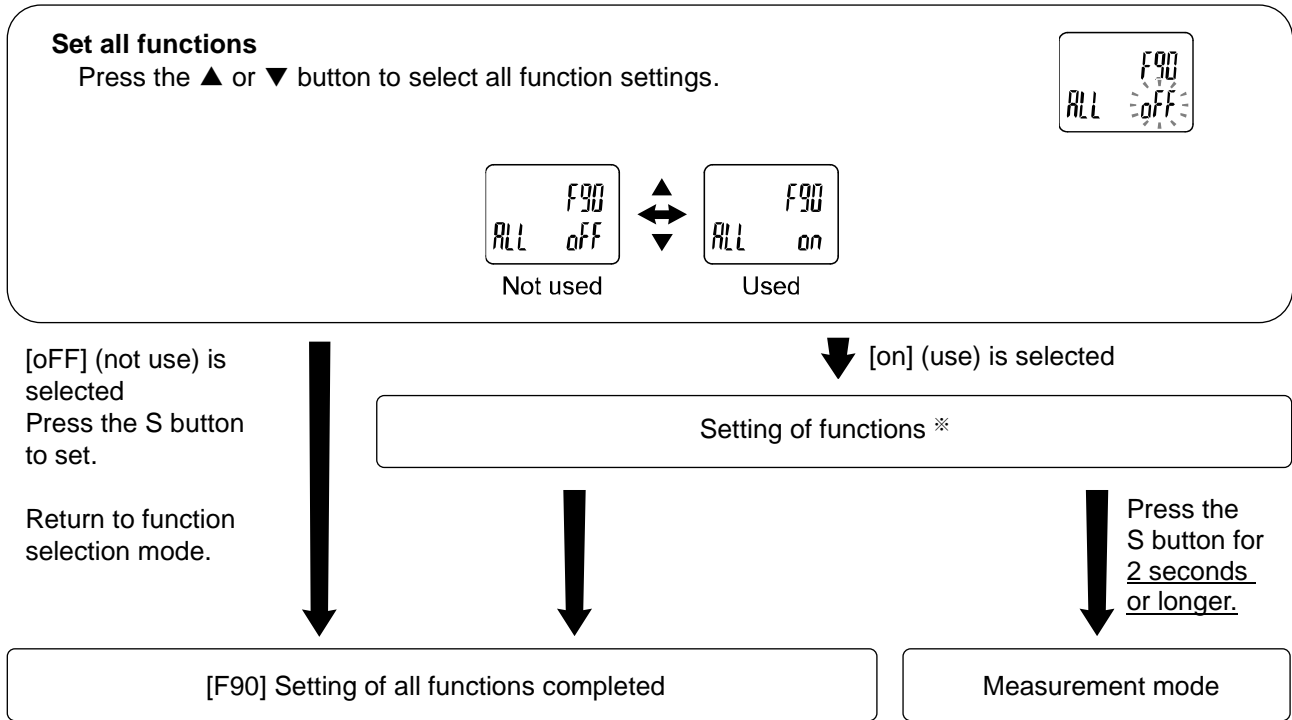

\*: Setting of each function

Every time the S button is pressed, the display moves to the next function in order of "Function setting" on page 61.

Set by pressing ▲ and ▼ button.

For details of how to set each function, refer to the relevant setting of function section in this manual.

## Order of function settings

Order	Function	Applicable model
[F 0]	Reference condition	All models
	Unit selection function	Model with units selection function
	Select NPN/PNP	All models
[F 1]	OUT1 output mode	All models
	OUT1 switch operation	All models (When setting mode is selected, except output off mode)
	OUT1 set value	All models (When setting mode is selected, except accumulated pulse output mode and output off mode)
	OUT1 hysteresis	All models (in hysteresis mode or window comparator mode)
	OUT1 delay time input	All models (in hysteresis mode or window comparator mode)
	OUT1 display colour	All models
[F 2] *1	OUT2 output mode	Model with OUT2 switch output
	OUT2 switch operation	Model with OUT2 switch output (When setting mode is selected, except output off mode)
	OUT2 set value	Model with OUT2 switch output (When setting mode is selected, except accumulated pulse output mode and output off mode)
	OUT2 hysteresis	Model with OUT2 switch output (in hysteresis mode or window comparator mode)
	OUT2 delay time input	Model with OUT2 switch output (in hysteresis mode or window comparator mode)
	OUT2 display colour	All models
[F 3]	Select digital filter	All models
[F 5]	Select FUNC	Model with OUT2/Analogue output/External input
[F10]	Select sub display (Line name setting)	All models
[F13]	Select reverse display	All models
[F14]	Select zero cut-off setting	All models
[F30]	Select accumulated value hold	All models
[F80]	Setting of display OFF mode	All models
[F81]	Setting of Security code	All models

\*1: [F 2] The OUT2 setting can be changed on the product screen, but there is no OUT2 switch output function for this product.

## ■[F96] Check of input signal

When the external input is selected by the FUNC setting, the ON/OFF of the input signal can be checked.


\*: However when analogue output is selected, the ON/OFF of the input signal cannot be checked.

<Operation>

Display [F96] by pressing ▲ or ▼ button in function selection mode.


Press the S button. ↓ Move on to check of input signal.

### Check of input signal




F96  
S. in OFF

The display shows OFF when there is no input signal, and it displays ON when there is an input signal.




F96  
S. in OFF

No input signal



F96  
S. in ON

With input signal



F96  
S. in ---

When analog output  
is selected

Press the S button to set. ↓ Return to function selection mode.

[F96] Check of input signal completed

## ■[F98] Setting of output check

The operation of the output can be checked by switching the output ON/OFF by pressing a button, without the need for a flow of fluid.


< Operation >

Display [F98] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ↓ Move on to select of output check

### Select of output check

Press the ▲ or ▼ button to select all function setting



Normal output (Output not checked)      Forced output (Output is checked)

[n] (Normal output) is selected. Press the S button to set.

[F] (Forced output) is selected. ↓ Move on to output check of OUT1. Press the S button to set.

### Output check of OUT1

Press the ▲ or ▼ button to select output check of OUT1.




Forced output OFF      Forced output ON

Return to function selection mode.

[F] (Forced output) is selected. ↓ Move on to output check of OUT2. Press the S button to set.

### Output check of OUT2

Press the ▲ or ▼ button to select output check of OUT2.



Forced output OFF      Forced output ON

[F 5] (FUNC) external input is selected. Press the S button to set. Move on to function selection mode.

[F 5] (FUNC) analogue output is selected. Press the S button to set. Move on to analogue output check.

[F 1] (OUT1) accumulated pulse output is selected. Press the S button to set. Move on to pulse output check.

### Accumulated pulse output check

Accumulated pulse is output for 10 times by pressing the ▲ button. Accumulated pulse is stopped by pressing the ▼ button.

Initial state

Converted pulse value

×  
10 outputs

\*: When the converted pulse value is 100 L/pulse, the value is changed from 0 to 1000 by pressing the ▲ button once (total of 10 times of output). If the ▲ button is pressed again, the value is changed from 1000 to 2000.

Move on to analogue output check.

### Analogue output check

Press the ▲ or ▼ button to select analogue output check.

Lower limit value

Upper limit value

\*: When 0-10V is selected for voltage output type, [ 0.0 ] ⇔ [ 10.0 ] is displayed.

\*: For current output type, [ 4 ] ⇔ [ 20 ] is displayed.

When the product is used in SIO mode

Press the S button to set. Move on to function selection mode.

When the product is used in SDCI mode (IO-Link)

Press the S button to set. Move on to the PD diagnostic bit check.

### PD diagnostic bit (flow) check

Press the ▲ or ▼ button to select diagnostic bit (flow) check.

Diagnostic bit 0

Diagnostic bit 1

\*: This function is available with IO-Link communication.

\*: Refer to page 78 for details of the diagnostic information.


Press the SET button to set.

Move on to PD diagnostic bit (flow) check.




### PD diagnostic bit (flow) check

Press the ▲ or ▼ button to select diagnostic bit (flow) check.



Diagnostic bit 0



Diagnostic bit 1



\*: This function is available with IO-Link communication.

\*: Refer to page 78 for details of the diagnostic information.


Press the SET button to set. ↓ Move on to PD flow measurement check.

### PD flow measurement check

Press the ▲ or ▼ button to select PD flow measurement check.



Lower limit  
of the PD rated



Upper limit  
of the PD rated

\*: This function is available with IO-Link communication.

Press the SET button to set. ↓ Return to function selection mode.

[F98] Setting of output check completed

\*: Measurement mode can return from any setting item by pressing the S button for 2 seconds or longer.

\*: An increase or decrease in flow will have no effect on the output while the output operation is being performed.

\*: PD stands for Process data. Refer to page 71 for further details of the PD.

## ■[F99] Reset to the default settings

If the Flow switch settings are uncertain, the default values can be restored.



<Operation>

Display [F99] by pressing ▲ or ▼ button in function selection mode.

Press the S button. ▼ Move on to reset to factory default settings.

### Rest to factory default settings.

Press the ▲ or ▼ button to display [ON], then press S and ▼ buttons simultaneously for 5 seconds or longer.

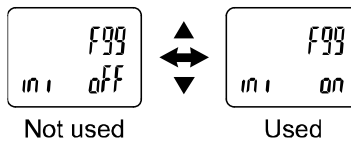

[oFF] (not use) is selected  
Press the S button to set.  
Return to function selection mode.

All settings are returned to the default values.  
Return to function selection mode.

[F99] Reset to the default settings completed

## Other Settings

- Reset operation

The Accumulated Flow, Peak Value and Bottom Value can be reset.

To reset the accumulated value, press the ▼ and S buttons for 1 second or longer.

- Snap shot function

The current flow rate value can be stored to the switch output ON/OFF set point.

When the items on the Sub display (left) are selected in either 3 step setting mode, Simple setting mode or Setting of each function mode, by pressing the ▲ and ▼ buttons simultaneously for 1 second or longer, the value of the sub display (right) will show "----", and the values corresponding to the current flow rate are automatically displayed.

Output mode	Configurable items	Sub display (left)	Snap shot function
Hysteresis mode	OUT set value	P_1 (n_1), P_2 (n_2)	○
	Hysteresis	H_1, H_2	○
Window comparator mode	OUT set value	P1L (n1L), P1H (n1H) P2L (n2L), P2H (n2H)	○
	Hysteresis	WH1, WH2	×

- OUT1 set value

The value is set to the same value as the display value (current flow rate value).

(There is a range which cannot be set to the current flow rate depending on the hysteresis difference. In that case, the value is set to the closest value.)

- Hysteresis

The hysteresis is calculated from the equation below and set.

Normal output: (OUT set value)-(current flow rate value)


Reverse output: (current flow rate value)-(OUT set value)

If the calculation result becomes 0 or less, [Err] is displayed on the sub display and the set value is not changed.

Afterwards, it is possible to adjust the value by pressing ▲ or ▼ button.

- Change of the accumulated output

The accumulated flow display style can be changed temporarily while the sub display is assigned for the accumulated flow display.

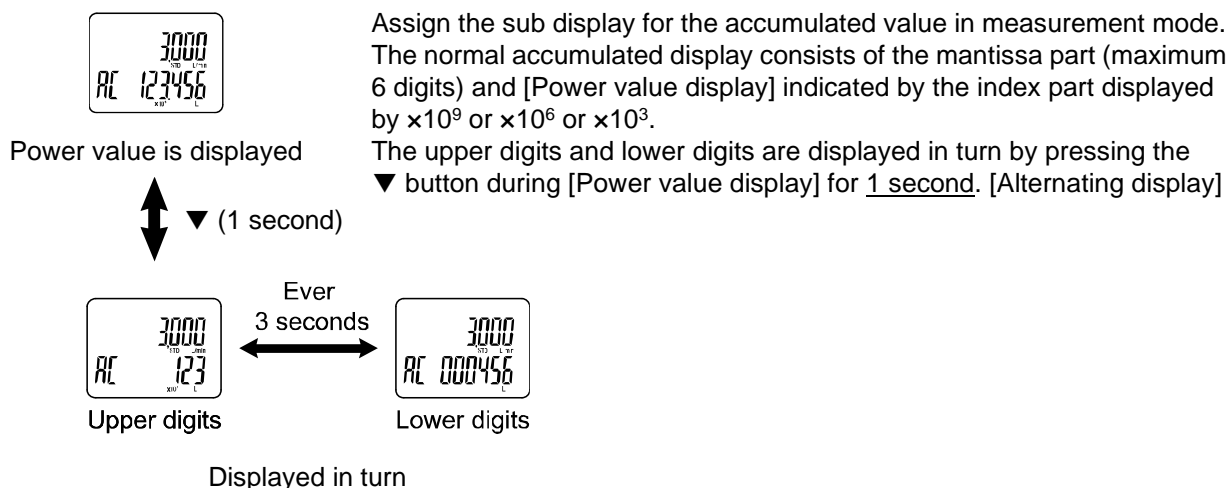

\*: If the accumulated value does not reach the upper digits (more than 7 digits), only the lower digits are displayed.

\*: If a button operation is not performed for 30 seconds during the alternating display, the display will flash.

●Key-lock function

The key lock function is used to prevent errors occurring due to unintentional changes of the set values. If S button is pressed while the keys are locked, [LoC] is displayed on the sub display (left) for approximately 1 second.


(Each setting and peak/ bottom values are displayed with ▲ and ▼ buttons.)

<Operation – Without security code input>


(1) Press the S button for 5 seconds or longer in measurement mode. When [oPE] is displayed on the main display, release the button.

The current setting [LoC] or [UnLoC] will be displayed on the sub display.

(To release key-lock repeat the above operation)

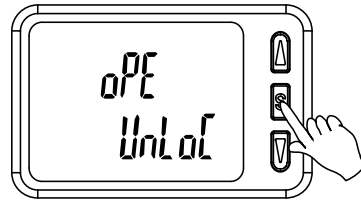


(2) Select the key locking/un-locking using the ▲ or ▼ button, and press the S button to set.

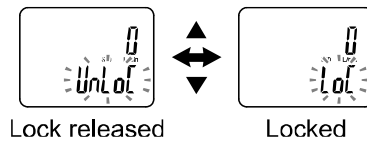


<Operation – Without security code input>

•Locking

- (1) Press the S button for 5 seconds or longer in measurement mode. When [oPE] is displayed on the main display, release the button.  
The current setting [LoC] or [UnLoC] will be displayed on the sub display.

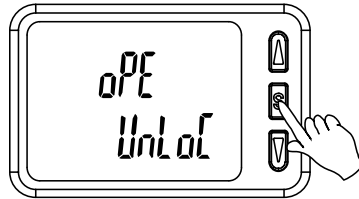


- (2) Select the key locking/ un-locking with ▲ or ▼ button, and press the S button to set.

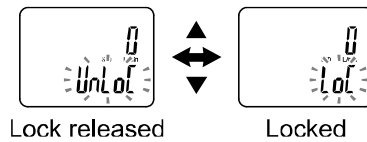


•Unlocking


- (1) Press the S button for 5 seconds or longer in measurement mode. When [oPE] is displayed on the main display, release the button.  
The current setting [LoC] or [UnLoC] will be displayed on the sub display.

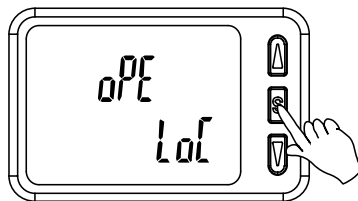

- (2) Select the un-locking [UnL] with ▲ or ▼ button. Setting is recognized by pressing the S button, then security code is required. When the security code is set, select the un-lock [UnLoC] with ▲ or ▼ button. Setting is recognized by pressing the S button, then the security code is required. If the security code is not set, select the un-lock [UnLoC]. Locking is released by pressing the S button.

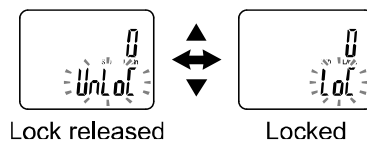

- (3) For the input method, refer to [F81] Security code (checking of the setting of security code) (page 58).

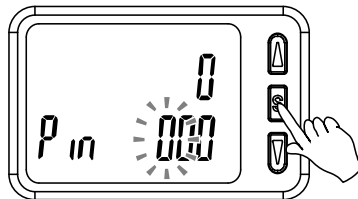

- (4) If inputted security code is correct, the indication of the main display changes to [UnLoC], and pressing one of ▲, S or ▼ button releases key lock and the measurement mode returns.  
If the security code entered is incorrect, [FAL] will be displayed on the main screen, and the security code must be entered again. If an incorrect security code is entered 3 times, [LoC] will be displayed on the main screen and the device will return to measurement mode.

## Maintenance

### **How to reset the product after a power loss or when the power has been unexpectedly removed**

The settings for the product are retained in memory prior to the power loss or de-energizing of the product. The output condition is also recoverable to that prior to the power loss or de-energizing. However, this may change depending on the operating environment. Therefore, check the safety of the whole installation before operating the product.

If the installation is using accurate control, wait until the product has warmed up (approximately 10 to 15 minutes) before operation.

## Forgotten the Security Code

If you have forgotten your security code, please contact SMC directly.

## IO-Link Specifications

### ■ Outline of IO-Link functions

#### ○ Communication function

This product can check the temperature measurement value, diagnostic information and switch output status using cyclic data communication via the IO-Link system.

#### ○ Product status monitoring function

This function monitors the product status via the IO-Link.

- Several errors (e.g. internal hardware errors) can be monitored.
- Detects multiple warning conditions (flow rate error, Internal failure, etc.).

#### ○ Data storage function

The Data storage function stores the IO-Link device parameter settings to the IO-Link master.

With the IO-Link data storage function, the IO-Link device can be replaced easily without re-setting the equipment construction or setting parameters

When the device parameter is set and downloaded to the device using the IO-Link setting tool, the parameter will be uploaded to the data storage in the master by the system command after download (backup instruction by the communication command).

When the device is replaced with the same type of IO-Link device due to failure, the parameter settings stored in the master are downloaded automatically, device can be operated with the parameter settings of the previous device.

Device parameter setting is applicable to 3 types of back-up levels of the master setting ("Inactive", "back-up/Restore", "Restore").

"Back-up" implies the activation of upload and "restore" implies download.

### ■ Communication specifications

IO-Link type	Device
IO-Link version	V1.1
Communication speed	COM2 (38.4 kbps)
Min. cycle time	3.3 ms
Process data length	Input Data: 4 byte, Output Data: 0 byte
On request data communication	Available
Data storage function	Available
Event function	Available

## ■ Process data

Process data is the data which is exchanged periodically between the master and device.  
This product process data consists of switch output status, error diagnostics, fixed output and flow measurement value.

(Refer to the table below.)

Bit offset	Item	Notes
0	OUT1 output	0: OFF 1: ON
1	OUT2 output	0: OFF 1: ON
8	Measurement diagnostics	0: Within range 1: Out of range (HHH)
14	Fixed output	0: Normal output 1: Fixed output (Setting of output check)
15	Error Diagnosis	0: Error not generated 1: Error generated
16 to 31	Flow measurement value	With sign: 16 bit

Bit offset	31	30	29	28	27	26	25	24	23	22	21	20	19	18	17	16
Item	Flow measurement value (PD)															

Bit offset	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Item	Error diagnosis	Fixed output	Reservation				Flow diagnosis	Reservation				OUT2	OUT1			
												Switch output				

•The process data of this product is Big-Endian type.

When the transmission method of the upper communication is Little-Endian, the byte order will be changed.

Refer to the table below for the Endian type of the major upper communication.

Endian type	Upper communication protocol
Big-Endian type	Such as PROFIBUS and PROFINET
Little-Endian type	Such as EtherNET/IP, EtherCAT and CC-Link IE Field.




○Unit specification and flow measurement value (PD)

Series	Unit	Flow range	Flow value		PD value					
			Rated flow range		Display/settable range					
			Min.	to Max.	Min.	to Max.	A	to B	C	to D
PF3A7#H	L/min	3,000 L	30	to 3000	30	to 3150	40	to 4000	40	to 4200
		6,000 L	60	to 6000	60	to 6300	40	to 4000	40	to 4200
		12,000 L	120	to 12000	120	to 12600	40	to 4000	40	to 4200
	cfm	3,000 L	1.1	to 105.9	1.1	to 111.2	40	to 4000	40	to 4200
		6,000 L	2.2	to 211.9	2.2	to 222.4	40	to 4000	40	to 4200
		12,000 L	4.0	to 424.0	4.0	to 445.0	40	to 4000	40	to 4200

\*: The flow ranges and relationship between the fluid and PD are shown in the figures below.

●Relationship between flow rate and PD

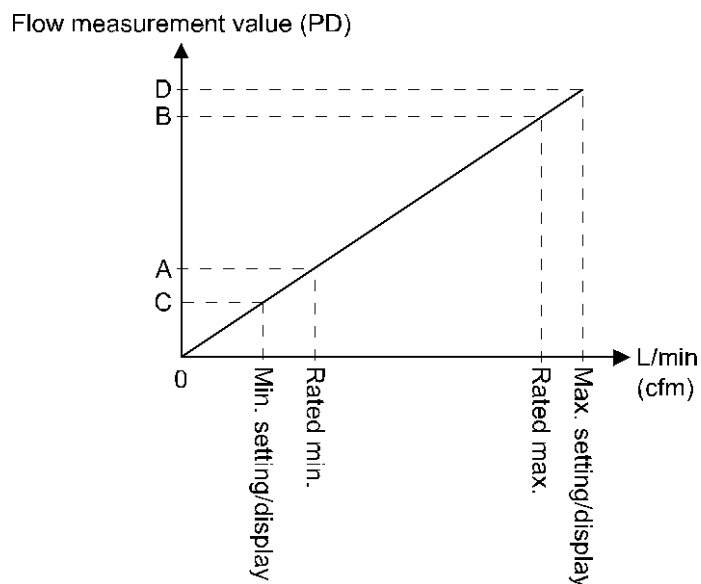

○ Conversion formula of the process data and flow measurement value

**(1) Conversion formula from the process data to the flow measurement value:**

$$Pr = a \times (PD) + b$$

**(2) Conversion formula from the flow gauge measurement value to the process data:**

$$(PD) = (Pr - b) / a$$

Pr: Flow measurement value and pressure set value

PD: Flow measurement value (process data)

a: Inclination

b: Intercept

[Inclination and intercept to the unit specification]

Series	Unit	Flow range	Inclination a	Intercept b
PF3A7#H	L/min	3000 L	0.75	0
		6000 L	1.50	0
		12000 L	3.00	0
	cfm	3000 L	0.026475	0
		6000 L	0.05295	0
		12000 L	0.106	0

[Calculation example]

**(1) Conversion from the process data to the flow measurement value**

**(For PF3A703H series, unit L/min, flow range 3000 L and PD = 2800)**

$$\begin{aligned} Pr &= a \times (PD) + b \\ &= 0.75 \times 2800 + 0 \\ &= 2100 \text{ [L/min]} \end{aligned}$$

**(2) Conversion from the flow measurement value to the process data**

**(For PF3A706H series, unit L/min, flow range 6000 L and Pr = 5250 [L/min])**

$$\begin{aligned} (PD) &= (Pr - b) / a \\ &= [5250 - 0] / 1.50 \\ &= 3500 \end{aligned}$$

## ■ IO-Link parameter setting

### ○ IODD file

IODD (I/O Device Description) is a definition file which provides all properties and parameters required for establishing functions and communication of the device.

IODD includes the main IODD file and a set of image files such as vendor logo, device picture and device icon.

The IODD file is shown below.

Product No.	IODD file *
PF3A7*H-*-L*-*	SMC-PF3A7*H-*-L*-*-*-yyyymmdd-IODD1.1

\*: "\*" indicates the product No., and the product No. applicable to each IODD file input.

\*: "yyyymmdd" indicates the file preparation date. yyyy is the year, mm is the month and dd is the date.

The IODD file can be downloaded from the SMC Web site (<https://www.smcworld.com>).

### ○ Service data

The tables below indicate the parameters which can be read or written by simple access parameter (direct parameters page) and ISDU parameters which are applicable to various parameters and commands.

#### ● Direct parameters page 1

DPP1 address	Access	Parameter name	Initial value (dec)	Content
0x07	R	Vendor ID	0x0083 (131)	"SMC Corporation"
0x08				
0x09	R	Device ID	0X0190 (400)	PF3A703H-xx-Lx-xxx
0x0A			0X0191 (401)	PF3A703H-xx-L3x-xxx
			0X0192 (402)	PF3A703H-xx-L4x-xxx
			0X0193 (403)	PF3A706H-xx-Lx-xxx
			0X0194 (404)	PF3A706H-xx-L3x-xxx
			0X0195 (405)	PF3A706H-xx-L4x-xxx
			0x0B	0X0196 (406)
0X0197 (407)	PF3A712H-xx-L3x-xxx			
		0X0198 (408)	PF3A712H-xx-L4x-xxx	

●ISDU parameters

Index (dec)	Sub index	Access *1	Parameters	Initial value	Remarks
0x0002 (2)	0	W	System command	-	Refer to "System command" on page 76.
0x000C (12)	0	R/W	Device access lock	0x0000	Refer to "Device access lock parameter" on page 77.
0x0010 (16)	0	R	Vendor name	SMC Corporation	
0x0011 (17)	0	R	Vendor text	www.smcworld.com	
0x0012 (18)	0	R	Product name	Example: PF3A703H-xx-Lx-xxx	
0x0013 (19)	0	R	Product ID	Example: PF3A703H-xx-Lx-xxx	
0x0014 (20)	0	R	Product text	Flow sensor	
0x0015 (21)	0	R	Serial number	Example: "xxxxxxxx"	•Initial value is indicated as 8-digit. •16 octets fixed character string
0x0016 (22)	0	R	Hardware version	HW-Vx.y	x: Large revision number y: Small revision number
0x0017 (23)	0	R	Software version	FW-Vx.y	x: Large revision number y: Small revision number
0x0024 (36)	0	R	Device status parameter	-	Refer to "Device state parameters" on page 77.
0x0025 (37)	0	R	Device detailed state parameter	-	Refer to "Device detailed state parameter" on page 78.
0x0028 (40)	0	R	Process data input	-	The latest value of process data can be read.

\*1: R: Read, W: Write

●System command (index 2)

In the ISDU index 0x0002 SystemCommand (system command), the command shown in the table below will be issued.

The button of each system command is displayed on the IO-Link setting tool (excluding "ParamDownloadStore").

Click the button to send the system command to the product.

Writable commands are shown below.

Data type: 8 bit UInteger

Value	Function definition	Description
128	Device Reset	Restart <sub>s</sub> the device
129	Application Reset	Reset of the peak/bottom value (flow rate/temperature) Reset of the accumulated flow value
130	Restore Factory Reset	Initialize the set value to the default value
170	Flow peak bottom Reset	Reset of peak/bottom value (flow rate)
190	Integrated flow Reset	Reset of the accumulated flow value

- Device access lock parameter (index 12)

The contents are as follows.

Data type: 16 bit Record

Value	Contents
0	Key lock release, DS unlock (Initial value)
2	Key lock release, DS lock
8	Key lock, DS unlock
10	Key lock, DS lock

**[Key lock]**

This function prevents the user from physically changing the setting of the flow switch (button operation is not accepted).

Even when key lock function is activated, settings can be changed by IO-Link communication.

Restoration by data storage (overwriting parameter data) can be performed.

**[Lock data storage (DS lock)]**

Locking "Data storage" will invalidate the data storage function of the flow switch.

In this case, access will be denied for backup and restoration of data storage.

- Device state parameters (index 36)

Readable device states are as follows.

Data type: 8 bit UInteger

Value	State definition	Description
0	Normal operation	-
1	Maintenance inspection required	Not available
2	Outside specification range	Outside the flow measurement range
3	Function check	Not available
4	Failure	Internal failure of digital flow switch

- Device detail status parameters (index 37)

Detailed event contents of readable device status are as follows.

Array	Event content	Event classification		Event code
		Definition	Value	
1	Internal failure of digital flow switch	Error	0xF4	0x8D02
2	Internal failure of digital flow switch	Error	0xF4	0x8D03
3	Internal failure of digital flow switch	Error	0xF4	0x8D04
4	Internal failure of digital flow switch	Error	0xF4	0x8D05
5	Internal failure of digital flow switch	Error	0xF4	0x8D01
6	Internal failure of digital flow switch	Error	0xF4	0x8D06
7	Internal failure of digital flow switch	Error	0xF4	0x8D08
8	Flow sensor error	Error	0xF4	0x8CD0
9	Temperature sensor error	Error	0xF4	0x8CD1
10	Outside the accumulated flow value measurement	warning	0xE4	0x8D80
11	Outside the instantaneous flow measurement	warning	0xE4	0x8C10
12	Test event A	warning	0xE4	0x8CA0
13	Test event B	warning	0xE4	0x8CA1
14	Data storage upload request	notification	0x54	0xFF91

●Product individual parameters

Index		Sub index	Access *1	Parameter	Data type *2	Initial value	Data storage *3	Set value *4	Remarks
dec	hex								
1000	0x03E8	0	R/W	Unit (Selection of display unit)	U8	0	Y	0: L/min (L) 1: cfm (ft <sup>3</sup> )	When the unit selection function is not included, a read/write to an un-selectable item is rejected.
1010	0x03F2	0	R/W	CoL (Selection of display colour)	U8	2	Y	0: rEd (Constantly red) 1: Grn (Constantly green) 2: 1SoG (OUT1 turns green at ON) 3: 1Sor (OUT1 turns red at ON) 4: 2SoG (OUT2 turns green at ON) 5: 2Sor (OUT2 turns red at ON)	Setting of display colour
1020	0x03FC	0	R/W	NorP (Selection of switch output PNP/NPN)	U8	1	Y	0: NPN 1: PNP	Setting the switch output
1030	0x0406	0	R/W	Change by FUNC	U8	0	Y	0: Aout (Analogue output) 1: in (Exterior input)	FUNC terminal function setting
1070	0x042E	0	R/W	Reference condition	U8	0	Y	0: std (Standard condition) 1: nor (Normal condition)	
1210	0x04BA	1	R/W	oUt1 (Selection of output mode)	U8	0	Y	0: HYS (Hysteresis) 1: Wind (Window comparator) 2: AC (Accumulated output) 3: PLS (Accumulated pulse) 4: Err (Error output) 5: oFF (Output OFF)	
		2	R/W	1ot (Selection of output type)	U8	0	Y	0: 1_P (Normal output) 1: 1_n (Reverse output)	Setting of OUT1 output normal and reserved output
1220	0x04C4	1	R/W	P_1 (n_1) (Selection of output set value)	S16	2000	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT1 output set value (Hysteresis)
		2	R/W	H_1 (Setting of OUT1 hysteresis)	U16	200	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT1 hysteresis (Hysteresis)
		3	R/W	P1L (n1L) (Lower limit of window comparator)	S16	1200	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT1 output set value (Lower limit of window comparator)
		4	R/W	P1H (n1H) (Upper limit of window comparator)	S16	2400	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT1 output set value (Upper limit of window comparator)
		5	R/W	WH1 (Window comparator hysteresis)	U16	400	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT1 hysteresis (Window comparator)
		6	R/W	dt1 (Delay time)	U16	0	Y	Settable values 0x0000 to 0x1770 (0 to 6000)	Setting of OUT1 delay time 10 ms increment

●Product individual parameters (continued)

Index		Sub index	Access *1	Parameter	Data type *2	Initial value	Data storage *3	Set value *4	Remarks							
dec	hex															
1410	0x0582	1	R/W	oUt2 (Selection of output mode)	U8	0	Y	0: HYS (Hysteresis) 1: Wind (Window comparator) 2: AC (Accumulated output) 3: PLS (Accumulated pulse) 4: Err (Error output) 5: oFF (Output OFF)								
		2	R/W							2ot (Selection of output type)	U8	0	Y	0: 2_P (Normal output) 1: 2_n (Reverse output)	Setting of OUT2 output normal and reserved output	
1420	0x058C	1	R/W	OUT2 setting	P_2 (n_2) (Selection of output set value)	S16	2000	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT2 output set value (Hysteresis)						
		2	R/W								H_2 (Setting of OUT2 hysteresis)	U16	200	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT2 hysteresis (Hysteresis)
		3	R/W								P2L (n2L) (Lower limit of window comparator)	S16	1200	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT2 output set value (Lower limit of window comparator)
		4	R/W								P2H (n2H) (Upper limit of window comparator)	S16	2400	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT2 output set value (Upper limit of window comparator)
		5	R/W								WH2 (Window comparator hysteresis)	U16	400	Y	Setting range Refer to "Settable range list". (Page 83)	Setting of OUT2 hysteresis (Window comparator)
		6	R/W								dt2 (Delay time)	U16	0	Y	Settable values 0x0000 to 0x1770 (0 to 6000)	Setting of OUT2 delay time 10 ms increment
1300	0x0514	1	R/W	OUT1 accumulated flow setting	AC1_L (OUT1 set value (L))	S16	0	Y	Setting range 0x0000 to 0x270F (0 to 9999)	Setting of OUT1 set value Unit specification (Unit): When "L" is selected						
		2	R/W								AC1_L (OUT1 index (L))	S16	0	Y	Setting range 0x0000 to 0x0008 (0 to 8)	Setting of OUT1 index value Unit specification (Unit): When "L" is selected
1310	0x051E	1	R/W	OUT1 accumulated flow setting	AC1_Ft <sup>3</sup> (OUT1 set value (Ft <sup>3</sup> ))	S16	0	Y	Setting range 0x0000 to 0x270F (0 to 9999)	Setting of OUT1 set value Unit specification (Unit): When "Ft <sup>3</sup> " is selected						
		2	R/W								AC1_Ft <sup>3</sup> (OUT1 index (Ft <sup>3</sup> ))	S16	0	Y	Setting range 0x0000 to 0x0008 (0 to 8)	Setting of OUT1 index value Unit specification (Unit): When "Ft <sup>3</sup> " is selected
1500	0x05DC	1	R/W	OUT2 accumulated flow setting	AC2_L (OUT2 set value (L))	S16	0	Y	Setting range 0x0000 to 0x270F (0 to 9999)	Setting of OUT2 set value Unit specification (Unit): When "L" is selected						
		2	R/W								AC2_L (OUT2 index (L))	S16	0	Y	Setting range 0x0000 to 0x0008 (0 to 8)	Setting of OUT2 index value Unit specification (Unit): When "L" is selected
1510	0x05E6	1	R/W	OUT2 accumulated flow setting	AC2_Ft <sup>3</sup> (OUT2 set value (Ft <sup>3</sup> ))	S16	0	Y	Setting range 0x0000 to 0x270F (0 to 9999)	Setting of OUT2 set value Unit specification (Unit): When "Ft <sup>3</sup> " is selected						
		2	R/W								AC2_Ft <sup>3</sup> (OUT2 index (Ft <sup>3</sup> ))	S16	0	Y	Setting range 0x0000 to 0x0008 (0 to 8)	Setting of OUT2 index value Unit specification (Unit): When "Ft <sup>3</sup> " is selected



●Product individual parameters (continued)

Index		Sub index	Access *1	Parameter		Data type *2	Initial value	Data storage *3	Set value *4	Remarks
dec	hex									
1320	0x0528	0	R/W	OUT1 accumulated pulse converted value	PLS1_L	U8	0	Y	0: 100 (L/pulse) 1: 1000 (L/pulse)	Accumulated pulse converted value setting
1330	0x0532	0	R/W		PLS1_F <sup>8</sup>	U8	0	Y	3000/6000 L range 0: 1 (L/pulse) 1: 10 (L/pulse) 12000 L range 0: 10 (L/pulse) 1: 100 (L/pulse)	
1520	0x05F0	0	R/W	OUT2 accumulated pulse converted value	PLS1_L	U8	0	Y	0: 100 (L/pulse) 1: 1000 (L/pulse)	
1530	0x05FA	0	R/W		PLS1_F <sup>8</sup>	U8	0	Y	3000/6000 L range 0: 1 (L/pulse) 1: 10 (L/pulse) 12000 L range 0: 10 (L/pulse) 1: 100 (L/pulse)	
1600	0x0640	0	R/W	AC (Setting of the accumulated flow output direction)	U8	0	Y	0: Add (Addition) 1: dEC1 (Subtraction OUT1) 2: dEC2 (Subtraction OUT2)	Setting of the accumulated flow output direction	
1800	0x0708	0	R/W	FiL (Digital filter)	U8	0	Y	0: 1.0 sec 1: 2.0 sec 2: 5.0 sec	Set digital filter	
2000	0x07D0	1	R/W	Sub (Setting of lower level display)	U8	0	Y	0: dEF (Default) 1: LinE (Line name) 2: oFF (Display is OFF)	Setting of the lower level display	
		2	R/W	dEF [Selection of display items during dEF setting]	U8	20	Y	Refer to "Selection of display items" when dEF is set". (Page 84)	[Setting of display items of lower display during dEF setting]	
2020	0x07E4	0	R/W	rEv (Reserved Display setting)	U8	0	Y	0: oFF (Normal display) 1: on (Reversed display)	Reserved Display setting	
2030	0x07EE	0	R/W	Cut (Zero cut-off setting)	U8	0	Y	Setting range 0x0000 to 0x000A (0 to 10)	1.0% increments	
2040	0x07F8	0	R/W	in (External input setting)	U8	0	Y	0: rAC (Reset accumulation) 1: rPb (Reset peak/bottom)	External input setting	
2100	0x0834	0	R/W	AoUt (Setting of analogue output)	U8	0	Y	0: 1 to 5 V 1: 0 to 10 V	Setting of analogue output (Voltage output type only)	
2110	0x083E	1	R/W	FrEE (Setting of free range mode)	U8	0	Y	0: oFF (Unused) 1: on (Used)	Setting of free range mode	
		2	R/W	F_H (Set value of free range)	S16	4000	Y	Setting range 0x0190 to 0x1068 (400 to 4200)	Set value of free range Rated value 10% to 105%	
2200	0x0898	0	R/W	SAVE (Accumulated flow value hold setting)	U8	0	Y	0: oFF (Not held) 1: 2.0 min 2: 5.0 min		
2400	0x0960	0	R/W	diSP (Display OFF setting)	U8	0	Y	0: on 1: oFF		

●Product individual parameters (continued)

Index		Sub index	Access *1	Parameter		Data type *2	Initial value	Data storage *3	Set value *4	Remarks
dec	hex									
2410	0x096A	1	R/W	Security code	Pin (Security code Used/Not used)	U8	0	Y	0: oFF (Unused) 1: on (Used)	
		2	R/W		PinCode (Security code setting)	U16	0	Y	Setting range 0x0000 to 0x03E7 (0 to 999)	
2420	0x0974	1	R/W	Lower level screen	Line name 1st letter	U8	0	Y	Refer to "Line name: communication data". (Page 85)	11 seg
		2	R/W		Line name 2nd letter	U8	0	Y		7seg
		3	R/W		Line name 3rd letter	U8	0	Y		7seg
		4	R/W		Line name 4th letter	U8	0	Y		7seg
		5	R/W		Line name 5th letter	U8	0	Y		7seg
		6	R/W		Line name 6th letter	U8	0	Y		11seg
		7	R/W		Line name 7th letter	U8	0	Y		7seg
		8	R/W		Line name 8th letter	U8	0	Y		7seg
		9	R/W		Line name 9th letter	U8	0	Y		7seg
7000	0x1B58	0	W	Communication OUT output test	Communication OUT output test	U8	-	N	0: Normal output 1: Fixed output	The PD becomes 1 when a fixed output has been received
7010	0x1B62	0	W		Toggle output command	U8	-	N	Refer to table "Toggle output command". (Page 83)	
7100	0x1BBC	0	R	Analogue output value		U16	-	N	0x0000 to 0x0BB8 (0 to 3000)	Analogue output type only
8000	0x1F40	0	R	Measurement related	Inclination of flow rate PD a	F32	-	N	Refer to "Inclination and intercept to the unit specification" (Page 74)	
8010	0x1F4A	0	R		Flow rate PD intercept b	F32	-	N	Refer to "Inclination and intercept to the unit specification" (Page 74)	
8020	0x1F54	0	R		Flow peak value	S16	-	N	0x0000 to 0x1068 (0 to 4200)	
8030	0x1F5E	0	R		Flow bottom value	S16	-	N	0x0000 to 0x1068 (0 to 4200)	
8040	0x1F68	1	R		Accumulated mantissa (Accumulated flow upper 4 digits)	U16	-	N	0x0000 to 0x270F (0 to 9999)	Accumulated mantissa x 10 <sup>(Accumulated index)</sup> = Current accumulated flow Example: 990 x 10 <sup>0</sup> = 990L 9999 x 10 <sup>5</sup> = 999,900,000L *: Figures less than the upper 4 digits are rounded down.
		2	R	Accumulated index	S16	-	N	0x0000 to 0x0008 (0 to 8)		

\*1: "R" means Read and "W" means Write.

\*2: Refer to the table below for the symbol.

Symbol	Data type (IO-Link standard)	Data length Bit [byte]	Description
U8	UIntegerT	8[1]	Unsigned integer
U16		16[2]	
S16	IntegerT	16[2]	Signed integer
F32	Float32T	32[4]	Floating point number

\*3: "Y" indicates that the parameter setting data is saved to the master, and "N" indicates that the parameter is not saved.

\*4: Read/write to un-selectable items will be rejected depending on the product No.

[Set range list]

Item	Setting range (PD)		
	3000 L	6000 L	12000 L
P_1/P_2 (n_1/n_2)	0x0028 to 0x1068 (40 to 4200)	0x0028 to 0x1068 (40 to 4200)	0x0028 to 0x1068 (40 to 4200)
H_1/H_2	0x0000 to 0x1040 (0 to 4160)	0x0000 to 0x1040 (0 to 4160)	0x0000 to 0x1040 (0 to 4160)
P1L/P2L (n1L/n2L)	0x0028 to 0x1068 (40 to 4200)	0x0028 to 0x1068 (40 to 4200)	0x0028 to 0x1068 (40 to 4200)
P1H/P2H (n1H/n2H)	0x0028 to 0x1068 (40 to 4200)	0x0028 to 0x1068 (40 to 4200)	0x0028 to 0x1068 (40 to 4200)
WH1/WH2	0x0000 to 0x0820 (0 to 2080)	0x0000 to 0x0820 (0 to 2080)	0x0000 to 0x0820 (0 to 2080)

[Toggle output command]

Item	Value	Notes
Measured value	0	
OUT output bit	OUT1	Connected with hardware output (Not connected as OUT2 does not have the hardware)
	OUT2	
Analogue output	80	
Diagnosis bit	224	
Error bit	255	

[dEF selection of display items during standard setting]

Value	Setting content		Supplemental information
0	OUT1	HYS mode set value	When the value which does not match the OUT* output mode setting is written, acknowledgment is sent
1		HYS mode hysteresis	
2		Wind mode lower side set value	
3		Wind mode upper side set value	
4		Wind mode hysteresis	
5		Accumulated output mode	
6		Accumulated pluse output mode	
7		Err mode	
8		oFF mode	
9	OUT2	HYS mode set value	
10		HYS mode hysteresis	
11		Wind mode lower side set value	
12		Wind mode upper side set value	
13		Wind mode hysteresis	
14		Accumulated output mode	
15		Accumulated pluse output mode	
16		Err mode	
17		oFF mode	
18	Flow bottom value		
19	Flow peak value		
20	Accumulated flow value		
21	Switch output mode/communication mode display		SIO mode/SDCI mode (Refer to page 14)
22	Option display		Line name, not displayed

[Line name communication data]

Value (16 hex number)		00	01	02	03	04	05	06	07	08	09	0A	0B	0C	0D	0E	0F	
Display letter	7seg	8	6	0	8	8	8	0	8	1	0	8	0	0	0	0	0	
	11seg	8	6	0	8	8	8	0	8	1	0	8	0	0	0	0	0	
Value (16 hex number)		10	11	12	13	14	15	16	17	18	19	1A	1B	1C	1D	1E	1F	
Display letter	7seg	/	7	5	8	0	0	0	8	/	8	/	0	0	2	3	4	5
	11seg	8	7	5	8	0	0	0	8	8	3	0	0	2	3	4	5	
Value (16 hex number)		20	21	22	23	24	25	26	27	28	29	2A	2B	2C	2D	2E	2F	
Display letter	7seg	8	0	8	9	1	1	1	/	/	/	/	/	/	/	/	1	
	11seg	8	0	8	9	1	1	1	1	1	1	1	1	1	1	1	1	

## Troubleshooting

If an operation failure of the product occurs, please confirm the cause of the troubles from the following table. If a cause applicable to the troubles cannot be identified and normal operation can be recovered by replacement with a new product, this indicates that the product itself was faulty. Problems with the product may be due to the operating environment (installation etc). Please consult SMC.

### ●Cross-reference for troubleshooting

Error indication	Problem Possible causes	Investigation method	Countermeasure
<ul style="list-style-type: none"> <li>•The Auto switch output does not turn off. The indicator light stays ON</li> <li>•The switch output does not turn on Operation LED stays OFF</li> </ul>	Incorrect flow rate setting	(1) Check the flow rate setting. (2) Check the settings of the operation mode, hysteresis and output type. (in hysteresis mode or window comparator mode, and normal output/ reversed output)	(1) Adjust the set flow rate. (2) Change the response time setting.
	Product failure		Replace the product
The output does not turn off. Indicator light is normal	Incorrect wiring	Check the output wiring. Check if the load is directly connected to DC(+) or DC(-).	Check and correct the wiring.
	Product failure		Replace the product
The output does not turn on. Indicator light is normal	Incorrect wiring	Check the output wiring. Check if the load is directly connected to DC(+) or DC(-).	Check and correct the wiring.
	Model Selection	Check if PNP output is used when NPN should have been selected, or the other way around.	Revise the model selection (output specification).
	Lead wire broken	Check if there is bending stress applied to any part of the lead wire. (bending radius, tensile force to the lead wire)	Correct the wiring. (Reduce the tensile force or increase the bending radius.)
	Product failure		Replace the product
The switch output generates chattering.	Incorrect wiring	Check the wiring. Check if the brown and blue wires are connected to DC(+) and DC(-) respectively, and if the output line is secure (contact failure).	Correct the connection on the power cord and the plug.
	Incorrect flow rate setting	(1) Check the flow rate setting. (2) Check if the tolerance range is small.	(1) Adjust the set flow rate. (2) Make the tolerance wider.
	Product failure		Replace the product

Error indication	Problem Possible causes	Investigation method	Countermeasure
<ul style="list-style-type: none"> <li>•Over current error (Er1) is displayed</li> <li>•System error (Er0, 4 to 16, 40) is displayed</li> <li>•"HHH" is displayed</li> </ul>	Excess current was applied to the output (Er1)	<ul style="list-style-type: none"> <li>(1) Check if the output current is 60 mA or greater.</li> <li>(2) Check if the connected load complies with the specification. Check if the load is short circuited.</li> <li>(3) Check if the relay without surge protection is connected.</li> <li>(4) Check if the wiring is in the same route as (or bundled together with) a high-voltage or power line.</li> </ul>	<ul style="list-style-type: none"> <li>(1)(2) Connect the appropriate load.</li> <li>(3) Use a relay with a surge voltage suppressor or take measures to prevent surge.</li> <li>(4) Separate the wiring from the high-voltage and/or power line.</li> </ul>
	Incorrect internal data processing of the product (Er0, 4 to 16, 40)	<ul style="list-style-type: none"> <li>(1) Check if there is noise interference (such as static electricity). Check if there is a noise source nearby.</li> <li>(2) Check if the power supply voltage is in the range 24 VDC <math>\pm</math>10%.</li> </ul>	<ul style="list-style-type: none"> <li>(1) Remove the noise and the noise source (or take measures to prevent noise interference), and reset the product (or turn off and then turn back on the power supply).</li> <li>(2) Check that the Power supply voltage is 24 VDC <math>\pm</math>10%.</li> </ul>
	Applied flow rate is higher than the upper limit (HHH)	<ul style="list-style-type: none"> <li>(1) Check if the flow rate exceeds the upper limit of the set flow rate.</li> <li>(2) Check if foreign matter has entered the piping.</li> </ul>	<ul style="list-style-type: none"> <li>(1) Reset applied flow rate to a level within the settable flow range.</li> <li>(2) Take measures to prevent foreign matter from entering the piping.</li> </ul>
	Product failure		Replace the product
The display is unstable.	Incorrect power supply	Check if the power supply voltage is in the range 24 VDC $\pm$ 10%.	Power supply voltage is 24 VDC $\pm$ 10%.
	Incorrect wiring	Check the power supply wiring Check if the brown and blue wires are connected to DC(+) and DC(-) respectively, and if the wiring is secure	Check and correct the wiring.
	Factory line pressure is not stable	Check if the factory line pressure is changing.	Setting of the response time may improve the condition.

Error indication	Problem Possible causes	Investigation method	Countermeasure
The display turns off. Part of the display is missing.	Incorrect power supply	Check if the power supply voltage is 24 VDC $\pm$ 10%.	Power supply voltage is 24 VDC $\pm$ 10%.
	Incorrect wiring	Check the power supply wiring Check if the brown and blue wires are connected to DC(+) and DC(-) respectively, and if the wiring is secure	Check and correct the wiring.
	Display off mode	Check if display off mode is selected.	Select the power saving mode again.
	Product failure		Replace the product
Display flashes	Incorrect wiring	(1) Check the power supply wiring. (2) Check if there is bending stress applied to any part of the lead wire.	(1) Check and correct the wiring. (2) Correct the wiring (bend radius and stress).
The flow rate display accuracy does not meet the specifications.	Foreign matter entered	Confirmed foreign matter entry or sticking to the piping port.	Use a filter to prevent foreign matter from entering or sticking. Discharge the condensate of the filter periodically.
	Air leakage	Check if air is leaking from the piping.	Rework the piping. If the tightening torque is exceeded, the mounting screws, brackets and the flow switch may be damaged.
	Warming up inadequate	Check if the product satisfies the specified accuracy 10 minutes after supplying power.	After energizing, the display and output can drift. Allow the product to warm up for 10 to 15 minutes.
	Product failure		Replace the product
Display measurement unit cannot be changed.	Model Selection (model selected does not have unit conversion function)	Check if the product number printed on the product indicates Unit selection function type.	Unit selection function is not available for Fixed to SI units type. *: The unit conversion function is not for use in Japan due to a new measurement law. *: Unit fixed to SI:L/min
	Product failure		Replace the product
Buttons do not work	Key-lock mode is activated.	Check if the key-lock function is turned on.	Check the key-lock function.
	Product failure		Replace the product
There is noise.	Air leakage	Check if air is leaking from the piping.	Rework the piping. If the tightening torque is exceeded, the mounting screws and the switch may be damaged.
	Product failure		Replace the product



Error indication	Problem Possible causes	Investigation method	Countermeasure
The operation is unstable. (chattering)	Effect of line pressure fluctuation because hysteresis is too narrow.	Check the set flow rate (hysteresis).	Check the flow rate setting.
	Incorrect wiring/ broken lead wire	(1) Check the power supply wiring. (2) Check if there is bending stress applied to any part of the lead wire. (bending radius, tensile force to the lead wire)	(1) Check and correct the wiring. (2) Correct the wiring. (Reduce the tensile force or increase the bending radius.)
	Product failure		Replace the product

○Troubleshooting list (IO-Link communication)

Problem	Description	Problem possible causes	Investigation method	Countermeasures
	IO-Link indicator light ☑: OFF			
IO-Link indicator light ☑: Flashing	MODE ***	Communication is not established. IO-Link wiring failure	Check the connection and cable condition of the IO-Link cable.	Additionally tighten the IO-Link cable. (Replace the cable if it is broken.)
IO-Link indicator light ☑: Flashing	Er 15 V 10	IO-Link master and product version are not matched.	Check the IO-Link version of the master and device.	Align the master IO-Link version to the device. □ <sup>1</sup>
	MODE Start MODE PrtE	Communication mode is not transferred to the Operation mode.	Check the setting of the data storage access lock and data storage backup level of the master.	Release the data storage access lock. Or deactivate the setting of the data storage backup level of the master port.
Data is swapped by byte.	-	Program data assignment is incorrect.	Check that the Endian type on the master upper level communication transmission format is Big Endian type or Little Endian type.	Assign the program data based on the Endian type of the transmission format of the master upper level communication. Or set to the master byte swap setting. (Refer to page 72 for the Endian type of the upper level communication)

\*1: When the product is connected to the IO-Link master with version other than "V1.1", an error will be generated.

## ■ Error display

Error name	Error display	Description	Measures
Instantaneous flow error		Flow rate exceeding the upper limit of the settable flow range is applied.	Reset applied flow rate to a level within the settable flow range.
Over current error		The switch output load current is 60 mA or more.	Turn the power off and remove the cause of the over current. Then supply the power again.
System error		An internal data error has occurred.	Turn the power off and on again. If the failure cannot be solved, contact SMC.
	to		
Accumulated flow error		The accumulated flow has exceeded the accumulated flow range. (For accumulated increment)	Reset the accumulated flow. (Press the ▼ and S buttons simultaneously for <u>1 second or longer</u> )
		The accumulated flow has reached the set accumulated flow. (For accumulated decrement)	
Version does not match		Version of master and IO-Link does not match.	Align the master IO-Link version to the device.

\*: If the error cannot be reset after the above measures are taken, or errors other than above are displayed, please contact SMC.

# Specifications

Models		PF3A703H	PF3A706H	PF3A712H	
Fluid	Applicable fluid *1	Air, N <sub>2</sub>			
	Operating fluid temperature	0 to 50 °C			
Flow specifications	Detection method	Heating type sensor			
	Rated flow range	30 to 3000 L/min	60 to 6000 L/min	120 to 12000 L/min	
	Set point range	Instantaneous flow	30 to 3150 L/min	60 to 6300 L/min	120 to 12600 L/min
		Accumulated flow	0 to 999,999,999,990 L	0 to 999,999,999,900 L	
	Minimum resolution	Instantaneous flow	2 L/min	5 L/min	10 L/min
		Accumulated flow	10 L	100 L	
	Accumulated volume per pulse (Pulse width = 50 msec.)	Select from 100 L/pulse and 1000 L/pulse			
	Accumulated value hold *2	2 minutes or 5 minutes			
Pressure specifications	Rated pressure range	0.1 to 1.5 MPa			
	Proof pressure	2.25 MPa			
	Pressure loss	Refer to the pressure loss graph			
	Pressure Characteristics *3	±2.5%F.S. (0.1 to 1.0 MPa, 0.5 MPa standard)			
Electrical specifications	Power supply voltage	Used as switch output device	24 VDC ±10%		
		Used as IO-Link device	18 to 30 VDC ±10%		
	Current consumption	150 mA or less			
	Protection	Polarity protection			
Accuracy	Display accuracy	±3.0%F.S.			
	Analogue output accuracy	±3.0%F.S.			
	Repeatability	Display, switch output, analogue output: ±1.0%F.S.			
	Temperature characteristics	±5.0%F.S. (Ambient temp. 0 to 50 °C, 25 °C standard)			
Switch output	Output type	Select from NPN or PNP open collector output			
	Output mode	Selects one of the output (hysteresis or window comparator mode), the output for the accumulated flow, the accumulated pulse output, error output and switch OFF.			
	Switch operation	Normal or reversed output			
	Maximum load current	60 mA			
	Maximum applied voltage (Only NPN)	30 VDC			
	Internal voltage drop (Residual voltage)	1.5 V or less (Load current 60 mA)			
	Delay time *4	3.3 ms or less Variable at 0 to 60 s/0.01 step			
	Hysteresis *5	Variable			
	Protection	Over current protection			

Models		PF3A703H	PF3A706H	PF3A712H	
Analogue output *6	Output type		Voltage output: 1 to 5 V (0 to 10 V can also be selected *7), Current output: 4 to 20 mA		
	Impedance	Output voltage	Output impedance approx. 1 kΩ		
		Current output	Max. load impedance 600 Ω		
	Response time *8		Output with digital filter setting		
Ext. input *9	Input type		Input with no voltage: 0.4 V or less		
	Input mode		Select from the Reset of Accumulated Value, Reset Peak and Reset Bottom values		
	Time for input		30 ms or more		
Display	Reference condition *10		Normal or Standard condition		
	Unit *11	Instantaneous flow	L/min, cfm (ft <sup>3</sup> /min)		
		Accumulated flow	L, ft <sup>3</sup>		
	Display range *12	Instantaneous flow	0 to 3150 L/min (Displays 0 when the value is below 30 L/min.)	0 to 6300 L/min (Displays 0 when the value is below 60 L/min.)	0 to 12600 L/min (Displays 0 when the value is below 120 L/min.)
		Accumulated flow *13	0 to 999,999,999,990 L		
	Minimum display unit	Instantaneous flow	2 L/min	5 L/min	10 L/min
		Accumulated flow	10 L	100 L	
	Display		Display method: LCD Number of displays: 2 (main display and sub display) Colour (main display): Red and green Display colour (sub display): Orange Display (main display and sub display): 9 digits (7 segment 7digits, 11 segment 2 digits)		
	Operation LED		OUT LED: Orange is ON when output is ON		
	Digital filter *14		Select from 1 s/2 s/5 s		
Environmental resistance	Protection		IP65		
	Withstand voltage		1000 V AC for 1 minute between terminals and housing		
	Insulation resistance		50 MΩ between terminals and housing (with 500 VDC megger)		
	Operating temperature range		Operation: 0 to 50 °C, Storage: -10 to 60 °C (No condensation or freezing)		
	Operating humidity range		Operation, Storage: 35 to 85%RH (No condensation)		
Standards		CE/UKCA marked, UL (CSA)			
Piping	Piping specification		Rc1, NPT1, G1	Rc1 1/2, NPT1 1/2, G1 1/2	Rc2, NPT2, G2
Materials in contact with fluid		Aluminum alloy, PPS, HNBR (Sensor: Pt, Au, Ni, Fe, lead glass (not RoHS compliant), Al <sub>2</sub> O <sub>3</sub> )			
Lead wire with connector		3 m			
Weight	Piping port sizes	Rc	610 g	1190 g	1680 g
		NPT	610 g	1190 g	1680 g
		G	630 g	1220 g	1720 g
	Lead wire with connector		+90 g		


- \*1: The air quality class is according to JIS B 8392-1:2012 [6:6:4] and ISO8573-1:2010 [6:6:4].  
Use an air filter with 5 µm or less filtration rating on the inlet side.
- \*2: When using the accumulated value hold function, calculate the product life from the operating conditions, and use the product within its life. Maximum updating time of accumulated value is 1.5 million times.  
If the product is energized for 24 hours per day, the product life will be as follows:  
•Data memorized every 5 minutes --- 5 minutes x 1.5 million times = 7.5 million minutes = 14.3 years  
•Data memorized every 2 minutes --- 2 minutes x 1.5 million times = 3 million minutes = 5.7 years  
If the Accumulated Flow External Reset is repeatedly used, the product life will be shorter than calculated life.
- \*3: When the pressure range is 1.0 to 1.5 MPa. The pressure characteristics will be ±5%F.S. to the standard pressure of 0.5 MPa.  
Do not release the OUT side piping port of the product directly to the atmosphere without connecting piping. If the product is used with the piping port released to atmosphere, accuracy may vary.
- \*4: The time can be set from when the instantaneous flow reaches the set value, to when the switch output actually begins working.
- \*5: If the applied voltage fluctuates around the set value, the width for setting more than the fluctuating width needs to be set. Otherwise, chattering will occur.
- \*6: Analogue output or external input can be selected by pressing the buttons. Refer to the graph for analogue output.
- \*7: When selecting 0 to 10 V, refer to the analogue output graph for the allowable load current.
- \*8: The time from when the flow is changed as a step input (when the flow rate changes from 0 to the maximum flow instantaneously) until the analogue output reaches 90% of the rated flow rate.
- \*9: Analogue output or external input can be selected by pressing the buttons.
- \*10: The flow rate given in the specification is the value at standard condition (STD).
- \*11: Setting is only possible for models with the unit selection function.
- \*12: Displayable range change based on the setting of zero cut-off function.
- \*13: Upper 6 digits are displayed and  $\times 10^3$  or  $\times 10^6$  or  $\times 10^9$  turns on for accumulated flow rate.
- \*14: Set the time for digital filter to the sensor input. The response time indicates when the set value is 90% in relation to the step input.
- \*15: Any products with tiny scratches, smears, or display colour variation or brightness which does not affect the performance are verified as conforming products.

#### Cable specification for M12 connector and lead wire (ZS-37-A)


Item		Specifications
Conductor	Nominal cross section	AWG23
Insulator	O.D.	Approx. 1.1 mm
	Colours	Brown, blue, black, white
Sheath	Finish O.D.	ø4

## ■ Characteristics data

### ● Flow rate/ Analogue output

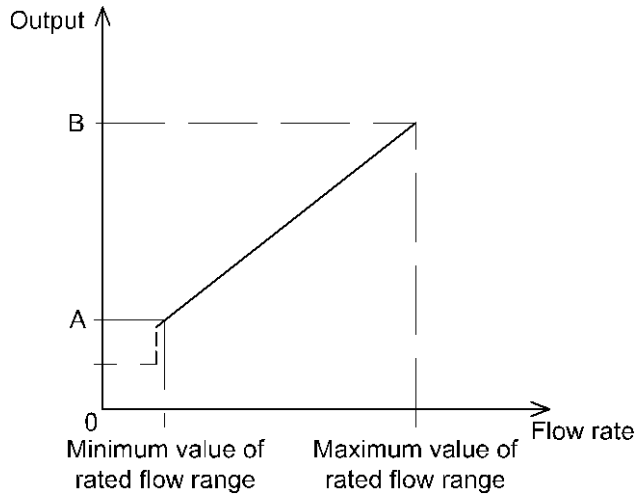

	0 L/min	A *2	B
Voltage output (1 to 5 V) *1	1 V	1.04 V	5 V
Current output *1	4 mA	4.16 mA	20 mA

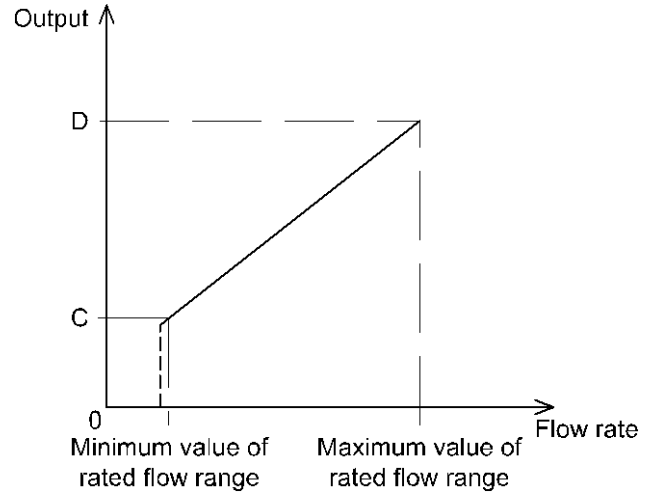

	0 L/min	C *2	D
Voltage output (0 to 10 V) *1, *3	0 V	0.1 V	10 V

Models	Minimum value of rated flow range *4	Maximum value of rated flow range
PF3A703H	30 L/min	3000 L/min
PF3A706H	60 L/min	6000 L/min
PF3A712H	120 L/min	12000 L/min

\*1: Analogue output accuracy is within  $\pm 3\%$ F.S.

\*2: A and C change based on the setting of zero cut-off function.


\*3: Set the current to the analogue output from the connected equipment to 20  $\mu$ A or less when selecting 0 to 10 V.

When 20  $\mu$ A or more current flows, it is possible that the accuracy is not satisfied in the area at 0.5 V or lower.


\*4: The minimum value of the rated flow range changes based on the setting of zero cut-off function.

• Pressure loss (reference value)


• PF3A703H (For 3000 L/min)

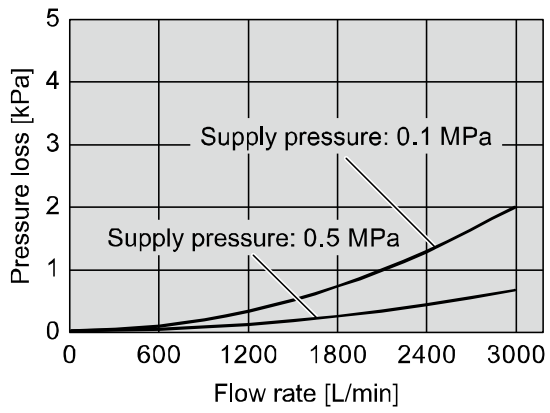

• PF3A706H (For 6000 L/min)

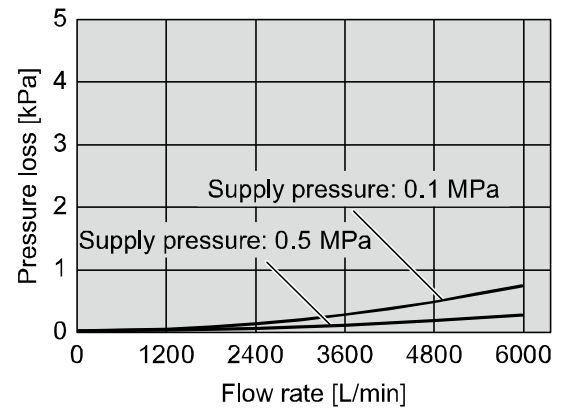

• PF3A712H (For 12000 L/min)

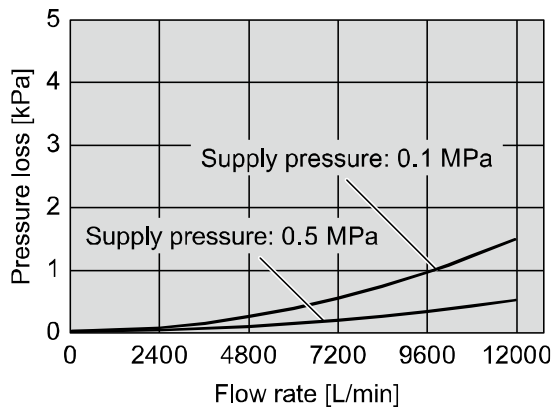

- IN side straight pipe length and accuracy (reference value)



- Do not connect equipment or piping which may generate a fluctuation in the flow or drift at the IN side of the product.

When installing the regulator at the IN side of the product, make sure that hunting is not generated.


- The piping on the IN side must have a straight section of piping whose length is 8 times the piping I.D. or more.

If a straight section of piping is not installed, the accuracy varies by approximately  $\pm 3\%$  or more.


\*: "Straight section" means a part of the piping without any bends or rapid changes in the cross sectional area.

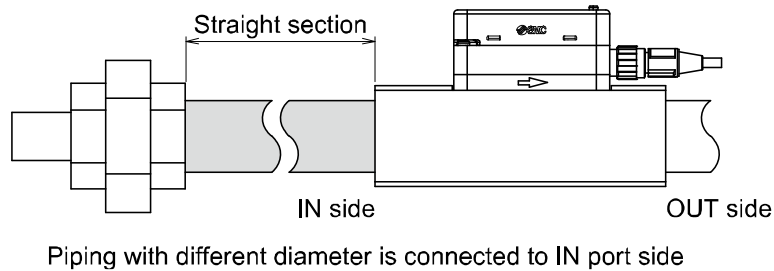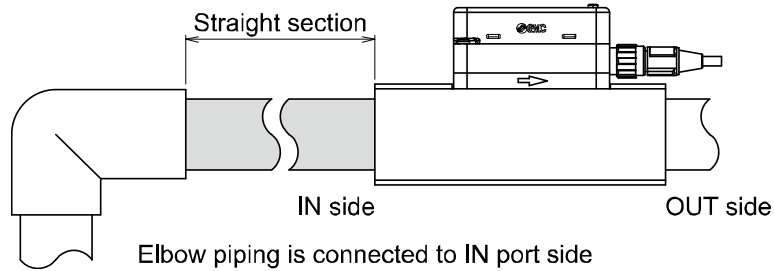


- PF3A703H (For 3000 L/min)

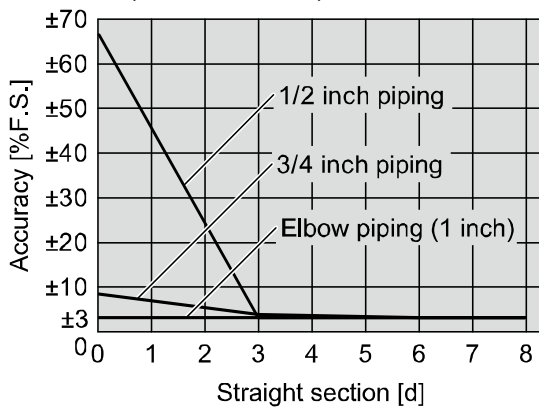

- PF3A706H (For 6000 L/min)

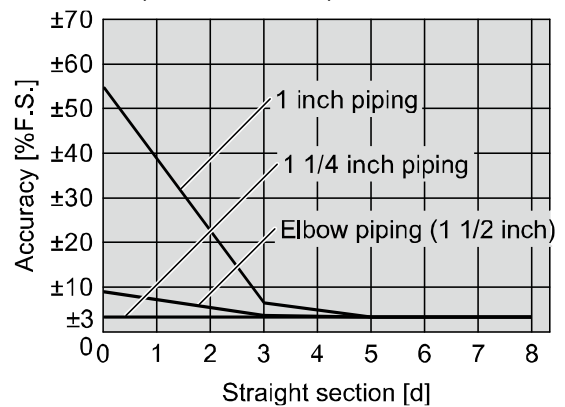


- PF3A712H (For 12000 L/min)

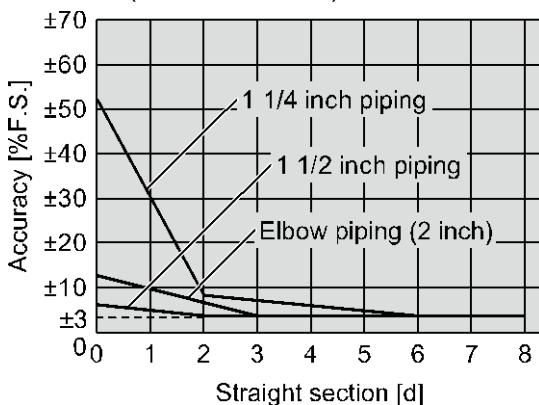




## ■Dimensions

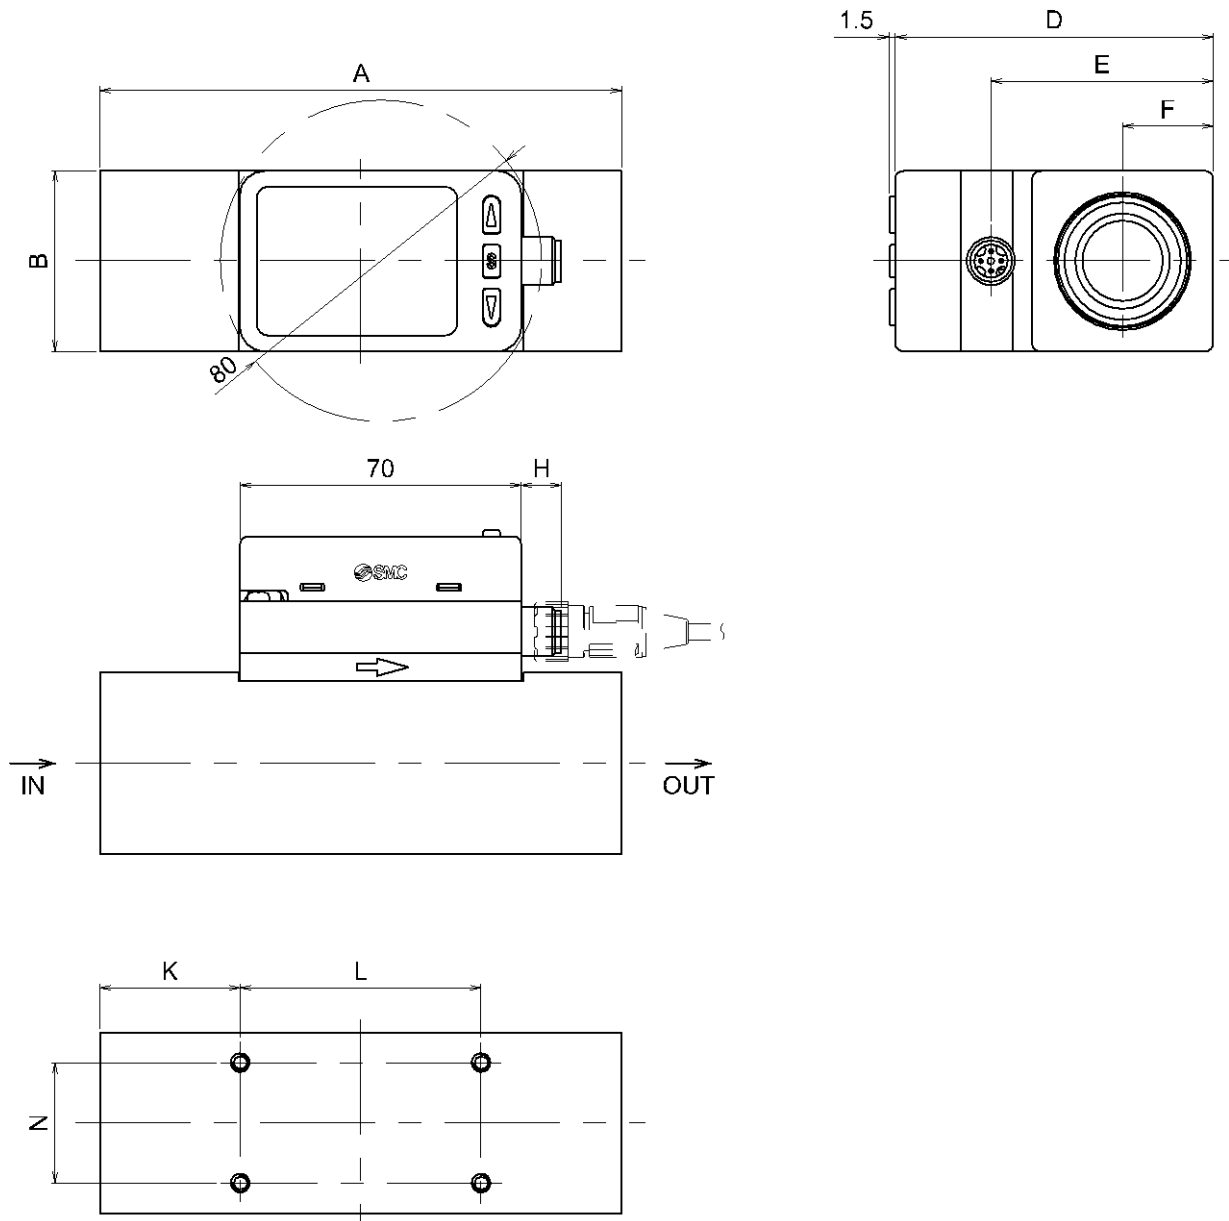

Symbol	A	B	D	E	F	H	K	L	N	
Models										
PF3A703H	130	45	79.1	55.3	22.5	25	35	60	30	4 x M4 x 0.7 depth 7
PF3A706H	170	60	94.1	70.3	30	68	45	80	40	4 x M5 x 0.8 depth 8
PF3A712H	200	70	104.1	80.3	35	85	50	100	50	4 x M6 x 1.0 depth 9


Lead wire with M12 connector (ZS-37-A)

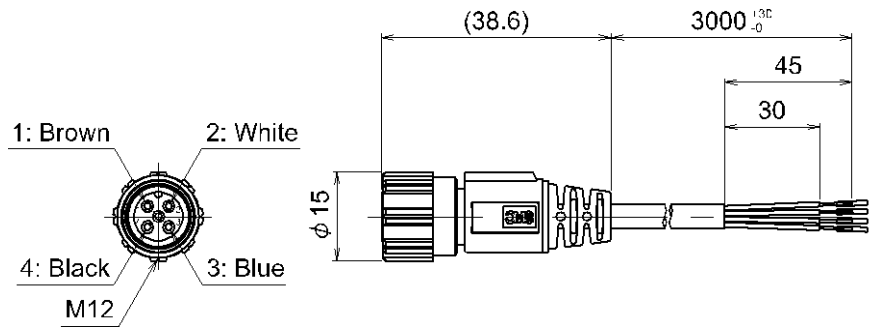

Pin number	Description	Colour
1	DC(+)	Brown
2	FUNC	White
3	DC(-)	Blue
4	OUT	Black

\*: 4-wire lead wire with M12 connector for PF3A series.

Lead wire with M12 connector (ZS-49-A)

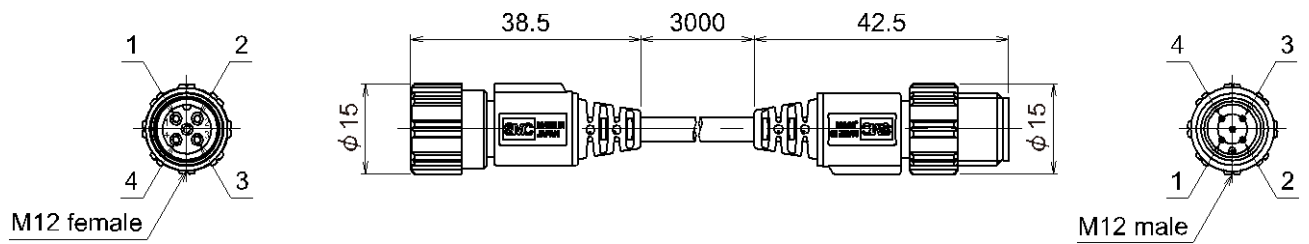

M12 female Pin number	Description	M12 male Pin number
1	L+	1
2	N.C. or Other	2
3	L-	3
4	C/Q	4

#### Revision history

A: Contents revised in several places.  
[August 2022]  
B: Contents revised in several places.  
[December 2022]  
C: Contents revised in several places.  
[November 2023]  
D: Contents revised in several places.  
[May 2024]  
E: Contents revised in several places.  
[October 2024]

## SMC Corporation

Tel: + 81 3 5207 8249 Fax: +81 3 5298 5362

URL <https://www.smcworld.com>

---

Note: Specifications are subject to change without prior notice and any obligation on the part of the manufacturer.  
© SMC Corporation All Rights Reserved

