

3-Screen Display Condensation Checker (Digital Temperature & Humidity Switch)

New
CE UK
CA

RoHS IP65
IO-Link

New A relative humidity under pressure (inside piping) display function has been added.

Visualisation of relative humidity

Real-time monitoring

Digital display

Main display	
Relative humidity (Atmospheric pressure/Under pressure)	
Sub display From page 5	
Temperature, set value, atmospheric pressure relative humidity, relative humidity under pressure, etc.	



* A variety of display options can be selected via the F10 function selection mode.

Relative humidity
[% R.H.]

Display/Setting range	0 to 100
Display accuracy	±5 % R.H. ±1 digit


Temperature
[°C]

Display/Setting range	-5 to 55
Display accuracy	±3°C ±1 digit

* La precisión es con respecto a la humedad relativa a presión atmosférica.

Remote/Condition monitoring

Remote confirmation via switch output preventing condensation problems!

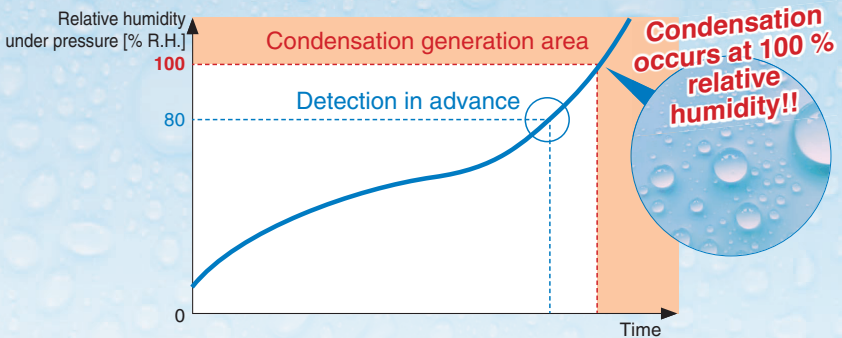

Protect important equipment from moisture.

Malfunction of air blowers/air drivers

Generation of water droplets

Equipment failure and frequent replacement

Malfunction of valves and actuators due to dripping grease

Reduced dryer dehumidification performance

High load on the dryer in summer

PSH Series



CAT.EUS100-161Aa-UK

Condensation problem inside piping

Case 1 Although a dryer was installed...

Summer ambient temperature
Increased outlet side consumption flow rate
Pressure drop

Drop in dryer processing capacity → **Condensation generated**

Case 2 Although a dryer was installed for dehumidifying purposes...

Degradation of film module
Increased outlet side consumption flow rate

Drop in dryer processing capacity → **Condensation generated**

Case 3 Although a line filter or mist separator was installed...

Passage of water vapour (gas)

Water droplets can be removed, but water vapour cannot be removed and remains. → **Condensation generated**

A condensation checker can prevent such problems!

- Allows for the **visualisation** of humidity inside piping
Detects abnormalities prior to condensation generation
- Can be easily connected to any pipe you want to monitor
Compact size allows for easy installation





- Aids in preventing condensation problems in advance
- Aids in dryer selection and installation as well as in gauging replacement timing
- Easy installation, Space saving



Water resistant!

Measurement with stable accuracy is possible even when it is humid inside the piping!

Measures the status of humidity inside the piping (under pressure) as **relative humidity under atmospheric pressure after depressurising to atmospheric pressure**

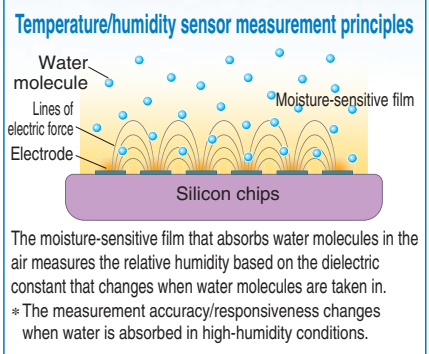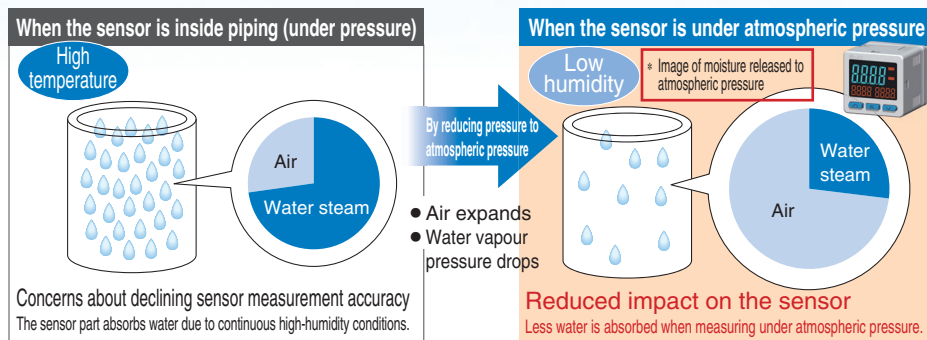

* The atmospheric pressure relative humidity value displayed is lower than that of the relative humidity inside piping (under pressure). For the relative humidity conversion method, refer to "Set value (threshold value) setting" on page 3.

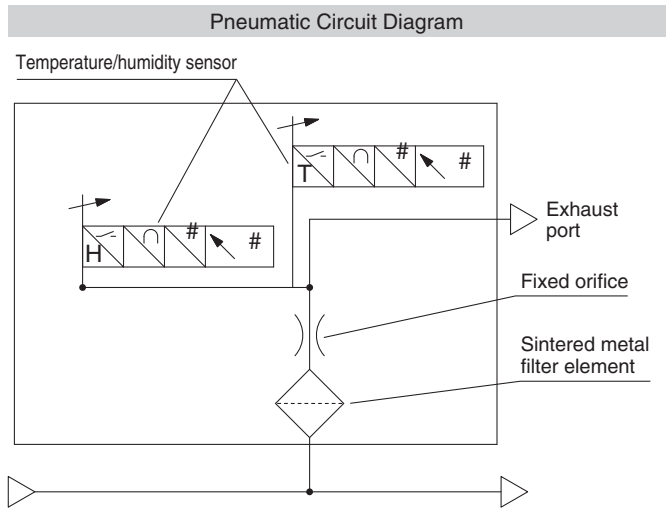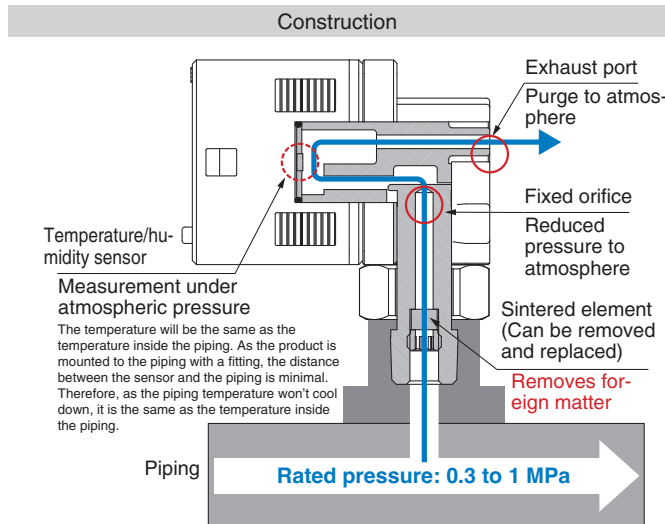

Application Example

● For problems with condensation, water droplets, and dehumidification in general pneumatic systems


Malfunction of air blowers/air drivers

Generation of water droplets



Equipment failure and frequent replacement

Malfunctioning of valves and actuators caused by dripping grease



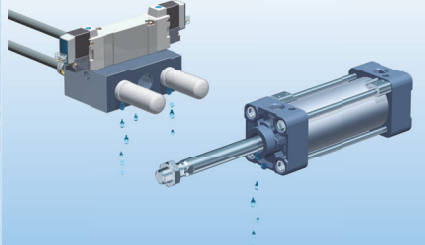


The outflow of drain to the outlet side

Decomposition of auto drain caused by rusting inside pipes




For when water droplets adhere to workpieces due to air blow

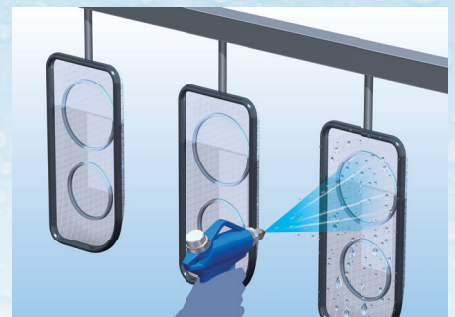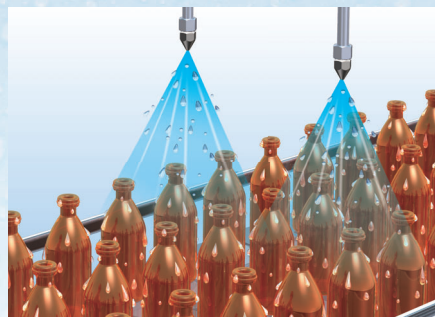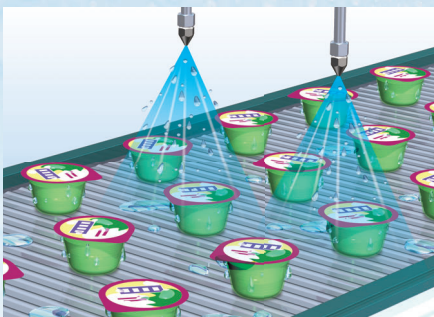

● Machine tools

For bearing oil air control


Prevents bearing seizure and damage due to poor lubrication

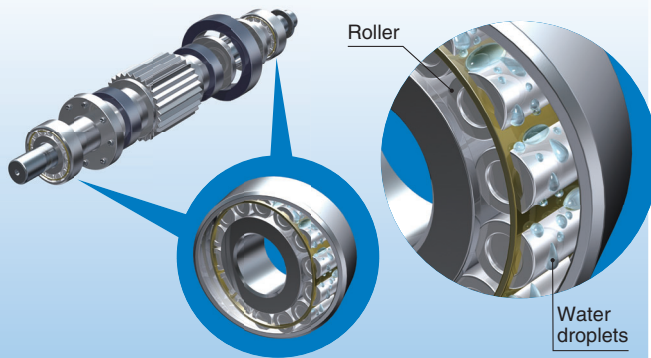

For linear scale purge air control

Reduces optical sensor lens contamination and measurement accuracy failure


Optical sensor

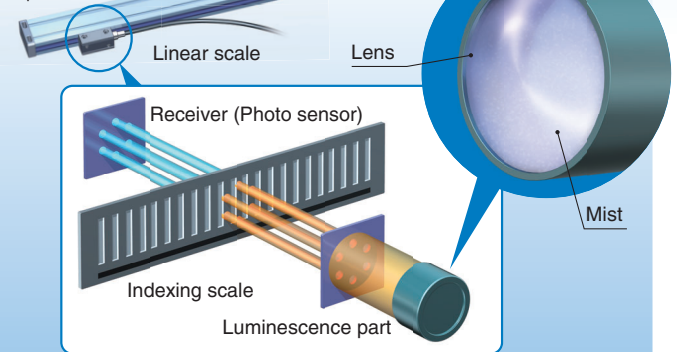

● Laser related equipment

For machining head purge air control


Reduces laser machining head lens fogging and machining defects

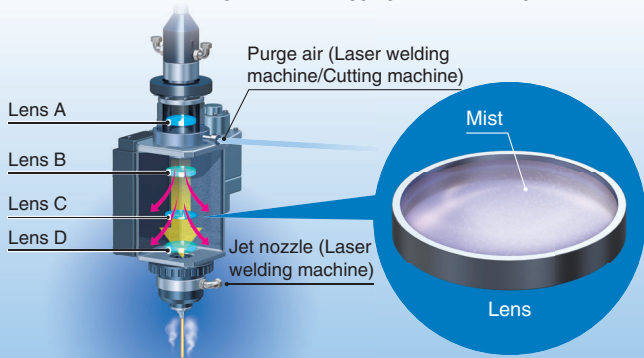

● Food processing machines

For the control of blow air when opening packaging bags

Reduces mold generation due to water contamination

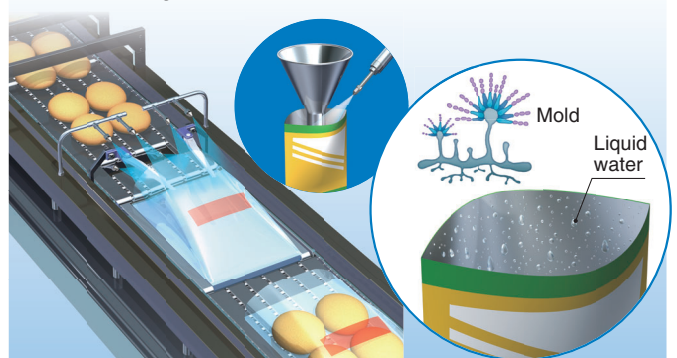

Set value (threshold value) setting

Relative humidity under pressure-atmospheric pressure relative humidity (Simple conversion tables)


The relative humidity inside the piping (under pressure) and the atmospheric pressure relative humidity can be converted as shown below so long as the temperature inside the piping (measured via the condensation checker) and the atmospheric pressure (ambient) temperature are the same.

The relative humidity under pressure display function allows for the relative humidity according to the set pressure value to be converted as shown below.

Conversion magnification list

Operating pressure [MPa]	Magnification	
	Under pressure → Atmospheric pressure	Atmospheric pressure → Under pressure
0.3	1/4	4
0.35	1/4.5	4.5
0.4	1/5	5
0.45	1/5.5	5.5
0.5	1/6	6
0.7	1/8	8
0.9	1/10	10

* For more information on the simple conversion formula, refer to the technical data on page 15.

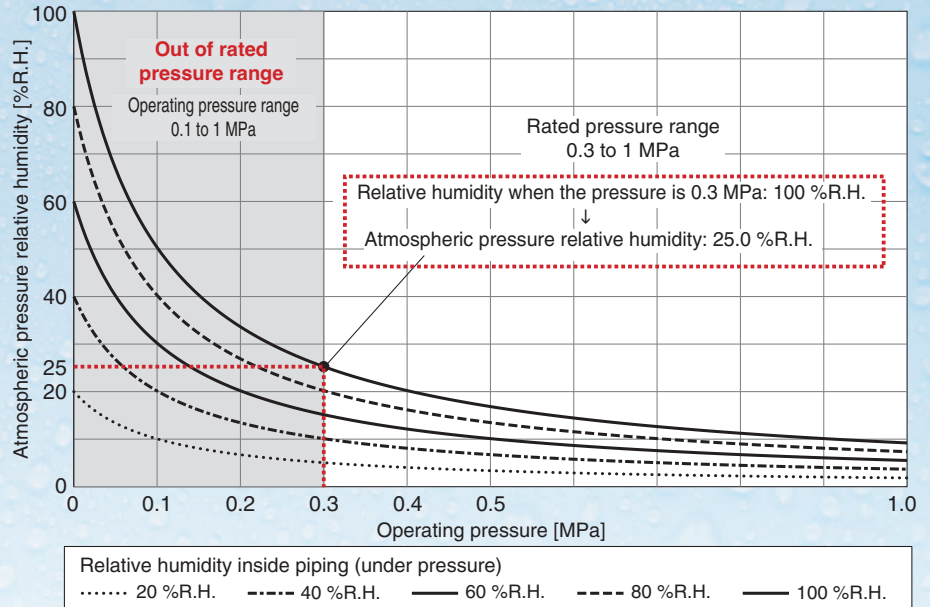

Model Selection Software Humidity conversion/condensed water (drain) calculation software

Supports conversion related to humidity for humidity control

- When the temperature inside piping differs from the atmospheric pressure (ambient) temperature
- Dew point to relative humidity or relative humidity to dew point conversion

Refer to the SMC website before use.

Example of air blow/purge air humidity abnormality detection

* When releasing air blow/purge air from inside piping (under pressure) to a component (atmosphere)



Setting the set value (threshold value) allows for condensation generation to be detected in advance!

Condensation is generated (When the relative humidity inside piping is 100 %R.H.)

Relative humidity
 Inside piping (under pressure) : 100.0 %R.H.
 Atmospheric pressure (Condensation checker) : 20.0 %R.H.

Condensation generation is prevented (Detection when the relative humidity inside piping is 80 %R.H.)

Relative humidity
 Inside piping (under pressure)*1: When the under pressure value is displayed and the threshold value is 80.0 %R.H.
 Atmospheric pressure: When the atmospheric pressure value is displayed and the threshold value is 16.0 %R.H.
 *1 Calculated value

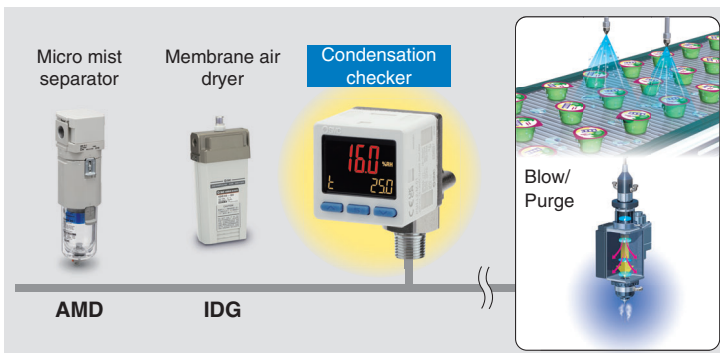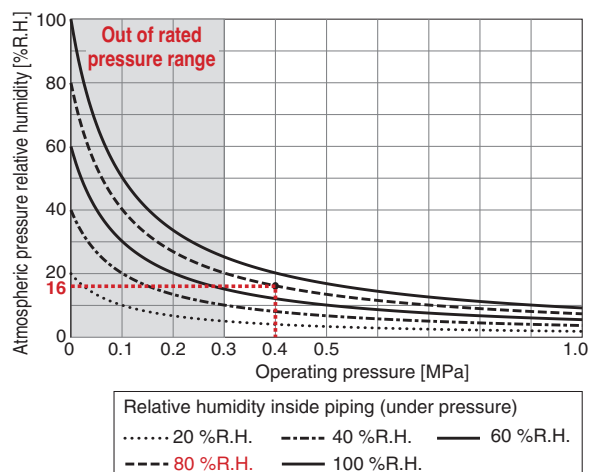

Example of operating conditions

Operating pressure : 0.4 MPa
 Temperature inside piping : 25 °C (Measured by the condensation checker)
 Ambient temperature : 25 °C

- * Due to the 0.4 MPa operating pressure, the atmospheric pressure relative humidity is 5 times (1/5 times) the relative humidity inside piping.
- * When the temperature inside piping and the atmospheric pressure (ambient) temperature are the same

Detection example of when the refrigerated air dryer humidity is abnormal

* When the processing capacity of the refrigerated air dryer drops

Setting the threshold value allows for the detection of an abnormality before condensation is generated!

Normal conditions Pressure dew point : 10 °Cdp (IDFA specification)


Relative humidity Inside piping (under pressure) : 52.5 % R.H.
Atmospheric pressure (Condensation checker) : 8.8 % R.H.

Dryer processing capacity drop

Abnormal conditions Pressure dew point: Equivalent to 20 °Cdp (Pressure dew point = ambient temperature)

Relative humidity Inside piping (under pressure)*1: When the under pressure value is displayed and the threshold value is 100.0 %R.H.
Atmospheric pressure: When the atmospheric pressure value is displayed and the threshold value is 16.7 %R.H.


*1 Calculated value

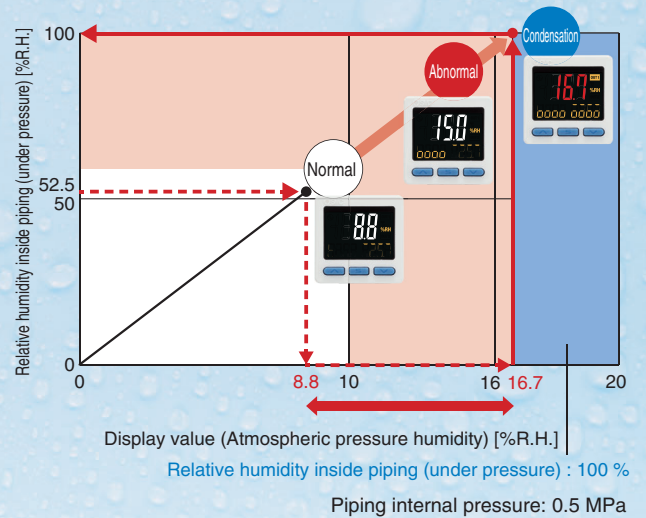

Example of operating conditions

Operating pressure : 0.5 MPa
Temperature inside piping : 20 °C (Measured by the condensation checker)
Ambient temperature : 20 °C

* Due to the 0.5 MPa operating pressure, the atmospheric pressure relative humidity is 6 times (1/6 times) the relative humidity inside piping.
* When the temperature inside piping and the atmospheric pressure (ambient) temperature are the same

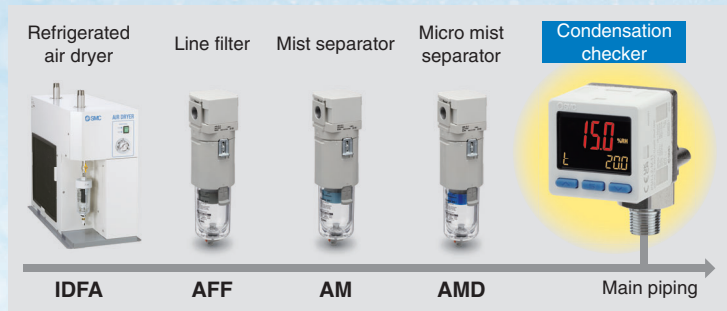

Example of deciding to install a membrane air dryer and confirming the effectiveness

* When installing a membrane air dryer after confirming like likelihood of condensation/water droplet generation

Visualisation of the effectiveness of the membrane air dryer is possible via the condensation checker!

(Be sure to take the pressure dew point/operating pressure and the accuracy of the condensation checker's atmospheric pressure relative humidity into consideration.)

Current situation * There is a likelihood of condensation generation when the relative humidity in piping is 80 %R.H.

Relative humidity Inside piping (under pressure) : 80.0 %R.H.
Atmospheric pressure : 20.0 %R.H.
Pressure dew point*1 : 16.4 °Cdp

Installation of membrane air dryer


Benefits * Relative humidity in piping : 32.4 %R.H. ← 80 %R.H.

Relative humidity Inside piping (under pressure)*1: When the under pressure value is displayed and the threshold value is 32.4 %R.H.
Atmospheric pressure: When the atmospheric pressure value is displayed and the threshold value is 8.1 %R.H.
Pressure dew point*1: 3.0 °Cdp

*1 Calculated value

Caution

This product's ability to detect low dew points is limited.
If measurement of the exact dew point is required, use a dew point meter.

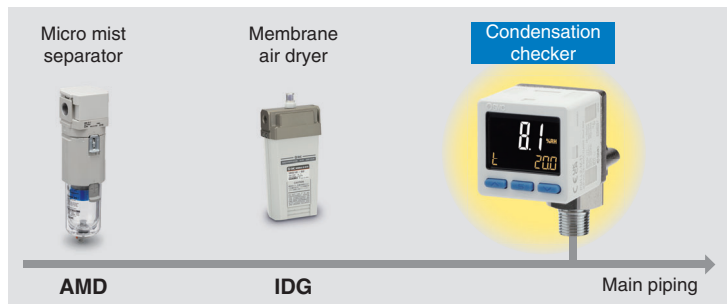

Example of operating conditions

Operating pressure : 0.3 MPa
Temperature inside piping : 20 °C (Measured by the condensation checker)
Ambient temperature : 20 °C


* Due to the 0.3 MPa operating pressure, the atmospheric pressure relative humidity is 4 times (1/4 times) the relative humidity inside piping.
* When the temperature inside piping and the atmospheric pressure (ambient) temperature are the same

When the temperature inside the piping (measured via the condensation checker) and the atmospheric pressure (ambient) temperature are different

* For more information on calculation methods, refer to "Changes in temperature inside piping" in the technical data on page 16.

Example of membrane air dryer high humidity status confirmation

Visual confirmation
Confirmation via colour Operator confirmation

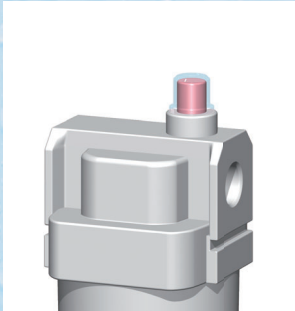


Numerical confirmation
Confirmation via output Constant monitoring



Simple 3-Step Setting

When the SET button is pressed and the set value (P_1) is being displayed, the set value (threshold value) can be set. When the SET button is pressed and the hysteresis (H_1) is being displayed, the hysteresis value can be set.

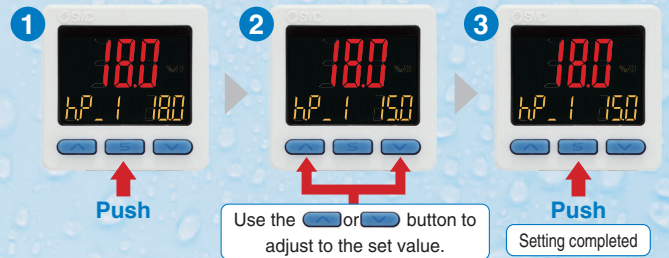

Items for 3-step setting (Sub-display)
OUT1 set value/hysteresis, OUT2 set value/hysteresis, Operating pressure set value

Relative humidity under pressure display function

By inputting the operating pressure, the calculation and display of the relative humidity under pressure from the atmospheric pressure relative humidity is possible.

* When the temperature inside the piping and the condensation checker display temperature are different, correction of the display value is required.


Switching between atmospheric pressure relative humidity display and relative humidity under pressure display is possible.



Visualisation of set items/status (sub-display)

The display can be switched via the up and down buttons. The following are display examples.

*1 3-step setting is possible.

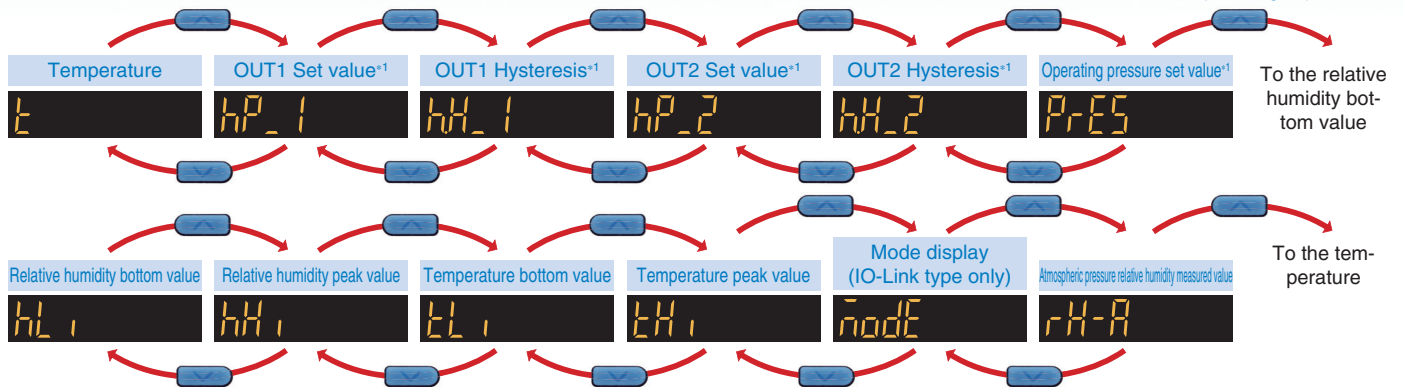


Level bar display

The level bar shows the difference from the set value.

● Relative humidity inside piping (under pressure)

○ Atmospheric pressure relative humidity (Condensation checker display)

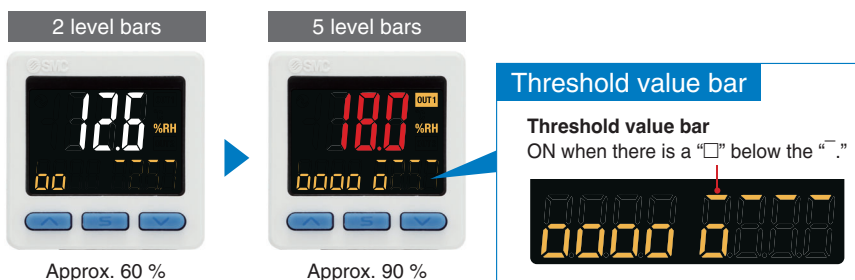


* When the piping internal pressure is 0.4 MPa, the temperature inside piping and the atmospheric pressure (ambient) temperature are set to 25 °C, and the set value (threshold value) is 90 %


Analogue free span

The analogue span point (5 V) can be set between 10 and 100 % R.H.

Example For relative humidity

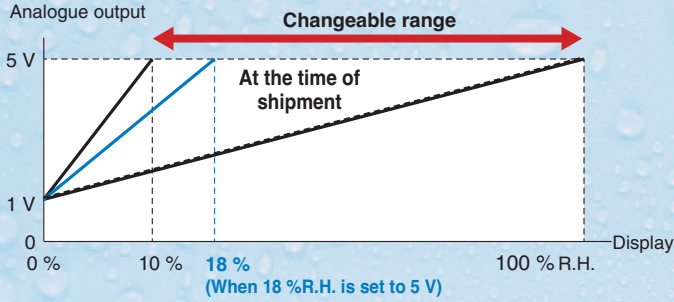

Relative humidity ↔ Temperature (Switchable)

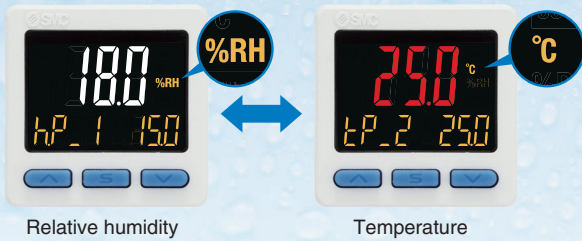

Main screen	Temperature ↔ Relative humidity (Atmospheric pressure/Under pressure)
OUT1	Temperature ↔ Relative humidity (Atmospheric pressure/Under pressure)
OUT2	Temperature ↔ Relative humidity (Atmospheric pressure/Under pressure)
Analog output	Temperature ↔ Relative humidity (Atmospheric pressure/Under pressure)

* Switching between atmospheric pressure relative humidity display and relative humidity under pressure display is possible via function selection mode (F0).

2-colour display type

The abnormal condition can be confirmed at a glance by the change in colour.



NPN/PNP switching function

A single unit supports both NPN and PNP. Therefore, the number of items to keep in stock can be reduced.

Press the "UP" or "DOWN" key to select the switch output specification.








CONTENTS

3-Screen Display Condensation Checker (Digital Temperature & Humidity Switch) PSH Series



How to Order	p. 7
Accessories Part Number	p. 7
Specifications	p. 8
Settable Range	p. 10
Internal Circuits and Wiring Examples	p. 11
Dimensions	p. 12
Technical Data	p. 15
Safety Instructions	Back cover


3-Screen Display  IO-Link    

Condensation Checker (Digital Temperature & Humidity Switch)

PSH Series



How to Order

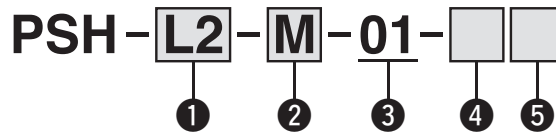

1 Output specification

Symbol	Description*1	At the time of factory shipment*2 (Relative humidity under pressure display)
L2	IO-Link/Switch output 1 + Switch output 2 (Switch output: NPN or PNP switching type)	OFF
LL		ON
RT	Switch output 1 + Switch output 2 + Analogue voltage output (Switch output: NPN or PNP switching type)	OFF
RR		ON


*1 Switch output 1/2, analog voltage output can be set to relative humidity or temperature.
 *2 The display mode at the time of factory shipment is different, but the product specifications are the same.

2 Units specification




Symbol	Description
—	Units selection function
M	SI units only*1

*1 Fixed units: % R.H., °C

3 Piping specification




Symbol	Description
01	R1/8 

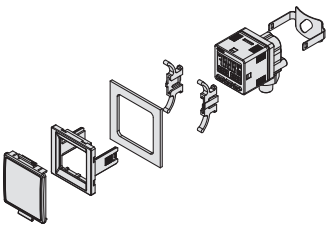5 Option 2

Symbol	Description	
—	None	
A	Bracket	 ZS-55-A
B	Panel mount adapter	 ZS-55-B
D	Panel mount adapter + Front protection cover	 ZS-55-D

* When mounting with a panel mount adapter, there are conditions that need to be met for UL compliance. For details, refer to the operation manual.



4 Option 1

Symbol	Description	
—	None	
W	Lead wire with connector (2 m, Waterproof)	 ZS-46-5F
V	Lead wire with connector (2 m, Waterproof, With connector mold cover (straight))	 ZS-46-5F-X525
R	Lead wire with connector (2 m, Waterproof, With connector mold cover (right angle))	 ZS-46-5F-X526

* When "V" is selected for option 1, the panel mount adapter cannot be used.

Accessories Part Number

When an accessory is required separately, order using the part number listed below.

Description	Part no.	Note
Bracket	ZS-55-A	—
Panel mount adapter	ZS-55-B	—
Panel mount adapter + Front protection cover	ZS-55-D	—
Lead wire with connector	ZS-46-5F	5-core, 2 m, Waterproof
Lead wire with M12 connector*1	ZS-46-5FM12	
Lead wire with connector + With connector cover	ZS-46-5F-X472	M12-4 pin, Waterproof Connector size M12  Sheath O.D. Ø 3.5
Lead wire with connector + With connector mold cover (straight)	ZS-46-5F-X525	5-core, 2 m, Waterproof
Lead wire with connector + With connector mold cover (right angle)	ZS-46-5F-X526	5-core, 2 m, Waterproof
Front protection cover	ZS-35-01	—
Sintered metal filter element	EBD-3.8-3-2	Min. purchase quantity: 10 pcs.

*1 Analogue voltage output is not available.

Refer to the operation manual on the SMC website for the "Specific Product Precautions."

Specifications

Model		PSH	
Applicable fluid		Air, Non-corrosive gas JIS B 8392-1 1.1.2 to 1.6.2, ISO 8573-1 1.1.2 to 1.6.2	
Temperature	Rated temperature range	0 to 50 °C	
	Display and Set temperature range	-5 to 55 °C	
	Display and minimum settable increment	0.1 °C	
Relative humidity	Display and Set relative humidity range	0 to 100 % R.H. (No condensation)	
	Display and minimum settable increment	0.1 % R.H.*4	
Pressure	Rated pressure range	0.3 to 1 MPa	
	Operating pressure range	0.1 to 1 MPa	
	Minimum unit setting	0.001 MPa	
Flow rate consumption		5 l/min (Pressure: 1 MPa) (Reference: Approx. 3 l/min or less at 0.3 MPa)	
Power supply	Power supply voltage	18 to 30 VDC (Including ripple)	
	Current consumption	35 mA or less	
	Protection	Polarity protection	
Accuracy*1, *2	Temperature	Display accuracy	±3 °C ±1 digit
		Analogue output accuracy*3	±3.5 °C
	Relative humidity	Display accuracy	±5 % R.H. ±1 digit*5, *6
		Analogue output accuracy*3	±5.5 % R.H.
Switch output	Output type	Select from NPN or PNP open collector output.	
	Output mode	Hysteresis mode, Window comparator mode, Error output	
		Output OFF	
	Switch operation	Normal output, Reversed output	
	Max. load current	10 mA	
	Max. applied voltage (NPN only)	30 V	
	Internal voltage drop (Residual voltage)	1.5 V or less (at load current of 10 mA)	
	Hysteresis	Hysteresis mode	Variable from 0
Window comparator mode			
Short circuit protection	Yes		
Analog output	Output type	1 to 5 V*7	
	Output impedance	Approx. 1 kΩ	
Digital filter		0.0 to 60.00 s (0.01 increments)*8	
Display	Units	°C, °F, % R.H.	
	Display type	LCD	
	Number of screens	3-screen display (Main screen, Sub screen x 2)	
	Display colour	1) Main screen: White/Red	
		2) Sub screen: Orange	
	Number of display digits	1) Main screen: 3 1/2 digits, 7 segments	
2) Sub screen: 4 digits, 7 segments			
Indicator light	Light is ON when switch output is ON. OUT1, OUT2: Orange		
Environmental resistance	Enclosure rating	IP65	
	Withstand voltage	1000 VAC for 1 min between terminals and housing	
	Insulation resistance	50 MΩ or more (using 500 VDC Mega) between terminals and housing	
	Ambient temperature range	Operating: 0 to 50 °C, Storage: -10 to 60 °C (No condensation or freezing)	
Ambient humidity range	Operating, Storage: 35 to 85 % R.H. (No condensation)*9		
Standards		CE/UKCA (EMC and RoHS directive), UL/CSA (E508758)	
Length of lead wire with connector		2 m	

*1 This is the overall accuracy, including the effects of factors such as temperature and repetition.

*2 Applicable only when using within the rated pressure range.

*3 When using a product with an analog output function. Select temperature or relative humidity using the settings.

*4 When the relative humidity under pressure is displayed, it is 1 %R.H.

*5 The accuracy is relative to the atmospheric pressure relative humidity.

The relative humidity display of the relative humidity under pressure is a calculated value that includes errors in operating pressure and air pressure.

*6 When using within the rated pressure range. The range in which relative humidity can change under atmospheric pressure changes depending on the operating pressure.

For details, refer to page 10. If the product is used outside the rated pressure range, the accuracy is not guaranteed.

*7 Relative humidity: 1 to 5 V output for 0 to 100 % R.H. Temperature: 1 to 5 V output for 0 to 50 °C.

*8 This is the 90 % response time to a step input in the internal sensor signal.

*9 Do not store in airtight conditions without air exchange.

* If the piping contains gases such as oil mist or organic solvents, it may not be possible to meet the specified accuracy or it may cause a malfunction.

* Although SMC strive to improve quality, products are considered to be of good quality if there are slight scratches, dirt, display colour, uneven brightness, etc. on the exterior that do not affect the performance.

Specifications

Piping Specifications and Weights

Model		PSH
Port size		R1/8
Materials in contact with fluid	Sensor pressure receiving area	Silicon, etc.
	Piping port	SUS303, CAC403, C3604 (Electroless nickel plating), ZDC2 (Nickel plating)
		Glass-fibre epoxy resin
		O-ring: EPDM, FKM
Weight	Body	103 g
	Lead wire with connector	+39 g (For option 1: W), +40 g (For option 1: V, R)

Cable Specifications

Conductor cross section		0.15 mm ² (AWG26)
Insulator	Outside diameter	1.0 mm
	Colour	Brown, Blue, Black, White, Grey (5-core)
Sheath	Outside diameter	Ø 3.5

Communication Specifications (For IO-Link)


IO-Link type	Device															
IO-Link version	V1.1															
Communication speed	COM2 (38.4 kbps)															
Configuration file	IODD file*1															
Minimum cycle time	3.8 ms															
Process data length	Input data: 6 bytes, Output data: 0 bytes															
On request data communication	Supported															
Data storage function	Supported															
Event function	Supported															
Vendor ID	131 (0 x 0083)															
Device ID	PSH-L2 (-M)-*: 728 (0x0002D8) PSH-LL (-M)-*: 729 (0x0002D9)															
Process data	Bit	47...32														
	Item	Relative humidity measurement value (16-bit signed integer)														
	Bit	31...16														
	Item	Temperature measurement value (16-bit signed integer)														
	Bit	15	14	13	12 to 11	10	9	8	7	6	5	4	3	2	1	0
	Item	System error diagnostic	Error diagnostic	Fixed output	0	Relative humidity under pressure display	Temperature diagnostic	0				Temperature SW2	Temperature SW1	Relative humidity SW2	Relative humidity SW1	

*1 The configuration file can be downloaded from the SMC website, <https://www.smc.eu>


Settable Range

The settable range is the range within which the switch output can be set.

Settable Temperature Range

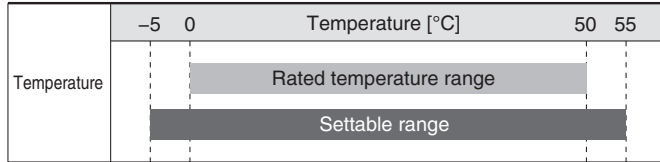

Settable Relative Humidity Range

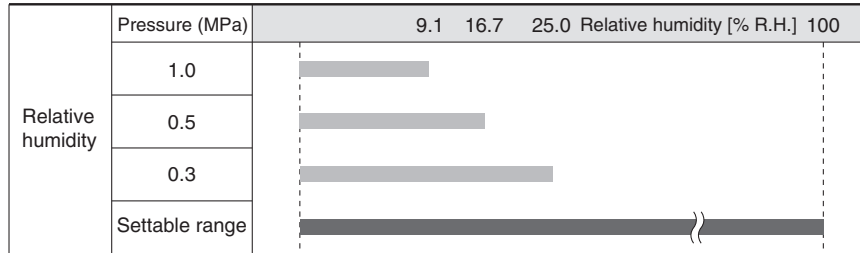

The range of atmospheric pressure and relative humidity that the condensation checker can measure changes depending on the pressure inside the piping (under pressure). For example, if the pressure inside the pipe (under pressure) is 0.3 MPa and the relative humidity is 100 % (maximum value), the atmospheric pressure relative humidity when released into the atmosphere will be 25.0 %R.H..


If the pressure inside the pipe (under pressure) is 0.3 MPa, the measurable range of the condensation checker is 25.0 %R.H..

Atmospheric pressure relative humidity $\pm 5\%$ is guaranteed only when used within the rated pressure range (0.3 to 1.0 MPa).


Relationship between displayed value (atmospheric pressure relative humidity) and relative humidity inside piping (under pressure)

* When the temperature inside piping and the atmospheric pressure (ambient) temperature are the same


When the piping internal pressure is 0.3 MPa

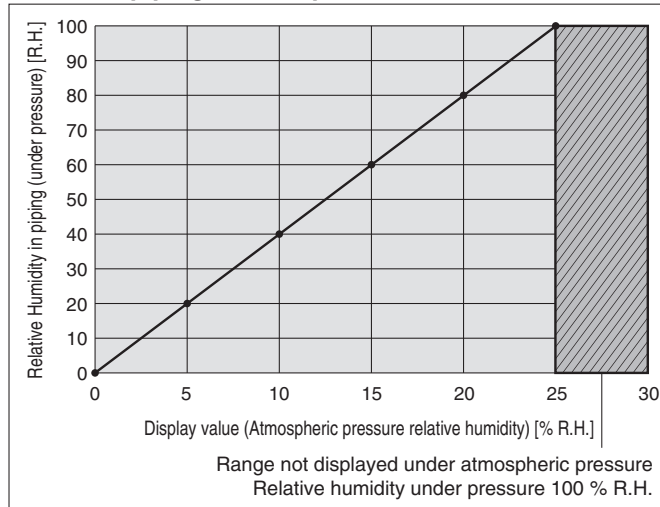


When the piping internal pressure is 0.7 MPa

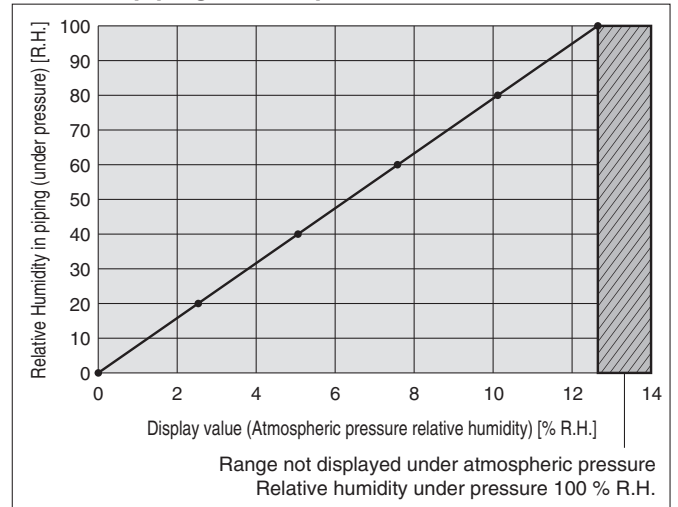

When the piping internal pressure is 0.5 MPa

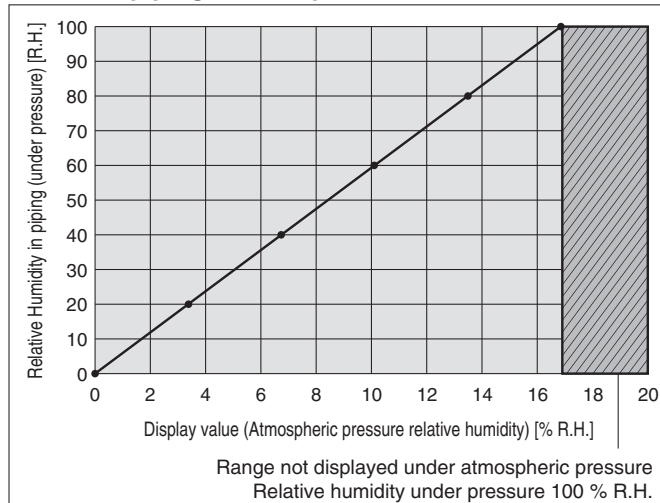


When the piping internal pressure is 0.9 MPa

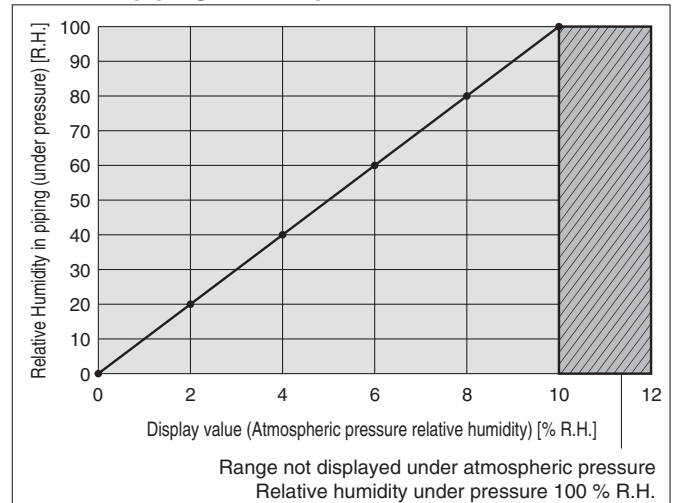


Internal Circuits and Wiring Examples

-L2/-LL: IO-Link/Switch output 1 + Switch output 2
 When used as a switch output device


Setting of NPN open collector 2 outputs

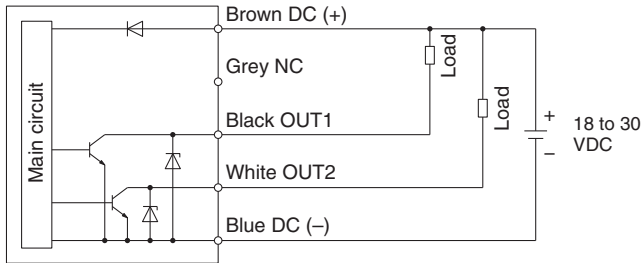

Setting of PNP open collector 2 outputs

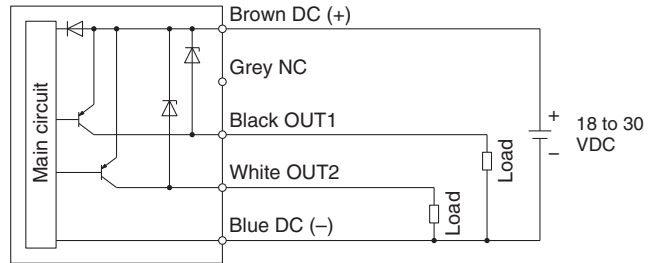


When used as an IO-Link device

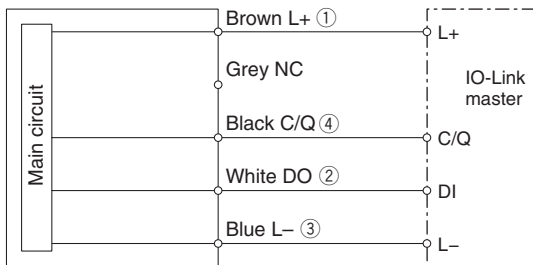


-RT/RR: Switch output 1 & 2 + Analogue voltage output

NPN setting

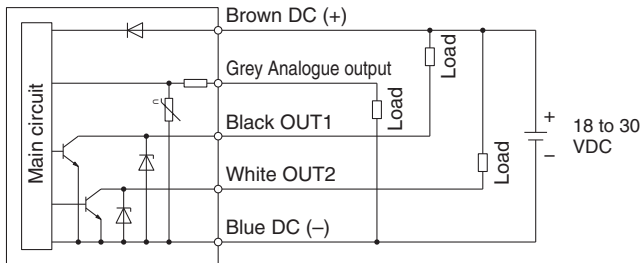


PNP setting

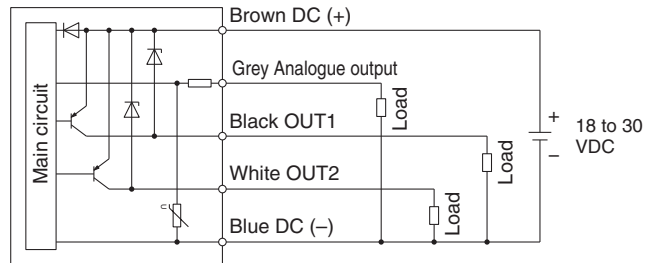


PSH Series

Dimensions

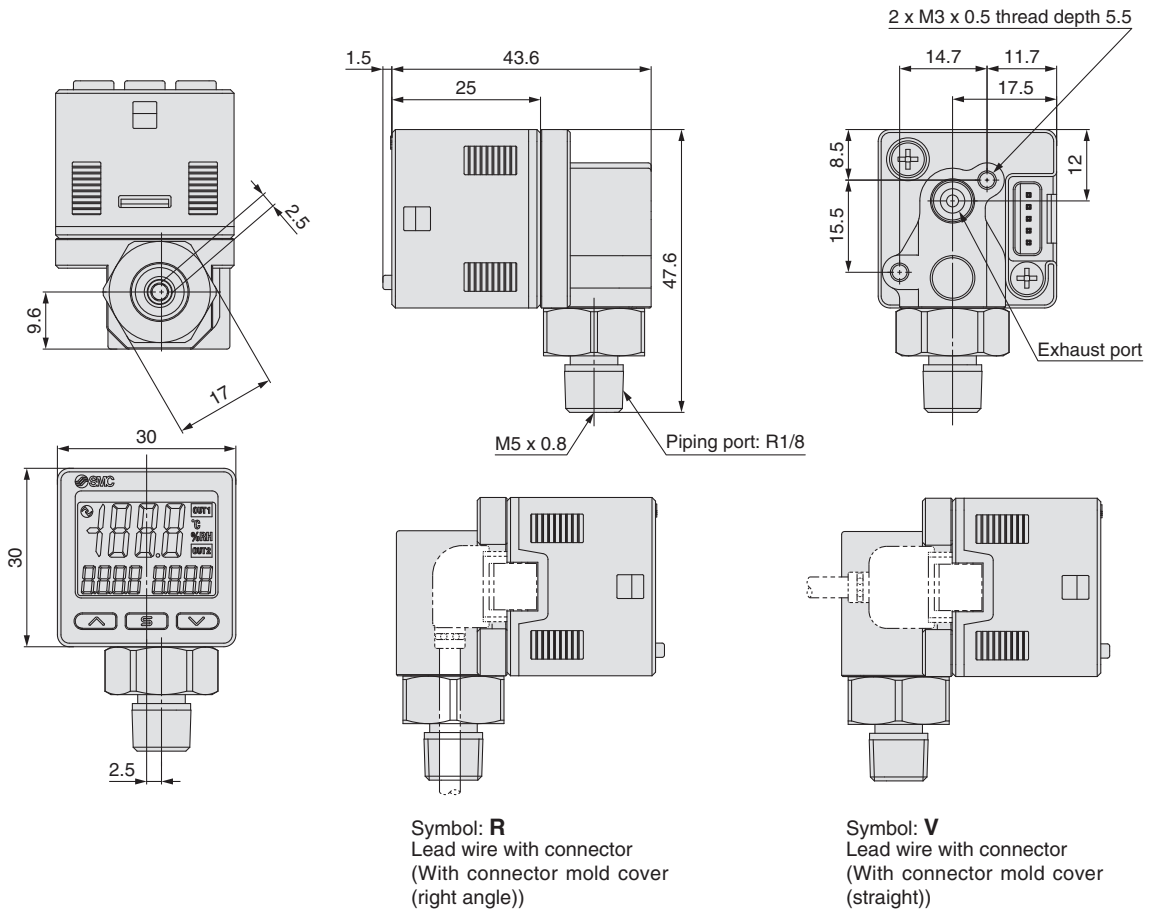


Bracket mounting dimensions

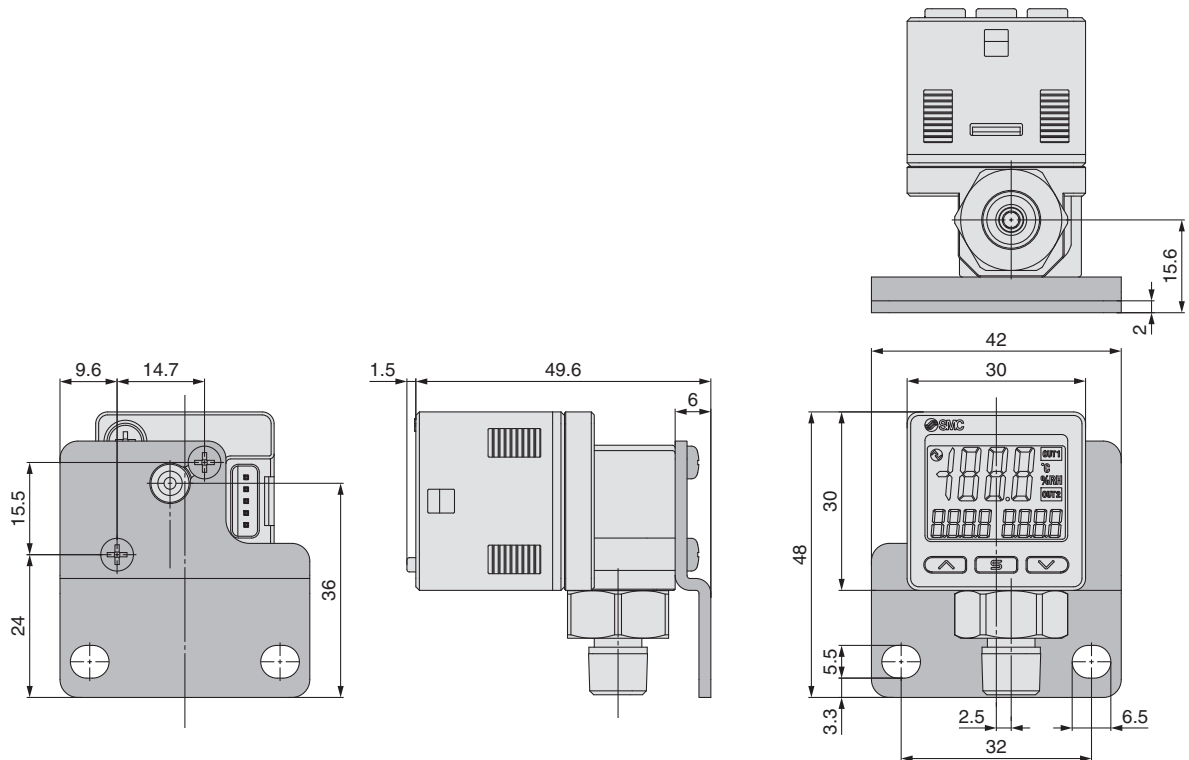


Dimensions

Panel mount adapter mounting dimensions

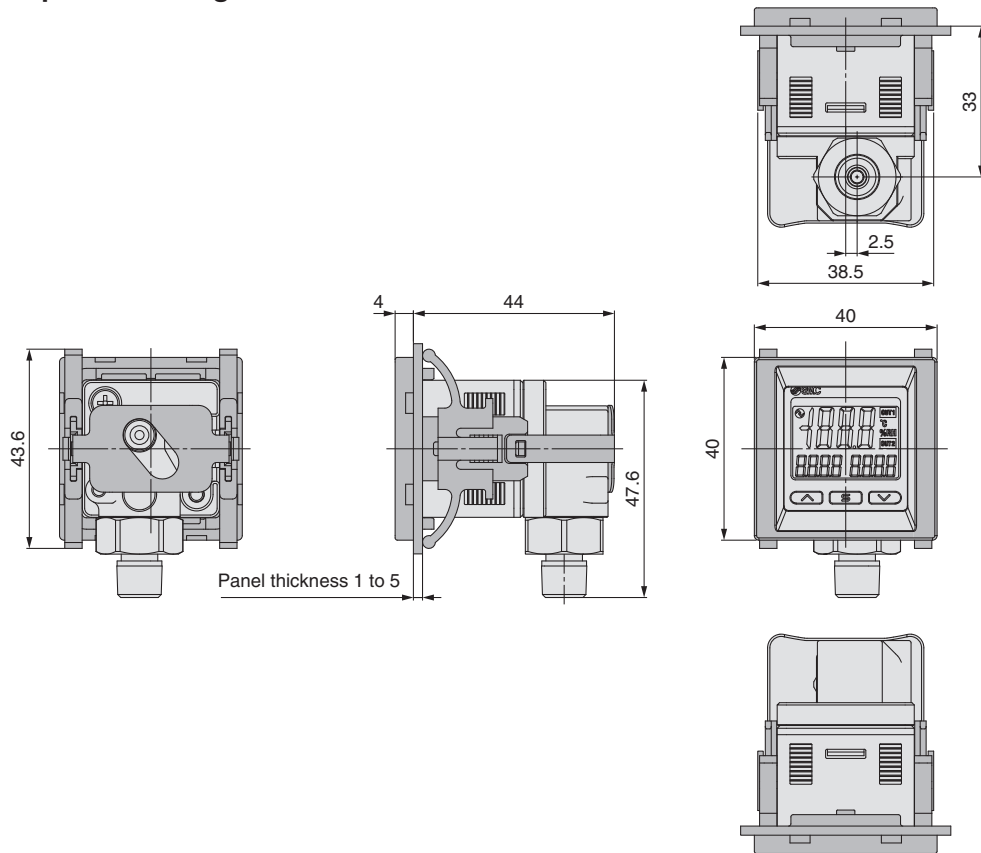

Panel mount adapter + front protection cover mounting dimensions

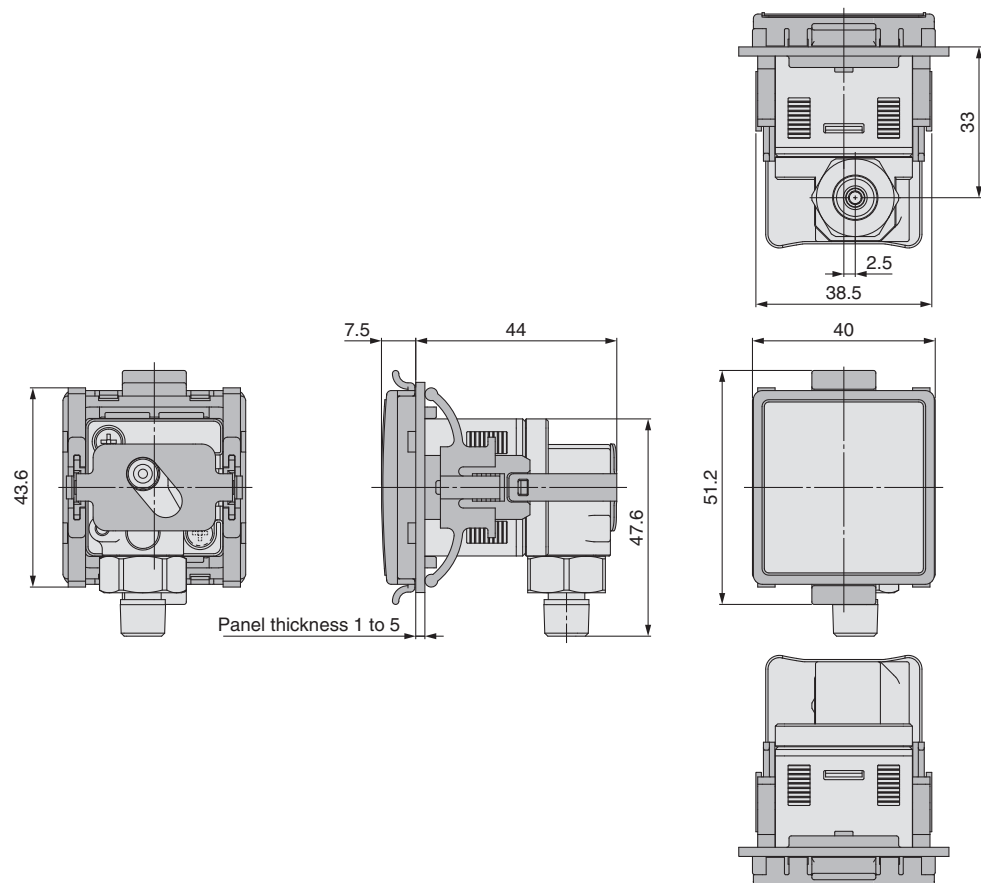


PSH Series


Dimensions

Panel cutout dimensions


Individual mounting

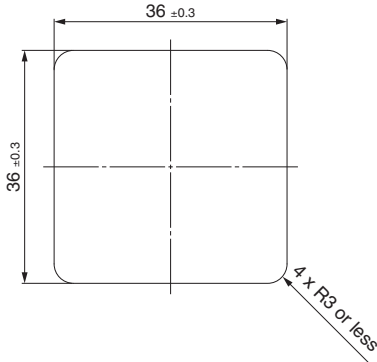


Multiple (2 pcs. or more) closely mounted <Horizontal>

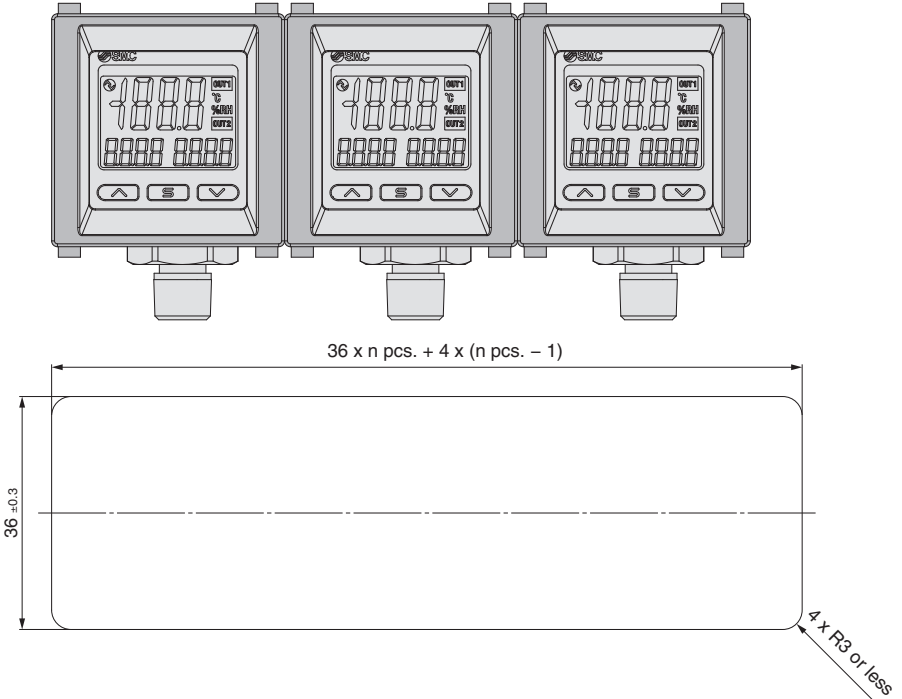


Lead wire with connector (Part no.: ZS-46-5F)

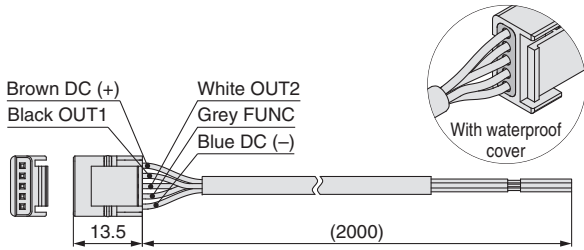


Lead wire with M12 connector (Part no.: ZS-46-5FM12)

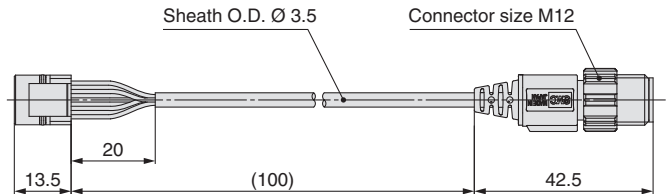


Lead wire with connector (With connector mold cover (straight)) (Part no.: ZS-46-5F-X525)



Lead wire with M12 connector (With connector cover) (Part no.: ZS-46-5F-X472)

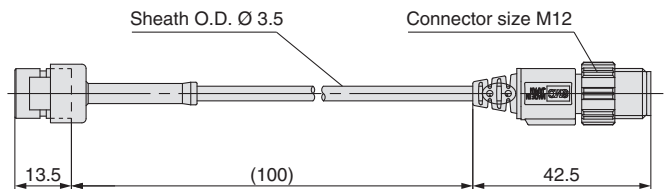


Lead wire with connector (With connector mold cover (right angle)) (Part no.: ZS-46-5F-X526)

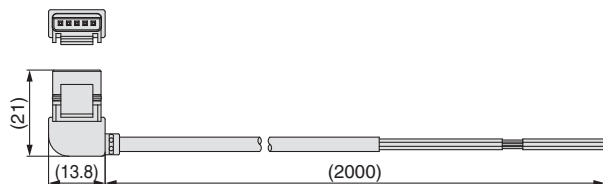

The connector pin assignment is the same as that of the ZS-46-5FM12.

Connector pin assignment

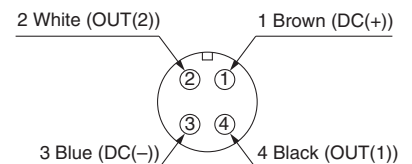

PSH Series

Technical Data

Relative Humidity in Piping (under pressure) ⇔ Atmospheric Pressure Relative Humidity (condensation checker display) Simple Conversion Formula

Relative Humidity is proportional to operating pressure at constant temperature.

Relative Humidity conversion guideline for inside piping (under pressure): It is possible to calculate from the condensation checker display value using the following multiplier.

For 0.3 MPa ⇒ 4 times, For 0.5 MPa ⇒ 6 times, For 0.7 MPa ⇒ 8 times, For 0.9 MPa ⇒ 10 times.

When the operating pressure is 0.4 MPa

$$\text{Relative Humidity in piping (under pressure)} = \frac{0.4 \text{ [MPa]} + 0.1 \text{ [MPa]}}{0.1 \text{ [MPa]}} \times 5 \text{ times} \times \text{Atmospheric pressure relative humidity (condensation checker display value)}$$

$$\text{Atmospheric pressure relative humidity (condensation checker display value)} = \frac{0.1 \text{ [MPa]}}{0.4 \text{ [MPa]} + 0.1 \text{ [MPa]}} \times \frac{1}{5} \text{ times} \times \text{In piping (below pressure) relative humidity}$$

Model Selection Software Setting Examples

Model Selection Software Humidity conversion/condensed water (drain) calculation software

Supports conversion related to humidity for humidity control

- When the temperature inside piping and the atmospheric pressure (ambient) temperature are different
- Dew point to relative humidity or relative humidity to dew point conversion

Refer to the SMC website before use.

To determine the threshold value of the condensation checker

* When the temperature inside piping and the atmospheric pressure (ambient) temperature are the same

Calculation of the relative humidity inside piping (under pressure) ⇒ atmospheric pressure relative humidity

Before conversion

Input the status under pressure.

➔ Relative humidity, pressure, and temperature under pressure

After conversion

Input the status detected by the condensation checker.

➔ Atmospheric pressure (0 MPa), temperature (Same temperature as in Status 1)

To calculate the relative humidity inside piping (under pressure) from the condensation checker display value

Calculation of the atmospheric pressure relative humidity ⇒ relative humidity inside piping (under pressure)

Before conversion

Input the status detected by the condensation checker.

➔ Condensation checker display value/threshold value (relative humidity), atmospheric pressure (0 MPa), temperature

After conversion

Input the status under pressure.

➔ Relative humidity, pressure, and temperature under pressure (Same temperature as in Status 1)

Before conversion

Select the air humidity you are aware of and enter the humidity and condition.

Relative humidity Atmospheric dew point Pressure dew point

Pressure (P ₁)	0.4	MPa	[0~10]
Temperature (T ₁)	20	°C	[-99~99]
Relative humidity	90	%	[0.1~100]
Atmospheric dew point	-4.5	°C	[-99~99]
Pressure dew point	18.3	°C	[-99~99]



after conversion

Calculation is performed when the air to be calculated is P₂ and T₂. Enter P₂ and T₂.

Pressure (P ₂)	0	MPa	[0~10]
Temperature (T ₂)	20	°C	[-99~99]
Relative humidity	18	%	[0.1~100]
Atmospheric dew point	-4.5	°C	[-99~99]
Pressure dew point	-4.5	°C	[-99~99]


PSH Series

When the temperature inside piping changes

The relative humidity changes according to the temperature. If the temperature inside piping changes due to the distance from the monitoring point, the relative humidity can be calculated using SMC's "Model Selection Software."

Example: To confirm the conditions on a cold day when water droplets are often generated by the cylinder

* The condensation checker cannot be installed close to a cylinder, so it is installed at a distance.

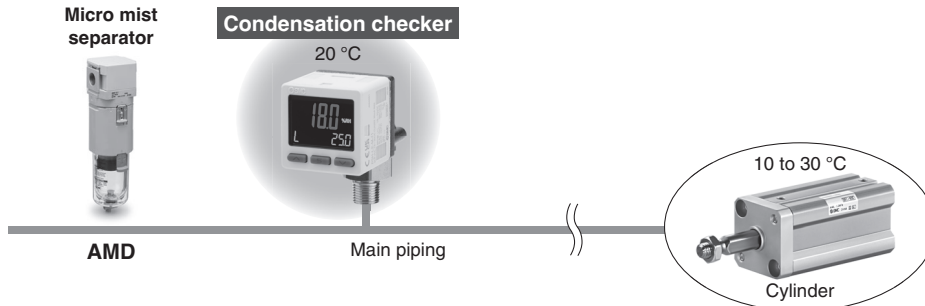

Example of operating conditions

- ① Operating pressure : 0.3 MPa
- ② Temperature inside piping: 20 °C (Condensation checker display value)
- ③ Temperature inside piping near cylinder: 10 °C
- ④ Atmospheric pressure relative humidity inside piping: 12 % (Condensation checker display value)

Before conversion				after conversion			
Select the air humidity you are aware of and enter the humidity and condition.				Calculation is performed when the air to be calculated is P ₂ and T ₂ . Enter P ₂ and T ₂ .			
<input checked="" type="radio"/> Relative humidity <input type="radio"/> Atmospheric dew point <input type="radio"/> Pressure dew point							
Pressure (P ₁)	0	MPa	[0~10]	Pressure (P ₂)	0.3	MPa	[0~10]
Temperature (T ₁)	20	°C	[-99~99]	Temperature (T ₂)	10	°C	[-99~99]
Relative humidity	12	%	[0.1~100]	Relative humidity	91.4	%	[0.1~100]
Atmospheric dew point	-9.1	°C	[-99~99]	Atmospheric dew point	-9.1	°C	[-99~99]
Pressure dew point	-9.1	°C	[-99~99]	Pressure dew point	8.7	°C	[-99~99]

The relative humidity inside the terminal piping (under pressure) is 91.4 %R.H.

Input the atmospheric pressure (MPa) for the pressure (P1).

When the temperature rises in the conditions shown on the above
 When the temperature near the cylinder rises to 30 °C, the relative humidity inside piping can be calculated as follows.
 (Measure the temperature as required.)

Before conversion				after conversion			
Select the air humidity you are aware of and enter the humidity and condition.				Calculation is performed when the air to be calculated is P ₂ and T ₂ . Enter P ₂ and T ₂ .			
<input checked="" type="radio"/> Relative humidity <input type="radio"/> Atmospheric dew point <input type="radio"/> Pressure dew point							
Pressure (P ₁)	0	MPa	[0~10]	Pressure (P ₂)	0.3	MPa	[0~10]
Temperature (T ₁)	20	°C	[-99~99]	Temperature (T ₂)	30	°C	[-99~99]
Relative humidity	12	%	[0.1~100]	Relative humidity	26.4	%	[0.1~100]
Atmospheric dew point	-9.1	°C	[-99~99]	Atmospheric dew point	-9.1	°C	[-99~99]
Pressure dew point	-9.1	°C	[-99~99]	Pressure dew point	8.7	°C	[-99~99]

The relative humidity inside the terminal piping (under pressure) is 26.4 %R.H.


When the temperature inside piping changes

⚠ Caution

Condensation Checker precautions

Do not separate the condensation checker from the fluid to be measured.

* Measurement accuracy and responsiveness performance will be reduced.

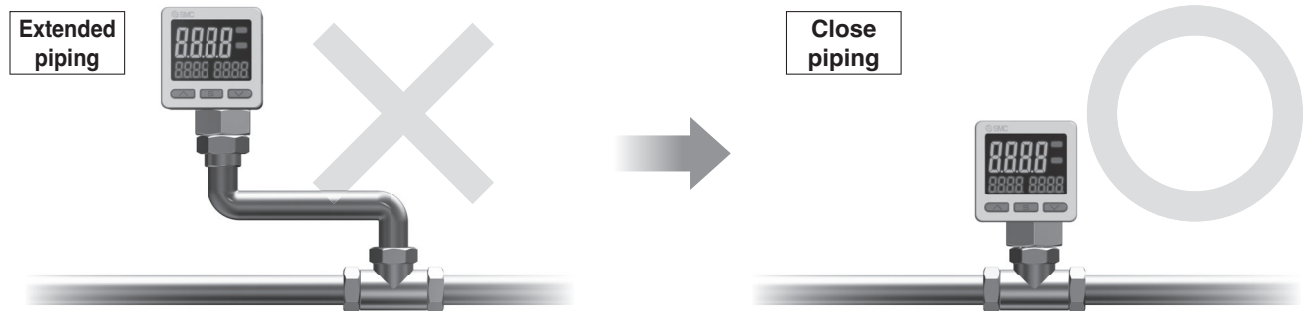




If the product is separated from the original piping, accurate measurements will no longer be possible due to external disturbances such as temperature variation in the extended piping. In addition, increasing the distance from the original piping slows down the temperature transmission and the response.

Direct mounting to the piping is recommended.

Safety Instructions

These safety instructions are intended to prevent hazardous situations and/or equipment damage. These instructions indicate the level of potential hazard with the labels of “Caution,” “Warning” or “Danger.” They are all important notes for safety and must be followed in addition to International Standards (ISO/IEC)¹⁾, and other safety regulations.

 Danger:	Danger indicates a hazard with a high level of risk which, if not avoided, will result in death or serious injury.
 Warning:	Warning indicates a hazard with a medium level of risk which, if not avoided, could result in death or serious injury.
 Caution:	Caution indicates a hazard with a low level of risk which, if not avoided, could result in minor or moderate injury.

- 1) ISO 4414: Pneumatic fluid power – General rules and safety requirements for systems and their components.
ISO 4413: Hydraulic fluid power – General rules and safety requirements for systems and their components.
IEC 60204-1: Safety of machinery – Electrical equipment of machines. (Part 1: General requirements)
ISO 10218-1: Robots and robotic devices - Safety requirements for industrial robots - Part 1: Robots.
etc.

Warning

1. The compatibility of the product is the responsibility of the person who designs the equipment or decides its specifications.

Since the product specified here is used under various operating conditions, its compatibility with specific equipment must be decided by the person who designs the equipment or decides its specifications based on necessary analysis and test results. The expected performance and safety assurance of the equipment will be the responsibility of the person who has determined its compatibility with the product. This person should also continuously review all specifications of the product referring to its latest catalogue information, with a view to giving due consideration to any possibility of equipment failure when configuring the equipment.

2. Only personnel with appropriate training should operate machinery and equipment.

The product specified here may become unsafe if handled incorrectly. The assembly, operation and maintenance of machines or equipment including our products must be performed by an operator who is appropriately trained and experienced.

3. Do not service or attempt to remove product and machinery/equipment until safety is confirmed.

1. The inspection and maintenance of machinery/equipment should only be performed after measures to prevent falling or runaway of the driven objects have been confirmed.
2. When the product is to be removed, confirm that the safety measures as mentioned above are implemented and the power from any appropriate source is cut, and read and understand the specific product precautions of all relevant products carefully.
3. Before machinery/equipment is restarted, take measures to prevent unexpected operation and malfunction.

4. Our products cannot be used beyond their specifications. Our products are not developed, designed, and manufactured to be used under the following conditions or environments.

Use under such conditions or environments is not covered.

1. Conditions and environments outside of the given specifications, or use outdoors or in a place exposed to direct sunlight.
2. Use for nuclear power, railways, aviation, space equipment, ships, vehicles, military application, equipment affecting human life, body, and property, fuel equipment, entertainment equipment, emergency shut-off circuits, press clutches, brake circuits, safety equipment, etc., and use for applications that do not conform to standard specifications such as catalogues and operation manuals.
3. Use for interlock circuits, except for use with double interlock such as installing a mechanical protection function in case of failure. Please periodically inspect the product to confirm that the product is operating properly.

Caution

We develop, design, and manufacture our products to be used for automatic control equipment, and provide them for peaceful use in manufacturing industries.

Use in non-manufacturing industries is not covered.

Products we manufacture and sell cannot be used for the purpose of transactions or certification specified in the Measurement Act.

The new Measurement Act prohibits use of any unit other than SI units in Japan.

Limited warranty and Disclaimer/Compliance Requirements

The product used is subject to the following “Limited warranty and Disclaimer” and “Compliance Requirements”. Read and accept them before using the product.

Limited warranty and Disclaimer

1. The warranty period of the product is 1 year in service or 1.5 years after the product is delivered, whichever is first.²⁾ Also, the product may have specified durability, running distance or replacement parts. Please consult your nearest sales branch.
2. For any failure or damage reported within the warranty period which is clearly our responsibility, a replacement product or necessary parts will be provided. This limited warranty applies only to our product independently, and not to any other damage incurred due to the failure of the product.
3. Prior to using SMC products, please read and understand the warranty terms and disclaimers noted in the specified catalogue for the particular products.
- 2) Vacuum pads are excluded from this 1 year warranty.
A vacuum pad is a consumable part, so it is warranted for a year after it is delivered. Also, even within the warranty period, the wear of a product due to the use of the vacuum pad or failure due to the deterioration of rubber material are not covered by the limited warranty.

Compliance Requirements


1. The use of SMC products with production equipment for the manufacture of weapons of mass destruction (WMD) or any other weapon is strictly prohibited.
2. The exports of SMC products or technology from one country to another are governed by the relevant security laws and regulations of the countries involved in the transaction. Prior to the shipment of a SMC product to another country, assure that all local rules governing that export are known and followed.

Safety Instructions

Be sure to read “Handling Precautions for SMC Products” (M-E03-3) before using.

SMC Corporation (Europe)

Austria	+43 (0)2262622800	www.smc.at	office@smc.at
Belgium	+32 (0)33551464	www.smc.be	info@smc.be
Bulgaria	+359 (0)2807670	www.smc.bg	office@smc.bg
Croatia	+385 (0)13707288	www.smc.hr	office@smc.hr
Czech Republic	+420 541424611	www.smc.cz	office@smc.cz
Denmark	+45 70252900	www.smc.dk.com	smc@smcdk.com
Estonia	+372 651 0370	www.smcee.ee	info@smcee.ee
Finland	+358 207513513	www.smc.fi	smcfi@smc.fi
France	+33 (0)164761000	www.smc-france.fr	supportclient@smc-france.fr
Germany	+49 (0)61034020	www.smc.de	info@smc.de
Greece	+30 210 2717265	www.smchellas.gr	sales@smchellas.gr
Hungary	+36 23513000	www.smc.hu	office@smc.hu
Ireland	+353 (0)14039000	www.smcautomation.ie	sales@smcautomation.ie
Italy	+39 03990691	www.smcitalia.it	mailbox@smcitalia.it
Latvia	+371 67817700	www.smc.lv	info@smc.lv

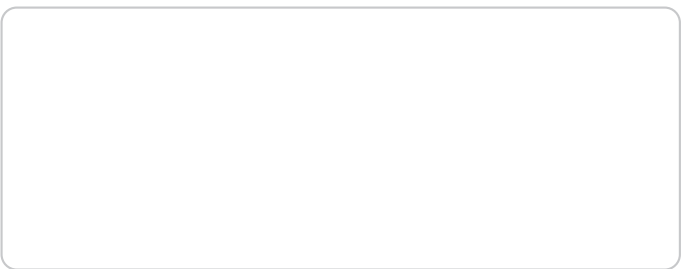

Lithuania	+370 5 2308118	www.smclt.lt	info@smclt.lt
Netherlands	+31 (0)205318888	www.smc.nl	info@smc.nl
Norway	+47 67129020	www.smc-norge.no	post@smc-norge.no
Poland	+48 222119600	www.smc.pl	sales@smc.pl
Portugal	+351 214724500	www.smc.eu	apoioclientept@smc.smces.es
Romania	+40 213205111	www.smcromania.ro	smcromania@smcromania.ro
Russia	+7 (812)3036600	www.smc.eu	sales@smcru.com
Slovakia	+421 (0)413213212	www.smc.sk	office@smc.sk
Slovenia	+386 (0)73885412	www.smc.si	office@smc.si
Spain	+34 945184100	www.smc.eu	post@smc.smces.es
Sweden	+46 (0)86031240	www.smc.nu	smc@smc.nu
Switzerland	+41 (0)523963131	www.smc.ch	helpcenter.ch@smc.com
Turkey	+90 212 489 0 440	www.smcturkey.com.tr	info@smcturkey.com.tr
UK	+44 (0)845 121 5122	www.smc.uk	sales@smc.uk
South Africa	+27 10 900 1233	www.smcza.co.za	zasales@smcza.co.za